

Level One Compliance Report

Bulk Earthworks Filling Operations Everleigh Precinct 12.2, SP2 Teviot Road, Greenbank

September 13th, 2021

Prepared By

MORRISON GEOTECHNIC PTY LTD

Prepared for:

Shadforth Civil

Document Reference: 21153 - GL21/028



MORRISON
GEOTECHNIC



Gold Coast Office
Job No: GL21/028
Ref No: 21153
Author: Ian Masman

13th September 2021

Shadforth Civil
99 Sandalwood Lane
Forest Glen Qld 4556

ATTENTION: MR DAVID BUGDEN
Email: david.bugden@shadcivil.com.au

Dear Sir,

**RE: LEVEL ONE COMPLIANCE REPORT FOR
BULK EARTHWORKS FILLING OPERATIONS,
EVERLEIGH PRECINCT 12.2 SP2
TEVIOT ROAD, GREENBANK.**

Table of Contents

Table of Contents	1
1.0 INTRODUCTION	2
1.1 General.....	2
1.2 Previous Earthworks.....	5
1.3 The Project.....	5
2.0 THE BRIEF	6
2.1 Additional Requirements.....	6
3.0 METHODOLOGY	7
3.1 Stripped Surface Assessment.....	7
3.1.1 Filling Operations.....	8
4.0 STATEMENT OF COMPLIANCE	11
5.0 EXCLUSIONS	11
6.0 LIMITATIONS	11
ATTACHMENTS:	12
Appendix A – Site Plans Showing Test Locations.....	12
Appendix B – Laboratory Test Results Reports.....	12
Appendix C – Previous Level 1 Report GL20/129 – Bulk Earthworks Operations, Everleigh Precinct.....	12

1.0 INTRODUCTION

1.1 General

This report presents results of Level One Earthworks Inspections and associated compaction compliance testing carried out on earthworks fill constructed at the Everleigh Estate – Precinct 12.2 SP2, Teviot Road, Greenbank.

Earthworks operations were constructed by Shadforth Civil.

Earthwork filling operations for Precinct 12.2 allotments and roads were carried between 13th April 2021 and 31st August 2021

The areas of fill covered by this report are presented as Figures 1A, 1B and 2 below.

Figure 1A and Figure 1B presents the extent of earthworks as shown on Premise Earthworks Drawings MIR012-02-C200C and MIR012-02-C201D.

Figure 2 presents the as constructed areas and actual areas of fill as shown on Shadforth Civil Survey Plans.

Figure 1A: Extent of Fill - Premise Earthwork Drawing MIR012-02-C200C

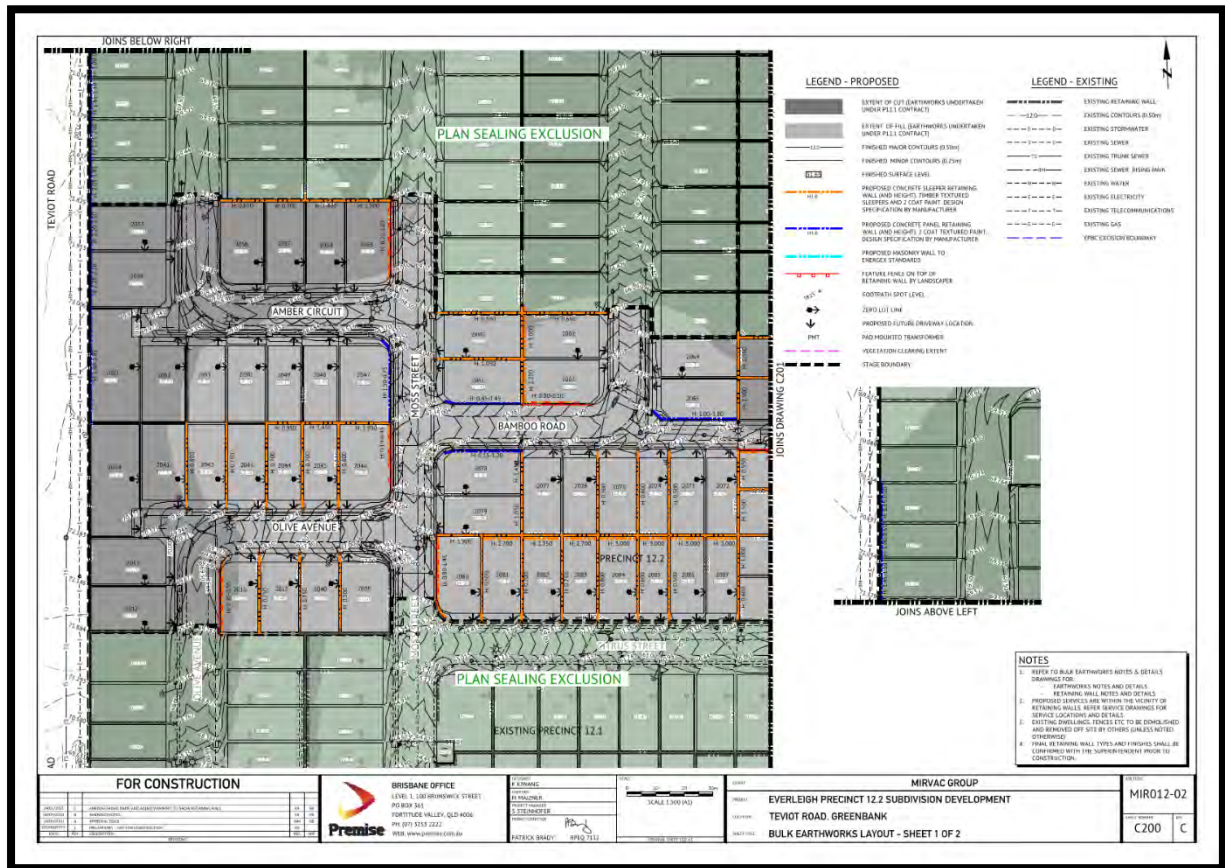


Figure 1B: Extent of Fill - Premise Earthwork Drawing MIR012-02-C201D



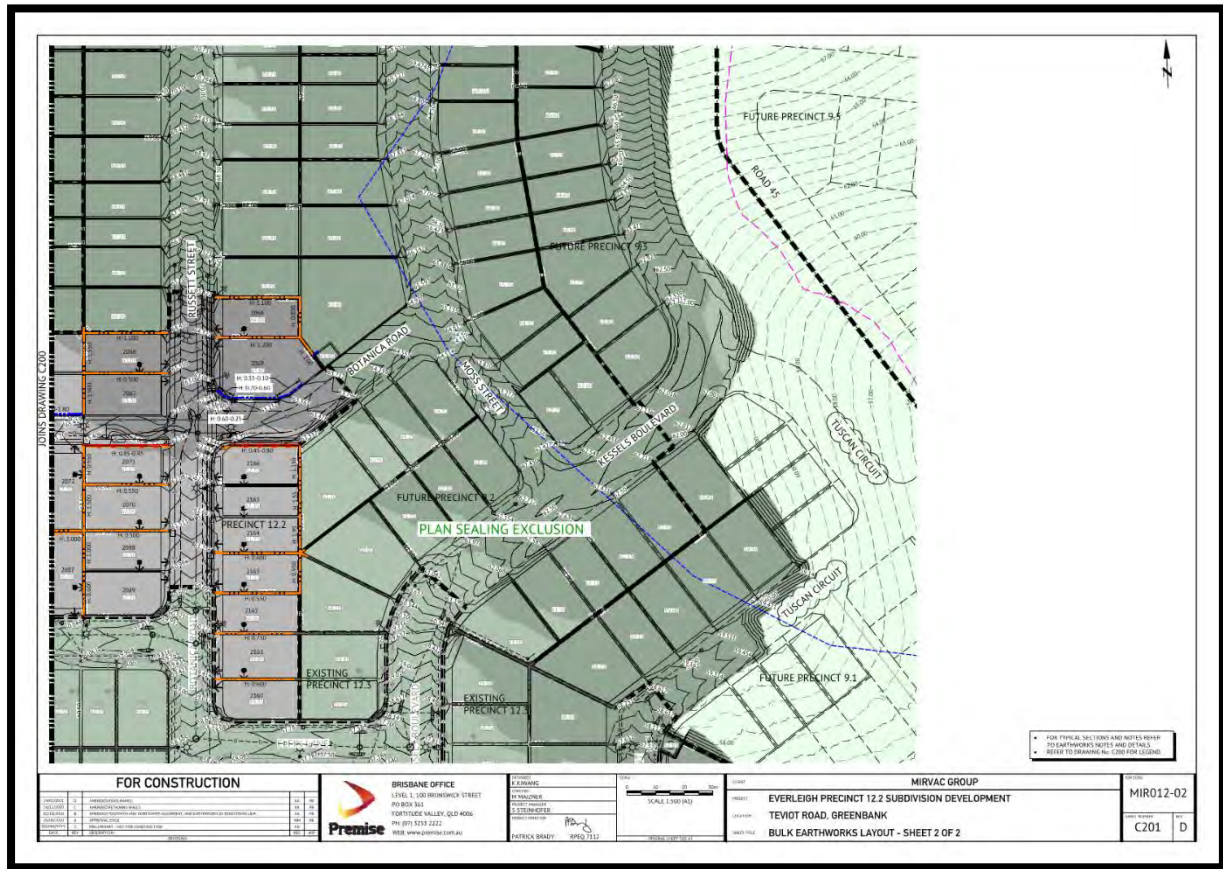


Figure 2: Actual Constructed Area of Fill – Shadforth Survey Plans

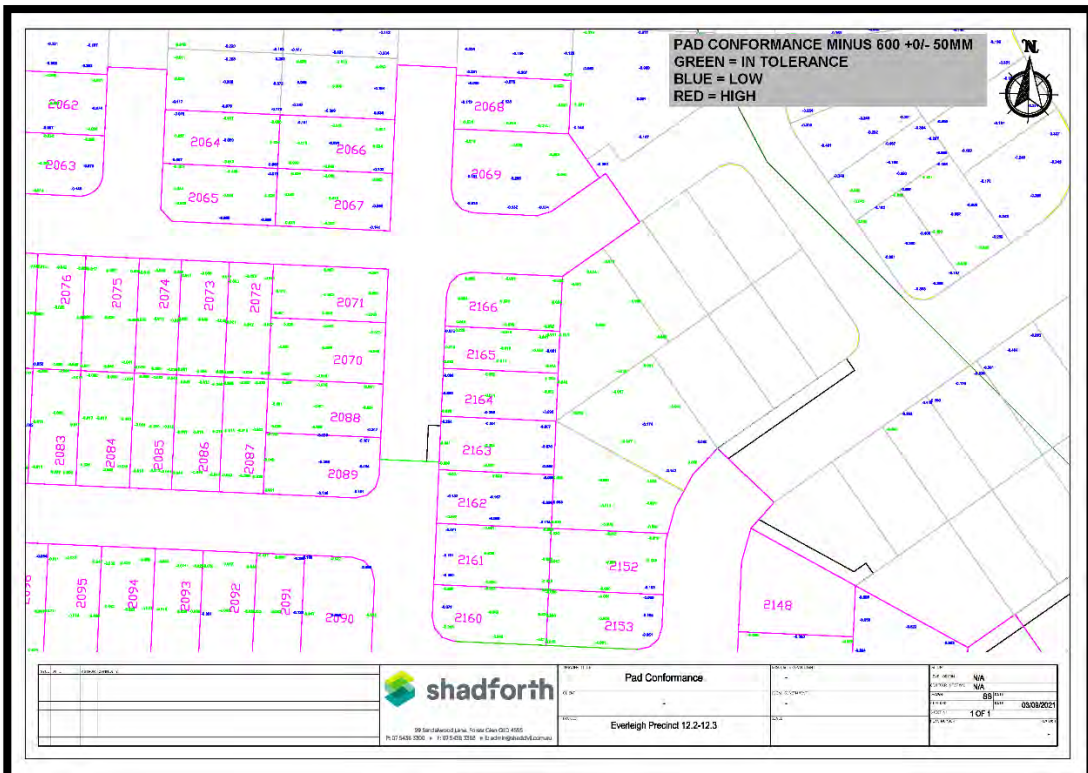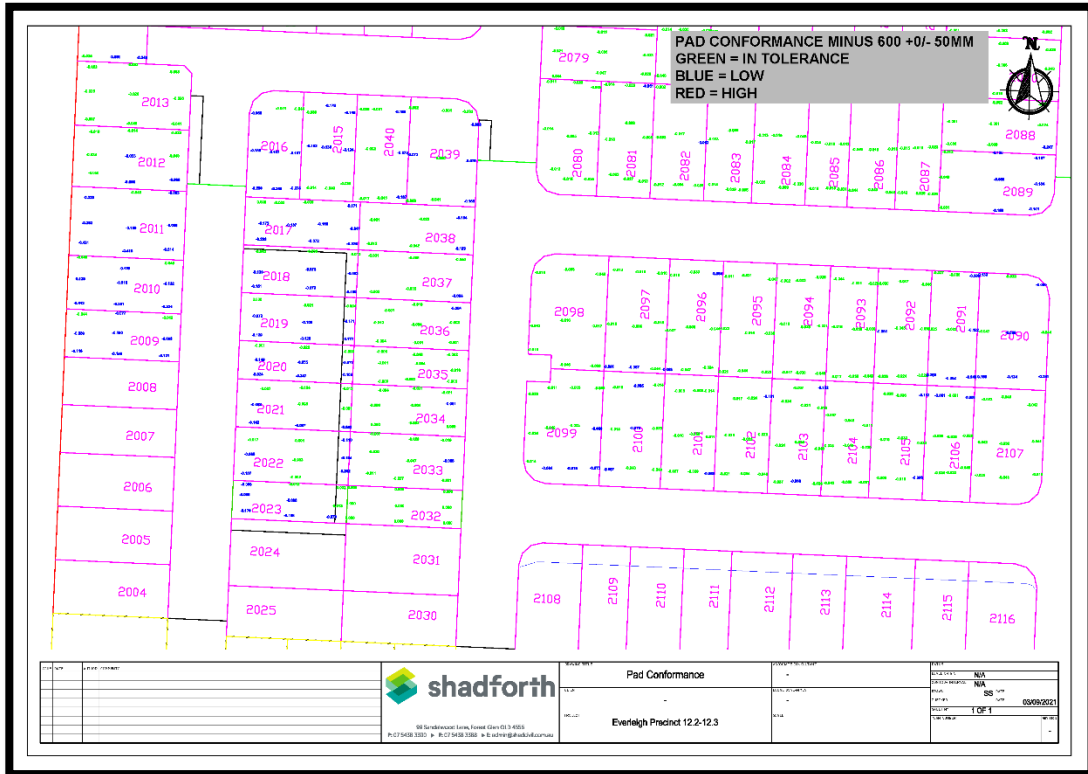

1.2 Previous Earthworks

Previous Earthworks have been carried out at The Site by Shadforth Civil between 11th November 2020 and 11th February 2021 with Quality Control Inspection and Testing being performed by Morrison Geotechnic.


Details of the previously placed fill material is contained in Morrison Geotechnic report “GL20/129 – Bulk Earthworks Operations, Everleigh Precinct 12.1 Reference 21014 (Dated 15th February 2021)” which is attached in Appendix C of this report.

The extent of this previous fill placed between November and February 2021 is presented below as Figure 4.

The fill placed between November and February 2021 is considered to have been placed and compacted in an appropriately controlled manner and suitable for the support of the new fill to which this report relates to.

The remaining portions of the site, outside the areas shown in Figure 4, are believed to; as far as could be assessed, have not undergone any previous earthworks filling operations.

Figure 4: Extent of Previously Placed Fill – (GL20/129, Dated 15th February 2021)

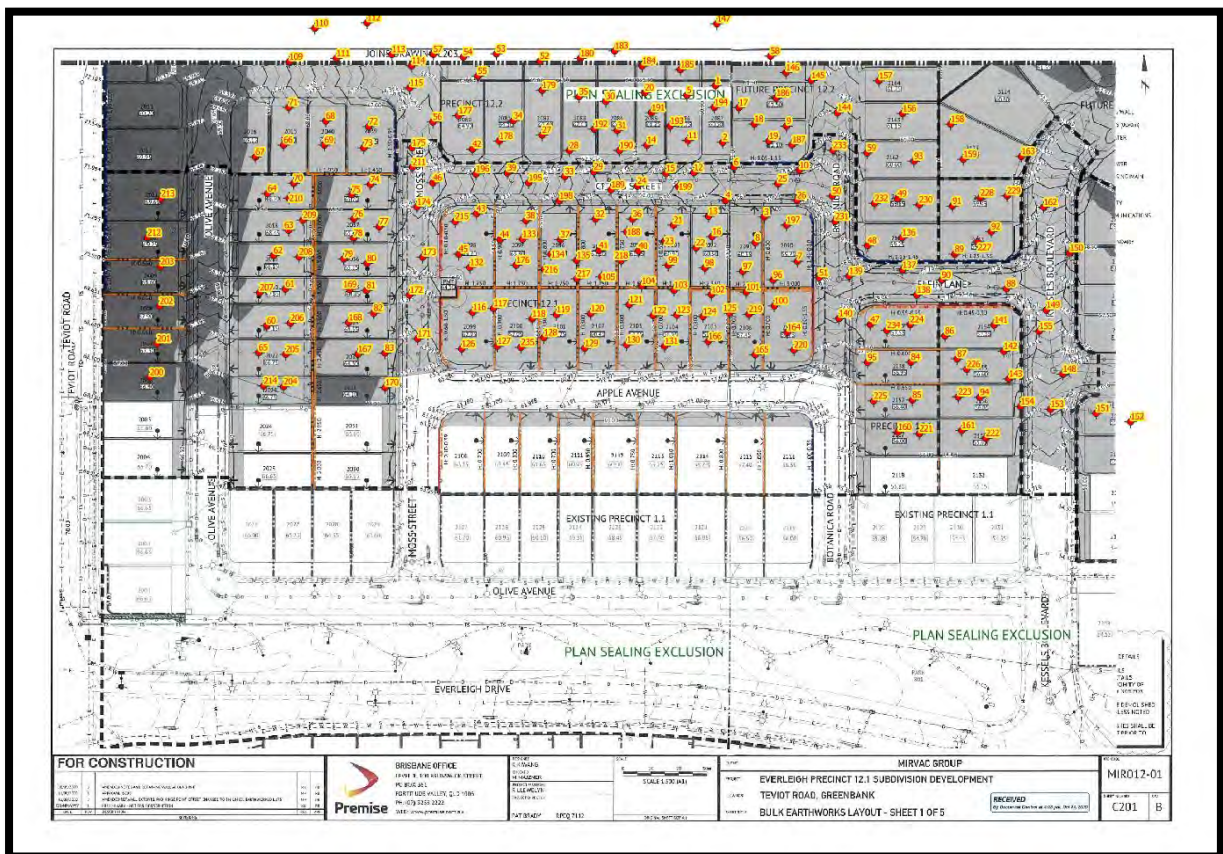

1.3 The Project

The project includes filling operations to construct building platforms supporting proposed residences, new pavements, and underground services. The Site is bounded by Existing Precincts to the south, existing developments to the west and future precincts to the north.

2.0 THE BRIEF

The Brief from the Client was limited to:

- Level One Inspection and Testing of the placement and compaction of fill materials in general accordance with AS3798 2007 – “Guidelines on Earthworks for Commercial and Residential Developments”.
- Relative Density Control Testing in accordance with AS1289 – Testing of Soils for Engineering Purposes and at frequencies required in AS3798 Table 8.1.
- Earthworks Notes on MIR012-02-C200C Drawings.
- Recommendations in Morrison Geotechnic report “recommended filling Earthworks specification” report 16520B, dated 25th June 2020.

2.1 Additional Requirements

All fill at The Site was to be constructed in accordance with the Earthworks Specification as shown on Premise Drawing – MIR012-02 C210 Rev B.

The earthworks specification is presented as Figure 5 below.

Figure 5 Earthworks Specification

EARTHWORKS SPECIFICATION						
SPECIFICATION	DEPTH RANGE (m)				PAVEMENT SUBGRADE	TRENCH BACKFILL
	0.0 - 0.6	0.6 - 3.00	3.00 - 5.00	> 5.00		
CBR %	-	-	-	-	10	15
LAYER THICKNESS (mm)	300	300	300	300	BETWEEN SUBGRADE AND 0.3m BELOW	300
MAXIMUM PARTICLE SIZE (mm)	200	500	500	500	200	200
% PASSING 37.5mm	80% MIN	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES
% PASSING 0.075mm	30% MIN	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES AND AS3798
COMPACTION	95% STD	95% STD	95% STD	95% STD	100% STD	95% MOD IN ROADS AND 95% STD OUTSIDE ROADS
MOISTURE	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	60% - 90% OF OMC	+/- 2% OMC

NOTES:

1. OMC - OPTIMUM MOISTURE CONTENT
2. LAYER OF THICKNESS IS LIMITED TO 300mm TO ALLOW IDENTIFICATION OF LARGER PARTICLES AND ALLOW EVERY CHANCE OF BREAK DOWN IN FILLING OR REMOVAL.
3. TREATMENT OF ROCK TO SIZES ABOVE SHOULD BE CARRIED OUT IN CUT PRIOR TO LOADING TO FILL AREAS. TREATED ROCK TO BE APPROVED BY GITA PRIOR TO TRANSPORTING.
4. UPPER 0.6m, (PARTICULARLY IN AREAS OF DEEP FILL), OF THE FILL PROFILE TO BE RELATIVELY IMPERMEABLE HENCE INCREASE IN FINES COMPONENT.
5. PROOF ROLL TESTING ON EACH COMPACTED LAYER USING RUBBER WHEELED PLANT SUCH AS LOADED ADT'S OR LOADED SCRAPERS. UNFAVOURABLE DEFORMATION OF THE COMPACTED SURFACE UNDER LOAD OF ADT'S OR SCRAPERS WILL REQUIRE REPAIR PRIOR TO ADDITIONAL PLACEMENT.
6. MECHANICAL INTERLOCK METHODOLOGY IS NOT APPROPRIATE DUE TO POOR DURABILITY OF SITE WON SANDSTONE. FILL COMPOSITION IS REQUIRED TO INCLUDE AN APPROPRIATE SAND GRAVEL AND FINES COMPONENT CONFORMING TO THE REQUIREMENTS OF AS798.

KEY OUTCOMES FOR EARTHWORKS OPERATIONS

1. DELIVER RESIDENTIAL LOTS WITH FAVOURABLE LOT CLASSIFICATIONS - I.E - NO P CLASSIFICATIONS
2. FILL THICKNESS DOES NOT VARY MORE THAN 2m OVER A DISTANCE OF 10m
3. CONSTRUCT FILL AND LIMIT LONG TERM CREEP SETTLEMENTS TO WITHIN 0.5% TO 1.0% OF THE FILL THICKNESS
4. BUILDING PLATFORM THAT ALLOWS BUILDERS TO CONSTRUCT SLAB ON GROUND RAFTS USING LIGHT EARTHMOVING EQUIPMENT
5. MATERIAL WON FROM CUTS AND USED IN FILL WITH REQUIRE
 - CUTS IN ROCK AS WELL AS BLENDED WITH
 - CUTS IN FINER MATERIALS SUCH AS SANDS AND CLAYS
6. CREATING A FILL PLATFORM THAT IS ABLE TO BE TESTED IN ACCORDANCE WITH AS3798 AND AS1289

Lots and pavements where rock of medium strength or stronger was exposed at the final cut earthworks levels, was cut to a depth of approximately 0.6m below the final earthworks levels. The excavated rock was then replaced with fill materials compliant with the specification requirements for materials within the 0.0m to 0.6m depth range as described in Figure 5 and compacted accordingly.

3.0 METHODOLOGY

Earthworks Inspections and Testing was carried out on the stripped ground surfaces and during the placement and compaction of fill materials.

Field and laboratory testing included a walk over assessments of the existing ground conditions, proof roll testing of the fill foundations, observations of filling and compaction activities and compaction testing.

3.1 Stripped Surface Assessment

The fill areas covered by this report were stripped and cleared of visible loose materials, vegetation, and topsoil.

Materials exposed after stripping and formed the fill foundation can be broadly summarised as:

- Natural - Silty Sand (SM) – at least dense, fine to medium grained sands, traces of low plasticity fines, grey – brown and moist.
- Natural – Sandy Clay (CI) – at least Very Stiff, medium plasticity, fine to medium grained sand, pale brown mottled orange and moist.
- Natural – Sandstone (XW-HW) – Extremely to Highly weathered, very low to low strength, orange – yellow brown
- Natural – Sandstone (MW-SW) – Moderately to Slightly weathered, medium, high, and very high strength, yellow grey, and pale grey
- Existing Fill – Clayey Sand (SC) fine to coarse sand, fine to coarse gravel, yellow brown and moist.
- Existing Fill – Gravelly Sand Clay (CI) medium plasticity, fine to coarse sand, fine to coarse gravel, yellow / brown moist.

Following the stripped surface assessment of the fill areas, the foundation was approved for filling using the following process:

- Walk over assessments confirming that a competent natural foundation had been exposed.

Proof roll testing using large sized truck carrying out multiple passes confirming no movement of the exposed natural or existing fill foundation.

Picture 1: View of The Site During Stripping Operations



3.1.1 Filling Operations

Fill materials were sourced onsite and can be broadly summarised as: -

- Imported Clayey Sand (SC), fine to coarse sand, medium plasticity fines, with fine to coarse gravel, yellow brown and moist.
- Onsite Gravelly Sandy Clay (CI), medium plasticity fines, fine to coarse sand, fine to coarse gravel, yellow - brown and moist.
- Ripped Sandstone with engineering properties of Gravelly Clayey Sand (SC), fine to coarse sand, fine to coarse gravel, low to medium plasticity fines with cobbles up to 200mm max.
- Blasted Sandstone with engineering properties of Gravelly Clayey Sand (SC), fine to coarse sand, fine to coarse gravel, low to medium plasticity fines with cobbles up to 200mm max.

Ripping operations were required to loosen high and very high strength sandstone. Ripped rock was then processed using mechanical crushing plant.

Methodology for the rock crushing operations can be broadly summarised as: -

- Large rock fragments were broken down by an excavator with hammer attachment to sizes acceptable by the mechanical crushing plant.
- Mechanical Crushing to reduce rock fragments to 200mm size or less.
- Mixing crushed product with onsite materials using a front-end loader and placed into stockpiles assessed to be suitable fill and earthwork operations.

Placement and compaction of the fill materials was carried out using the following plan: -

- Water Carts
- Pad Foot Roller
- Dozers
- Excavators
- Grader
- Front End Loader
- Cat 825 Compactor
- Articulated Dump Truck's
- Mechanical Rock Crusher's

The fill materials were moisture conditioned at the fill source and during placement to moisture contents suitable for compaction. Deleterious materials such as organics, sticks, roots and over size particles were sorted and removed during placement or were rejected for use. Occasional oversize particles including cobbles may be present in the deeper fill profile, however, are not considered to affect the fill as a mass.

Placement of the fill materials was carried out in layers appropriate for the above plant and compacted using the above plant carrying out multiple passes.

Our representative observed the filling process as described above and was assessed to be consistent for the entire thickness of fill.

Field density tests and laboratory compactions were carried out on the fill materials in accordance with Table 5.1 and 8.1 of AS3798 2007 (Guidelines on Earthworks for Commercial and Residential Developments) and tested to AS1289 test methods (Testing of Soils for Engineering Purposes).

Testing achieved the required specification of 95% of the Hilt Density at the test locations.

Fill placed and compacted at measured density ratios less than 95% were tined, moisture conditioned and re-compacted until the required specification was achieved. Retesting was carried out using Random Stratified Location methods.

The Location of the field density tests are shown on the Site Plans contained in Appendix A. These test locations and levels were not obtained by survey and therefore should only be considered as approximate.

Picture 2: View of the Crushing Operation and Produced Product



Picture 3: View of the Site During Construction



Picture 4: View of the Site During Construction



4.0 STATEMENT OF COMPLIANCE

Our representatives observed the relevant earthworks operations including the stripped surface, fill placement and compaction operations and carried out field density tests and laboratory compaction tests in accordance with the required standard (AS3798, AS1289). Testing achieved the required specification of 95% Standard at the test locations.

It is confirmed that Level One Inspection and Testing has been carried out on the filling operation and limited to the extent shown in Figure 2. Based on the observations made by our Geotechnicians and the results of the field and laboratory tests, the placed and compacted fill at the above project has, as far as we have been able to assess, been constructed in general accordance with the intent of AS3798.

The fill can be deemed to be “controlled” in accordance with AS2870.

5.0 EXCLUSIONS

This statement does not include any topsoil, which may be placed for use as dressing, trench backfill, areas outside the areas shown in Figure 2 or any other subsequent earthworks after 31st August 2021

Assessments of material quality such as soaked CBR and site classifications are excluded from this commission.

Our on-site attendance specifically excludes assessments of fill material quality and engineering properties that are outside the requirements of AS3798 – 2007.

Footings and ground slabs for any structures constructed over natural soils or controlled fill should be designed to accommodate the characteristic ground surface movements and settlement potential. Assessments of these design parameters are beyond the scope of this Report.

6.0 LIMITATIONS

This Report has been prepared by Morrison Geotechnic Pty Ltd (**Morrison Geotechnic**), and may include contributions from Morrison Geotechnic’s officers and employees, sub-contractors, sub-consultants, or agents (**Contributors**).

This Report is for the sole benefit and use of Shadforth Civil Pty Ltd (**Client**), its designers, clients, and relevant statutory authorities for the sole purpose of providing geotechnical advice and recommendations in respect of the Bulk Earthworks Filling Operations, Precinct 12.2 SP2, Everleigh Estate (**Project**). The Report is only intended to address those issues expressly described in the Brief/ Work Instructions in this Report.

This Report should not be used or relied upon for any other purpose without Morrison Geotechnic’s prior written consent. Morrison Geotechnic and the Contributors do not accept any responsibility or liability in any way whatsoever for the use or reliance of this Report by anyone other than Golding Urban Pty Ltd (**Client**), its designers, its clients, and relevant statutory authorities or by anyone else for any purpose other than that for which it has been prepared.

Except with Morrison Geotechnic’s prior written consent, this Report may not be:

- (a) released to any other party, whether in whole or in part (other than to the Client’s officers, employees, advisers, designers, clients, and relevant statutory authorities).
- (b) used or relied upon by any other party.

Morrison Geotechnic and the Contributors do not accept any liability or responsibility whatsoever for, or in respect of, any use or reliance upon this Report by any other party. Morrison Geotechnic is not obliged to enter discussions with any third party in respect of this Report.

The information (including technical information and information obtained through discussions) on which this report is based has been provided by the Client and third parties. Morrison Geotechnic and the Contributors:

- (a) have relied upon and presumed the accuracy of this information.
- (b) have not verified the accuracy or reliability of this information (other than as expressly stated in this Report).
- (c) have not made any independent investigations or enquiries in respect of those matters of which it has no actual knowledge at the time of giving this Report to the Client; and
- (d) make no warranty or guarantee, expressed or implied, as to the accuracy or reliability of this information.

Morrison Geotechnic and the Contributors do not accept responsibility or liability for any incorrect assumptions related to this Report. For the avoidance of doubt, this Report:

- (a) is not an environmental, contamination or hazardous materials assessment; may be invalid, incomplete, or inaccurate (including errors in the scope of work, investigation methodology, observations, opinions, and advice) where the information provided to Morrison Geotechnic was invalid, incomplete, or inaccurate.
- (b) is limited to observations of those parts of the site described in Section 1.0.

No warranty or guarantee, whether express or implied, is made in respect of the geotechnical data, information, advice, opinions, and recommendations present in this Report.

If further information becomes available, or additional assumptions need to be made, Morrison Geotechnic reserves its right to amend this Report.

If you have any queries regarding the above, please contact our Gold Coast office.

Yours faithfully



Ian Masman
For and on behalf of
MORRISON GEOTECHNIC PTY LIMITED



Mark Ballard RPEQ 10223
For and on behalf of
MORRISON GEOTECHNIC PTY LIMITED

ATTACHMENTS:

- Appendix A – Site Plans Showing Test Locations
- Appendix B – Laboratory Test Results Reports
- Appendix C – Previous Level 1 Report GL20/129 – Bulk Earthworks Operations, Everleigh Precinct
12.1 Reference 21014 (15th February 2021)



Appendix A

Site Plan & Test Locations



MORRISON GEOTECHNIC PTY LTD



MORRISON
GEOTECHNIC



Appendix B

Laboratory Test Reports



MORRISON GEOTECHNIC PTY LTD



MORRISON
GEOTECHNIC

Material Test Report

Report Number: GL21/028-1
Issue Number: 1
Date Issued: 02/05/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5049
Date Sampled: 23/04/2021 10:00
Dates Tested: 23/04/2021 - 29/04/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5049A	G21-5049B	G21-5049C
Sample Number	G21-5049A	G21-5049B	G21-5049C
Test Number	**	**	**
Date Tested	23/04/2021	23/04/2021	23/04/2021
Time Tested	10:00	10:10	10:20
Test Request #/Location	LOT 2076	LOT 2077	LOT 2078
Chainage (m)	O/S SE CNR	O/S SE CNR	O/S SE CNR
Location Offset (m)	7m WEST, 6m NTH	13m WEST, 7m NTH	9m WEST, 8m NTH
Elevation (m)	RL 60.77	RL 60.69	RL 60.96
Soil Description	Sandy Clay. Orange-Brown	Sandy Clay. Orange-Brown	Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0
Percentage of Wet Oversize (%)	5	0	0
Field Wet Density (FWD) t/m ³	2.16	2.11	2.17
Field Moisture Content %	12.7	12.2	13.1
Field Dry Density (FDD) t/m ³	1.92	1.88	1.92
Peak Converted Wet Density t/m ³	**	2.16	2.19
Adjusted Peak Converted Wet Density t/m ³	2.17	**	**
Moisture Variation (Wv) %	**	0.5	0.0
Adjusted Moisture Variation %	0.0	**	**
Hilf Density Ratio (%)	99.5	98.0	99.5
Compaction Method	Standard	Standard	Standard
Report Remarks	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-2
Issue Number: 1
Date Issued: 23/05/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5128
Dates Tested: 07/05/2021 - 21/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Location: TOP 600mm
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5128A	G21-5128B	G21-5128C	G21-5128D	G21-5128E
Test Number	1	2	3	4	5
Date Tested	07/05/2021	07/05/2021	07/05/2021	07/05/2021	07/05/2021
Time Tested	12:00	12:10	12:20	12:30	12:40
Test Request #/Location	LOT 3034	LOT 3035	LOT 3036	LOT 3037	LOT 3053
Easting	E 498653	E 498652	E 498654	E 498661	E 498692
Northing	N 6932142	N 6932129	N 6932123	N 6932118	N 6932147
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.15	2.20	2.16	2.18	2.16
Field Moisture Content %	12.4	12.5	11.7	13.7	11.1
Field Dry Density (FDD) t/m ³	1.92	1.96	1.94	1.92	1.94
Peak Converted Wet Density t/m ³	2.12	2.20	2.24	2.17	2.19
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	1.5	2.0	-0.5	0.0	1.0
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	101.5	100.0	97.0	100.5	98.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-2
Issue Number: 1
Date Issued: 23/05/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5128
Dates Tested: 07/05/2021 - 21/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Location: TOP 600mm
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5128F	G21-5128G	G21-5128H	G21-5128I	G21-5128J
Test Number	6	7	8	9	10
Date Tested	07/05/2021	07/05/2021	07/05/2021	07/05/2021	07/05/2021
Time Tested	12:50	13:00	13:10	13:20	13:30
Test Request #/Location	LOT 3052	LOT 3051	LOT 3050	LOT 3049	LOT 3048
Easting	E 498685	E 498695	E 498679	E498695	E 498682
Northing	N 6932131	N 6932121	N 6932108	N 6932090	N 6932077
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	14	0	0	0
Field Wet Density (FWD) t/m ³	2.19	2.16	2.20	2.18	2.20
Field Moisture Content %	12.4	13.5	11.5	11.8	10.8
Field Dry Density (FDD) t/m ³	1.95	1.90	1.97	1.95	1.98
Peak Converted Wet Density t/m ³	2.18	**	2.22	2.19	2.18
Adjusted Peak Converted Wet Density t/m ³	**	2.20	**	**	**
Moisture Variation (Wv) %	0.0	**	2.0	1.5	0.0
Adjusted Moisture Variation %	**	0.0	**	**	**
Hilf Density Ratio (%)	100.5	98.0	99.5	99.5	101.0
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-3
Issue Number: 1
Date Issued: 23/05/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5176
Date Sampled: 14/05/2021
Dates Tested: 14/05/2021 - 17/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5176A	G21-5176B	G21-5176C	G21-5176D	G21-5176E	G21-5176F
Test Number	11	12	13	14	15	16
Date Tested	14/05/2021	14/05/2021	14/05/2021	14/05/2021	14/05/2021	14/05/2021
Time Tested	09:20	09:30	09:40	09:50	10:00	11:30
Test Request #/Location	LOT 3033	LOT 3031	LOT 3019	LOT 3028	LOT 3027	LOT 3025
Easting	498684	498663	498614	498603	498610	498599
Northing	6932163	6932169	6932135	6932105	6932089	6932064
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12	14	7	9	7	8
Field Wet Density (FWD) t/m ³	2.19	2.21	2.16	2.22	2.17	2.19
Field Moisture Content %	10.3	10.6	10.2	10.4	10.9	10.8
Field Dry Density (FDD) t/m ³	1.99	2.00	1.96	2.01	1.96	1.98
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.20	2.22	2.17	2.22	2.21	2.18
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.5	0.0	-0.5	0.5
Hilf Density Ratio (%)	99.5	99.5	99.5	100.5	98.0	100.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-3
Issue Number: 1
Date Issued: 23/05/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5176
Date Sampled: 14/05/2021
Dates Tested: 14/05/2021 - 17/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5176G	G21-5176H	G21-5176I	G21-5176J	G21-5176K	G21-5176L
Test Number	17	18	19	20	21	22
Date Tested	14/05/2021	14/05/2021	14/05/2021	14/05/2021	14/05/2021	14/05/2021
Time Tested	11:40	11:50	12:00	14:40	14:50	15:00
Test Request #/Location	LOT 3017	LOT 3020	LOT 3022	LOT 3024	LOT 3014	LOT 3012
Easting	498583	498573	498570	498573	498615	498581
Northing	6932145	6932118	6932090	6932067	6932188	6932189
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	8	9	9	10	10	8
Field Wet Density (FWD) t/m ³	2.16	2.20	2.29	2.20	2.18	2.19
Field Moisture Content %	11.7	10.2	10.7	10.9	10.5	10.9
Field Dry Density (FDD) t/m ³	1.94	2.00	2.07	1.98	1.98	1.98
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.18	2.18	2.38	2.19	2.21	2.19
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	1.0	2.0	1.0	0.0	0.0
Hilf Density Ratio (%)	99.5	101.0	96.0	100.5	99.0	100.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-4
Issue Number: 1
Date Issued: 02/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5195
Date Sampled: 18/05/2021
Dates Tested: 18/05/2021 - 28/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5195A	G21-5195B	G21-5195C	G21-5195D
Test Number	23	24	25	26
Date Tested	18/05/2021	18/05/2021	18/05/2021	18/05/2021
Time Tested	08:00	09:30	11:00	12:20
Test Request #/Location	LOT 3156	LOT - BOUNDY OF 3154 & 3155	LOT 3154	LOT 3156
Easting	498977	498956	498976	498953
Northing	6931874	6931804	6931805	6931783
Elevation (m)	2.5m BELOW FL	1.5m BELOW FL	1m BELOW FL	2m BELOW FL
Soil Description	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	11	11	9	9
Field Wet Density (FWD) t/m ³	2.17	2.25	2.27	2.26
Field Moisture Content %	12.9	14.0	12.8	11.5
Field Dry Density (FDD) t/m ³	1.92	1.97	2.01	2.02
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.22	2.28	2.29	2.29
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	-0.5
Hilf Density Ratio (%)	97.5	98.5	99.0	98.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-5
Issue Number: 1
Date Issued: 03/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5222
Date Sampled: 20/05/2021
Dates Tested: 20/05/2021 - 31/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-5222A	G21-5222B	G21-5222C	G21-5222D
Test Number	35	36	37	38
Date Tested	20/05/2021	20/05/2021	20/05/2021	20/05/2021
Time Tested	09:30	09:40	10:00	10:30
Test Request #/Location	LOT 2065	LOT 2063	LOT 2061	LOT 2061
Easting	498723	498692	498663	498641
Northing	6931985	6931988	6931988	6931988
Elevation (m)	2.4m BELOW FL	3.0m BELOW FL	3.0m BELOW FL	2.4m BELOW FL
Soil Description	Clayey Sandy. Orange-Brown	Clayey Sandy. Orange-Brown	Clayey Sandy. Orange-Brown	Clayey Sandy. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	9	14
Field Wet Density (FWD) t/m ³	2.19	2.18	2.23	2.29
Field Moisture Content %	14.3	12.5	11.5	11.8
Field Dry Density (FDD) t/m ³	1.92	1.94	2.00	2.05
Peak Converted Wet Density t/m ³	2.17	2.17	**	**
Adjusted Peak Converted Wet Density t/m ³	**	**	2.14	2.13
Moisture Variation (Wv) %	0.5	0.5	**	**
Adjusted Moisture Variation %	**	**	2.0	0.5
Hilf Density Ratio (%)	101.0	100.5	104.0	107.0
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-5
Issue Number: 1
Date Issued: 03/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5222
Date Sampled: 20/05/2021
Dates Tested: 20/05/2021 - 31/05/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5222E	G21-5222F	G21-5222G	G21-5222H
Sample Number				
Test Number	39	40	41	42
Date Tested	20/05/2021	20/05/2021	20/05/2021	20/05/2021
Time Tested	10:50	11:00	11:50	12:00
Test Request #/Location	LOT 2074	LOT 2076	LOT 2063	BAMBOO ROAD
Easting	498709	498692	498682	498707
Northing	6931959	6931962	6931987	6931982
Elevation (m)	2m BELOW FL	3m BELOW FL	2.5m BELOW FL	1.5m BELOW SG
Soil Description	Clayey Sandy. Orange-Brown	Clayey Sandy. Orange-Brown	Clayey Sandy. Orange-Brown	Clayey Sandy. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	17	12	13	16
Field Wet Density (FWD) t/m ³	2.22	2.25	2.22	2.21
Field Moisture Content %	12.3	12.5	13.3	13.3
Field Dry Density (FDD) t/m ³	1.98	2.00	1.96	1.95
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.16	2.18	2.14	2.15
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.5
Hilf Density Ratio (%)	103.0	103.5	104.0	102.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-6
Issue Number: 1
Date Issued: 08/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5275
Date Sampled: 26/05/2021
Dates Tested: 26/05/2021 - 07/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5275A	G21-5275B	G21-5275C	G21-5275D	G21-5275E
Sample Number					
Test Number	43	44	45	46	47
Date Tested	26/05/2021	26/05/2021	26/05/2021	26/05/2021	26/05/2021
Time Tested	07:30	07:40	07:50	08:00	08:10
Test Request #/Location	BAMBOO ROAD	LOT 2074	LOT 2076	LOT 2077	LOT 2046
Easting	498698	498711	498685	498669	498615
Northing	6931987	6931967	6931965	6931969	6931970
Elevation (m)	1.1m BELOW FL	1.4m BELOW FL	2.5m BELOW FL	3.5m BELOW FL	4.2m BELOW FL
Layer / Reduced Level	**	**	**	**	**
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	12	9	12	13	9
Field Wet Density (FWD) t/m ³	2.20	2.24	2.23	2.21	2.26
Field Moisture Content %	12.5	12.1	12.8	13.3	12.3
Field Dry Density (FDD) t/m ³	1.96	2.00	1.98	1.95	2.01
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.27	2.30	2.30	2.29	2.33
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0	-0.5
Hilf Density Ratio (%)	97.0	97.5	97.0	96.5	97.0
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-6
Issue Number: 1
Date Issued: 08/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5275
Date Sampled: 26/05/2021
Dates Tested: 26/05/2021 - 07/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5275F	G21-5275G	G21-5275H	G21-5275I	G21-5275J
Test Number	48	49	50	51	52
Date Tested	26/05/2021	26/05/2021	26/05/2021	26/05/2021	26/05/2021
Time Tested	08:20	08:30	08:40	11:30	11:40
Test Request #/Location	LOT 2047	LOT 2049	LOT 2045	LOT 2047	LOT 2046
Easting	498614	498585	498592	498604	498604
Northing	6931998	6931992	6931973	6931990	6931970
Elevation (m)	4.0m BELOW FL	3.9m BELOW FL	4.5m BELOW FL	3.6m BELOW FL	3.7m BELOW FL
Layer / Reduced Level	**	**	**	**	**
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	11	13	9	12	10
Field Wet Density (FWD) t/m ³	2.26	2.23	2.24	2.24	2.23
Field Moisture Content %	12.1	12.4	12.0	12.1	11.9
Field Dry Density (FDD) t/m ³	2.02	1.99	2.00	2.00	2.00
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.35	2.32	2.34	2.34	2.33
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	96.5	96.0	95.5	96.0	95.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-7
Issue Number: 1
Date Issued: 10/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5200
Dates Tested: 19/05/2021 - 08/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5200A	G21-5200B	G21-5200C	G21-5200D
Sample Number				
Test Number	27	28	29	30
Date Tested	19/05/2021	19/05/2021	19/05/2021	19/05/2021
Time Tested	06:50	07:00	07:10	07:20
Test Request #/Location	LOT 2073	LOT 2075	BOTANICA ROAD	BOTANICA ROAD
Easting	498726	498701	498679	498638
Northing	6931962	6931966	6931972	6931975
Elevation (m)	4.7m BELOW FL	5.0m BELOW FL	3.9m BELOW SG	3.1m BELOW SG
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	10	11	9	12
Field Wet Density (FWD) t/m ³	2.19	2.18	2.20	2.18
Field Moisture Content %	11.9	12.1	11.7	12.2
Field Dry Density (FDD) t/m ³	1.96	1.95	1.97	1.94
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.27	2.26	2.28	2.25
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	-0.5	0.0
Hilf Density Ratio (%)	96.5	96.5	96.5	96.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-7
Issue Number: 1
Date Issued: 10/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5200
Dates Tested: 19/05/2021 - 08/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5200E	G21-5200F	G21-5200G	G21-5200H
Sample Number				
Test Number	31	32	33	34
Date Tested	19/05/2021	19/05/2021	19/05/2021	19/05/2021
Time Tested	11:30	11:40	11:50	12:00
Test Request #/Location	LOT 2074	LOT 2076	BOTANICA ROAD	LOT 2078
Easting	498716	498689	498661	498638
Northing	6931963	6931967	6931979	6931970
Elevation (m)	4.5m BELOW FL	4.9m BELOW FL	3.3m BELOW SG	2.5m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	12	7	8	12
Field Wet Density (FWD) t/m ³	2.21	2.16	2.17	2.19
Field Moisture Content %	11.7	11.9	12.0	12.2
Field Dry Density (FDD) t/m ³	1.98	1.93	1.94	1.96
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.27	2.23	2.26	2.28
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	-0.5	0.0	-0.5
Hilf Density Ratio (%)	97.0	97.0	96.0	96.0
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-8
Issue Number: 1
Date Issued: 14/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5288
Date Sampled: 27/05/2021
Dates Tested: 27/05/2021 - 11/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5288A	G21-5288B	G21-5288C	G21-5288D	G21-5288E	G21-5288F
Test Number	53	54	55	56	57	58
Date Tested	27/05/2021	27/05/2021	27/05/2021	27/05/2021	27/05/2021	27/05/2021
Time Tested	08:20	08:30	08:40	08:50	09:00	09:10
Test Request #/Location	LOT 3008	LOT 3006	LOT 3004	LOT 3002	LOT 2055	LOT 3062
Easting	498526	498535	498520	498540	498530	498731
Northing	6932161	6932132	6932108	6932081	6932050	6932073
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	13	3	0	5	0	0
Field Wet Density (FWD) t/m ³	2.19	2.20	2.23	2.20	2.19	2.21
Field Moisture Content %	11.3	11.7	11.2	10.7	11.6	12.3
Field Dry Density (FDD) t/m ³	1.97	1.97	2.00	1.99	1.96	1.97
Peak Converted Wet Density t/m ³	**	**	2.21	**	2.19	2.13
Adjusted Peak Converted Wet Density t/m ³	2.13	2.12	**	2.13	**	**
Moisture Variation (Wv) %	**	**	0.5	**	0.5	1.0
Adjusted Moisture Variation %	0.5	1.0	**	0.5	**	**
Hilf Density Ratio (%)	102.5	104.0	101.0	103.5	100.5	103.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-8
Issue Number: 1
Date Issued: 14/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5288
Date Sampled: 27/05/2021
Dates Tested: 27/05/2021 - 11/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5288G	G21-5288H	G21-5288I	G21-5288J	G21-5288K	G21-5288L
Test Number	59	60	61	62	63	64
Date Tested	27/05/2021	27/05/2021	27/05/2021	27/05/2021	27/05/2021	27/05/2021
Time Tested	11:00	11:10	11:20	11:30	12:00	12:10
Test Request #/Location	LOT 3060	LOT 2065	LOT 2078	LOT 2049	LOT 2063	LOT 3072
Easting	498736	498724	498645	498583	498677	498758
Northing	6932094	6931993	6931959	6931988	6931995	6932086
Elevation (m)	FINISHED LEVEL	2.1m BELOW FL	2.2m BELOW FL	3.5m BELOW FL	2.1m BELOW FL	FINISHED LEVEL
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	7	0	0	0	0
Field Wet Density (FWD) t/m ³	2.24	2.23	2.19	2.20	2.20	2.19
Field Moisture Content %	11.3	12.0	12.1	11.1	11.7	11.9
Field Dry Density (FDD) t/m ³	2.02	1.99	1.95	1.98	1.97	1.96
Peak Converted Wet Density t/m ³	2.20	**	2.18	2.21	2.18	2.20
Adjusted Peak Converted Wet Density t/m ³	**	2.19	**	**	**	**
Moisture Variation (Wv) %	0.5	**	0.5	0.5	0.5	0.5
Adjusted Moisture Variation %	**	0.0	**	**	**	**
Hilf Density Ratio (%)	102.0	102.0	100.5	100.0	101.0	99.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-9
Issue Number: 1
Date Issued: 18/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12.1 SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5302
Date Sampled: 28/05/2021
Dates Tested: 28/05/2021 - 09/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5302A	G21-5302B	G21-5302C	G21-5302D
Test Number	65	66	67	68
Date Tested	28/05/2021	28/05/2021	28/05/2021	28/05/2021
Time Tested	10:20	10:30	10:40	10:50
Test Request #/Location	LOT 2073	LOT 2075	LOT 2077	LOT 2078
Easting	498719	498696	498675	498641
Northing	6931959	6931960	6931962	6931967
Elevation (m)	3.5m BELOW FL	2.2m BELOW FL	3m BELOW FL	1.7m BELOW FL
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	7	0
Field Wet Density (FWD) t/m ³	2.20	2.20	2.15	2.20
Field Moisture Content %	12.3	11.8	11.7	12.2
Field Dry Density (FDD) t/m ³	1.96	1.97	1.92	1.96
Peak Converted Wet Density t/m ³	2.09	2.07	**	2.10
Adjusted Peak Converted Wet Density t/m ³	**	**	2.05	**
Moisture Variation (Wv) %	1.5	2.0	**	2.5
Adjusted Moisture Variation %	**	**	2.0	**
Hilf Density Ratio (%)	105.5	106.0	105.0	104.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-10
Issue Number: 1
Date Issued: 18/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5328
Date Sampled: 01/06/2021
Dates Tested: 01/06/2021 - 08/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5328A	G21-5328B	G21-5328C	G21-5328D	G21-5328E	G21-5328F
Test Number	69	70	71	72	73	74
Date Tested	01/06/2021	01/06/2021	01/06/2021	01/06/2021	01/06/2021	01/06/2021
Time Tested	07:30	07:40	07:50	08:00	08:10	08:20
Test Request #/Location	LOT 2073	LOT 2075	LOT 2078	LOT 2046	LOT 2044	LOT 2050
Easting	498726	498702	498659	498607	498582	498569
Northing	6931968	6931958	6931959	6931958	6931964	6931993
Elevation (m)	1.8m BELOW FINISHED LEVEL	1.5m BELOW FINISHED LEVEL	1.0m BELOW FINISHED LEVEL	3.1m BELOW FINISHED LEVEL	2.7m BELOW FINISHED LEVEL	3.0m BELOW FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	19.0	37.5	37.5	37.5
Percentage of Wet Oversize (%)	8	11	14	9	10	11
Field Wet Density (FWD) t/m ³	2.20	2.22	2.18	2.20	2.23	2.22
Field Moisture Content %	15.2	14.8	14.4	14.3	14.4	14.2
Field Dry Density (FDD) t/m ³	1.91	1.93	1.90	1.93	1.95	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.28	2.29	2.24	2.31	2.33	2.30
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	-0.5	0.0	0.0
Hilf Density Ratio (%)	96.5	97.0	97.0	95.5	96.0	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-10
Issue Number: 1
Date Issued: 18/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5328
Date Sampled: 01/06/2021
Dates Tested: 01/06/2021 - 08/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5328G	G21-5328H	G21-5328I	G21-5328J	G21-5328K	G21-5328L
Test Number	75	76	77	78	79	80
Date Tested	01/06/2021	01/06/2021	01/06/2021	01/06/2021	01/06/2021	01/06/2021
Time Tested	08:30	08:40	08:50	09:00	09:10	09:20
Test Request #/Location	LOT 2048	LOT 2047	LOT 2061	LOT 2063	BAMBOO ROAD	LOT 2064
Easting	498596	498617	498651	498688	498705	498727
Northing	6931993	6931984	6931989	6931995	6931990	6931998
Elevation (m)	3.2m BELOW FINISHED LEVEL	3.4m BELOW FINISHED LEVEL	2.1m BELOW FINISHED LEVEL	1.7m BELOW FINISHED LEVEL	1.1m BELOW SUBGRADE	1.4m BELOW FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	19.0	19.0	19.0	37.5	19.0
Percentage of Wet Oversize (%)	8	15	11	17	13	12
Field Wet Density (FWD) t/m ³	2.22	2.21	2.20	2.20	2.23	2.24
Field Moisture Content %	13.6	14.4	14.7	14.7	14.5	13.9
Field Dry Density (FDD) t/m ³	1.96	1.93	1.92	1.92	1.95	1.97
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.28	2.26	2.27	2.28	2.31	2.34
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.0	0.0	-0.5	-0.5
Hilf Density Ratio (%)	97.5	97.5	97.0	96.5	96.5	96.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-11
Issue Number: 1
Date Issued: 18/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5342
Date Sampled: 02/06/2021
Dates Tested: 02/06/2021 - 09/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5342A	G21-5342B	G21-5342C	G21-5342D	G21-5342E
Test Number	81	82	83	84	85
Date Tested	02/06/2021	02/06/2021	02/06/2021	02/06/2021	02/06/2021
Time Tested	10:20	10:30	10:40	11:00	11:20
Test Request #/Location	LOT 2046	LOT 2045	LOT 2043	LOT 2042	LOT 2051
Easting	498617	498595	498570	498558	498559
Northing	6931963	6931959	6931962	6931967	6931992
Elevation (m)	1.1m BELOW FINISHED LEVEL	1.7m BELOW FINISHED LEVEL	1.9m BELOW FINISHED LEVEL	1.6m BELOW FINISHED LEVEL	1.8m BELOW FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	14	11	13	10	9
Field Wet Density (FWD) t/m ³	2.18	2.19	2.16	2.18	2.15
Field Moisture Content %	12.4	12.3	13.7	12.7	12.8
Field Dry Density (FDD) t/m ³	1.94	1.95	1.90	1.93	1.91
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.22	2.25	2.24	2.27	2.25
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.0	0.0
Hilf Density Ratio (%)	98.5	97.0	96.5	96.0	95.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-11
Issue Number: 1
Date Issued: 18/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5342
Date Sampled: 02/06/2021
Dates Tested: 02/06/2021 - 09/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5342F	G21-5342G	G21-5342H	G21-5342I	G21-5342J
Test Number	86	87	88	89	90
Date Tested	02/06/2021	02/06/2021	02/06/2021	02/06/2021	02/06/2021
Time Tested	11:30	12:25	12:35	12:45	12:55
Test Request #/Location	LOT 2049	LOT 2047	LOT 2060	LOT 2062	LOT 2078
Easting	498586	498610	498654	498685	498652
Northing	6932005	6931993	6932011	6932014	6931966
Elevation (m)	2.1m BELOW FINISHED LEVEL	2.0m BELOW FINISHED LEVEL	1.5m BELOW FINISHED LEVEL	1.3m BELOW FINISHED LEVEL	0.6m BELOW FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13	11	10	11	11
Field Wet Density (FWD) t/m ³	2.17	2.17	2.18	2.19	2.21
Field Moisture Content %	13.2	13.5	14.4	13.8	12.4
Field Dry Density (FDD) t/m ³	1.91	1.91	1.91	1.93	1.96
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.26	2.26	2.25	2.27	2.29
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	95.5	96.0	97.0	96.5	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-12
Issue Number: 1
Date Issued: 19/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5353
Date Sampled: 03/06/2021
Dates Tested: 03/06/2021 - 09/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5353A	G21-5353B	G21-5353C	G21-5353D
Test Number	91	92	93	94
Date Tested	03/06/2021	03/06/2021	03/06/2021	03/06/2021
Time Tested	14:00	14:10	14:20	14:30
Test Request #/Location	LOT 2074	LOT 2065	LOT 2076	LOT 2063
Easting	498715	498733	498684	498671
Northing	6931954	6931988	6931955	6931990
Elevation (m)	0.8m BELOW FL	1.1m BELOW FL	1.5m BELOW FL	1.2m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	11	12	13	14
Field Wet Density (FWD) t/m ³	2.22	2.20	2.20	2.24
Field Moisture Content %	16.2	15.3	15.4	16.0
Field Dry Density (FDD) t/m ³	1.91	1.91	1.90	1.93
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.30	2.29	2.28	2.30
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	96.5	96.0	96.5	97.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-13
Issue Number: 1
Date Issued: 19/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5374
Date Sampled: 07/06/2021
Dates Tested: 07/06/2021 - 10/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5374A	G21-5374B	G21-5374C	G21-5374D
Test Number	95	96	97	98
Date Tested	07/06/2021	07/06/2021	07/06/2021	07/06/2021
Time Tested	07:50	07:55	08:00	08:05
Test Request #/Location	LOT 2061	LOT 2063	LOT 2048	LOT 2050
Easting	498654	498683	498600	498573
Northing	6931992	6931999	6931998	6931999
Elevation (m)	0.8m BELOW FL	0.7m BELOW FL	1.4m BELOW FL	2.4m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	37.5	37.5	37.5
Percentage of Wet Oversize (%)	12	12	14	14
Field Wet Density (FWD) t/m ³	2.24	2.22	2.19	2.17
Field Moisture Content %	13.8	13.5	13.6	14.0
Field Dry Density (FDD) t/m ³	1.97	1.95	1.93	1.90
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.31	2.30	2.29	2.27
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	97.0	96.5	95.5	95.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-14
Issue Number: 1
Date Issued: 19/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5387
Date Sampled: 08/06/2021
Dates Tested: 08/06/2021 - 10/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5387A	G21-5387B	G21-5387C	G21-5387D
Sample Number	99	100	101	102
Test Number	08/06/2021	08/06/2021	08/06/2021	08/06/2021
Date Tested	07:30	07:40	07:50	08:00
Time Tested	LOT 3041	LOT 3043	LOT 2056	LOT 2043
Test Request #/Location	498659	498659	498616	498571
Easting	6932024	6932046	6932028	6931972
Northing	1m BELOW FL	0.8m BELOW FL	1m BELOW FL	0.8m BELOW FL
Elevation (m)	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Soil Description	150	150	150	150
Test Depth (mm)	37.5	37.5	37.5	37.5
Sieve used to determine oversize (mm)	13	10	13	13
Percentage of Wet Oversize (%)	2.20	2.19	2.19	2.20
Field Wet Density (FWD) t/m ³	11.9	11.8	12.8	12.4
Field Moisture Content %	1.96	1.96	1.94	1.96
Field Dry Density (FDD) t/m ³	**	**	**	**
Peak Converted Wet Density t/m ³	2.30	2.27	2.29	2.30
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**
Moisture Variation (Wv) %	-0.5	0.5	0.0	0.0
Adjusted Moisture Variation %	95.5	96.5	96.0	95.5
Hilf Density Ratio (%)	Standard	Standard	Standard	Standard
Compaction Method	**	**	**	**
Report Remarks				

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-15
Issue Number: 1
Date Issued: 19/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5406
Date Sampled: 10/06/2021
Dates Tested: 10/06/2021 - 14/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5406A	G21-5406B	G21-5406C	G21-5406D	G21-5406E	G21-5406F
Test Number	103	104	105	106	107	108
Date Tested	10/06/2021	10/06/2021	10/06/2021	10/06/2021	10/06/2021	10/06/2021
Time Tested	08:30	08:40	08:50	10:00	10:10	10:30
Test Request #/Location	MOSS STREET	LOT 3043	LOT 3040	LOT 3066	LOT 2064	LOT 2072
Easting	498630	498645	498650	498719	498734	498735
Northing	6931958	6932023	6932059	6932014	6931999	6931966
Elevation (m)	1.0m BELOW FL	0.6m BELOW FL	0.6m BELOW FL	0.6m BELOW FL	0.6m BELOW FL	0.6m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	19.0	37.5	37.5	19.0	37.5
Percentage of Wet Oversize (%)	12	12	12	9	10	14
Field Wet Density (FWD) t/m ³	2.20	2.22	2.22	2.22	2.20	2.24
Field Moisture Content %	9.9	11.4	10.1	10.4	10.0	10.4
Field Dry Density (FDD) t/m ³	2.00	1.99	2.01	2.01	2.00	2.03
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.28	2.30	2.28	2.30	2.30	2.31
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.5	0.0	0.0	0.0
Hilf Density Ratio (%)	96.5	96.5	97.0	96.0	95.5	97.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-16
Issue Number: 1
Date Issued: 26/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5423
Date Sampled: 14/06/2021
Dates Tested: 14/06/2021 - 18/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5423A	G21-5423B	G21-5423C	G21-5423D
Sample Number				
Test Number	109	110	111	112
Date Tested	14/06/2021	14/06/2021	14/06/2021	14/06/2021
Time Tested	08:30	08:40	08:50	10:00
Test Request #/Location	LOT 2070	LOT 2071	LOT 2062	LOT 2061
Easting	498752	498753	498686	498646
Northing	6931951	6931962	6932007	6931996
Elevation (m)	1.4m BELOW FL	1.1m BELOW FL	1.0m BELOW FL	0.6m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	19.0	19.0	37.5
Percentage of Wet Oversize (%)	13	16	12	13
Field Wet Density (FWD) t/m ³	2.22	2.21	2.20	2.23
Field Moisture Content %	10.8	10.7	10.1	10.2
Field Dry Density (FDD) t/m ³	2.00	2.00	2.00	2.02
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.26	2.26	2.31
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.5	0.0
Hilf Density Ratio (%)	97.0	98.0	97.5	96.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-16
Issue Number: 1
Date Issued: 26/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5423
Date Sampled: 14/06/2021
Dates Tested: 14/06/2021 - 18/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

	G21-5423E	G21-5423F	G21-5423G	G21-5423H
Sample Number	113	114	115	116
Test Number	14/06/2021	14/06/2021	14/06/2021	14/06/2021
Date Tested	10:10	10:20	12:00	12:30
Time Tested	LOT 2060	LOT 3042	LOT 2065	LOT 2047
Test Request #/Location	498663	498652	498739	498618
Easting	6932011	6932037	6931983	6932001
Northing	0.7m BELOW FL	0.6m BELOW FL	0.6m BELOW FL	0.8m BELOW FL
Elevation (m)	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Soil Description	150	150	150	150
Test Depth (mm)	37.5	37.5	37.5	37.5
Sieve used to determine oversize (mm)	16	15	14	13
Percentage of Wet Oversize (%)	2.26	2.24	2.22	2.23
Field Wet Density (FWD) t/m ³	10.5	10.3	10.4	10.2
Field Moisture Content %	2.04	2.03	2.01	2.03
Field Dry Density (FDD) t/m ³	**	**	**	**
Peak Converted Wet Density t/m ³	2.32	2.30	2.29	2.31
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**
Moisture Variation (Wv) %	0.0	0.5	0.0	0.0
Adjusted Moisture Variation %	97.0	97.0	97.0	96.5
Hilf Density Ratio (%)	Standard	Standard	Standard	Standard
Compaction Method	**	**	**	**
Report Remarks				

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-17
Issue Number: 1
Date Issued: 26/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5446
Date Sampled: 17/06/2021
Dates Tested: 17/06/2021 - 21/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5446A	G21-5446B	G21-5446C	G21-5446D	G21-5446E
Test Number	117	118	119	120	121
Date Tested	17/06/2021	17/06/2021	17/06/2021	17/06/2021	17/06/2021
Time Tested	09:10	09:20	09:30	09:40	09:50
Test Request #/Location	LOT 3046	LOT 3044	LOT 2054	LOT 2014	LOT 2058
Easting	498681	498688	498526	498523	498599
Northing	6932048	6932021	6932023	6931986	6932039
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	37.5	37.5	37.5	19.0
Percentage of Wet Oversize (%)	14	14	12	10	18
Field Wet Density (FWD) t/m ³	2.21	2.24	2.26	2.24	2.18
Field Moisture Content %	12.6	12.2	12.0	12.6	12.1
Field Dry Density (FDD) t/m ³	1.96	1.99	2.02	1.99	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.30	2.31	2.33	2.29	2.26
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.0	0.5	0.5
Hilf Density Ratio (%)	96.0	97.0	97.0	98.0	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-17
Issue Number: 1
Date Issued: 26/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5446
Date Sampled: 17/06/2021
Dates Tested: 17/06/2021 - 21/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5446F	G21-5446G	G21-5446H	G21-5446I	G21-5446J
Test Number	122	123	124	125	126
Date Tested	17/06/2021	17/06/2021	17/06/2021	17/06/2021	17/06/2021
Time Tested	10:00	10:10	10:20	10:30	10:40
Test Request #/Location	LOT 2056	LOT 3063	LOT 3075	LOT 3058	LOT 3054
Easting	498570	498727	498761	498729	498722
Northing	6932036	6932043	6932112	6932128	6932147
Elevation (m)	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	19.0
Percentage of Wet Oversize (%)	12	11	12	10	16
Field Wet Density (FWD) t/m ³	2.24	2.22	2.21	2.22	2.19
Field Moisture Content %	12.7	12.1	13.1	12.7	12.7
Field Dry Density (FDD) t/m ³	1.99	1.98	1.96	1.97	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.33	2.29	2.29	2.28	2.27
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.5	0.0	0.5
Hilf Density Ratio (%)	96.5	97.0	96.5	97.5	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-18
Issue Number: 1
Date Issued: 26/06/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5457
Date Sampled: 18/06/2021
Dates Tested: 18/06/2021 - 22/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite 200mm minus



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5457A	G21-5457B	G21-5457C	G21-5457D
Test Number	127	128	129	130
Date Tested	18/06/2021	18/06/2021	18/06/2021	18/06/2021
Time Tested	10:00	10:20	12:00	14:00
Test Request #/Location	LOT 3056	LOT 3070	LOT 3068	LOT 2164
Easting	498751	498758	498750	498805
Northing	6932148	6932056	6932030	6931940
Layer / Reduced Level	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	0.8m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	14	13	9	14
Field Wet Density (FWD) t/m ³	2.20	2.23	2.17	2.21
Field Moisture Content %	10.7	11.5	10.6	10.9
Field Dry Density (FDD) t/m ³	1.99	2.00	1.96	1.99
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.28	2.24	2.27
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.5	0.5
Hilf Density Ratio (%)	96.0	97.5	97.0	97.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-19
Issue Number: 1
Date Issued: 02/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5469
Date Sampled: 21/06/2021
Dates Tested: 21/06/2021 - 29/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5469A	G21-5469B	
Test Number	131	132	
Date Tested	21/06/2021	21/06/2021	
Time Tested	11:00	11:10	
Test Request #/Location	LOT 3122	LOT 3122	
Easting	498826	498827	
Northing	6931947	6931954	
Elevation (m)	2m BELOW FINISHED LEVEL	1.5m BELOW FINISHED LEVEL	
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	
Test Depth (mm)	150	150	
Sieve used to determine oversize (mm)	19.0	19.0	
Percentage of Wet Oversize (%)	14	12	
Field Wet Density (FWD) t/m ³	2.21	2.20	
Field Moisture Content %	10.0	9.7	
Field Dry Density (FDD) t/m ³	2.01	2.01	
Peak Converted Wet Density t/m ³	**	**	
Adjusted Peak Converted Wet Density t/m ³	2.27	2.19	
Moisture Variation (Wv) %	**	**	
Adjusted Moisture Variation %	0.5	0.0	
Hilf Density Ratio (%)	97.0	100.5	
Compaction Method	Standard	Standard	
Report Remarks	**	**	

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-20
Issue Number: 1
Date Issued: 09/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5482
Date Sampled: 22/06/2021
Dates Tested: 22/06/2021 - 29/06/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-5482A	G21-5482B	G21-5482C	G21-5482D
Test Number	133	134	135	136
Date Tested	22/06/2021	22/06/2021	22/06/2021	22/06/2021
Time Tested	10:00	10:10	10:20	10:30
Test Request #/Location	LOT 3122	LOT 3120	LOT 2071	LOT 2066
Chainage (m)	498835	498855	498762	498763
Location Offset (m)	6931966	6931970	6931964	6932000
Elevation (m)	0.6m BELOW FL	0.7m BELOW FL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	19.0
Percentage of Wet Oversize (%)	14	13	15	16
Field Wet Density (FWD) t/m ³	2.26	2.21	2.22	2.24
Field Moisture Content %	11.7	12.2	12.0	12.3
Field Dry Density (FDD) t/m ³	2.02	1.97	1.98	1.99
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.33	2.28	2.32	2.30
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	97.0	97.0	95.5	97.0
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-21
Issue Number: 1
Date Issued: 09/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5497
Date Sampled: 24/06/2021
Dates Tested: 24/06/2021 - 02/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-5497A	G21-5497B	G21-5497C	G21-5497D	G21-5497E	G21-5497F
Test Number	137	138	139	140	141	142
Date Tested	24/06/2021	24/06/2021	24/06/2021	24/06/2021	24/06/2021	24/06/2021
Time Tested	09:50	10:00	10:10	10:20	10:30	11:40
Test Request #/Location	LOT 2145	LOT 2148	LOT 3124	LOT 2166	LOT 3122	LOT 2069
Easting	498884	498878	498839	498799	498824	498801
Northing	6931849	6931887	6931939	6931964	6931965	6931997
Elevation (m)	0.8m BELOW FINISHED LEVEL	0.6m BELOW FINISHED LEVEL	0.6m BELOW FINISHED LEVEL	0.6m BELOW FINISHED LEVEL	0.8m BELOW FINISHED LEVEL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	37.5	37.5	37.5	19.0	19.0
Percentage of Wet Oversize (%)	13	12	13	12	13	12
Field Wet Density (FWD) t/m ³	2.21	2.23	2.21	2.24	2.24	2.20
Field Moisture Content %	13.1	13.4	13.7	13.4	13.3	13.0
Field Dry Density (FDD) t/m ³	1.95	1.97	1.95	1.97	1.98	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.31	2.31	2.32	2.29	2.29
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.0	0.0	0.0	0.5	0.0
Hilf Density Ratio (%)	96.0	96.5	95.5	96.0	98.0	96.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-22
Issue Number: 1
Date Issued: 09/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5524
Date Sampled: 30/06/2021
Dates Tested: 30/06/2021 - 08/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-5524A	G21-5524B	G21-5524C	G21-5524D
Test Number	143	144	145	146
Date Tested	30/06/2021	30/06/2021	30/06/2021	30/06/2021
Time Tested	10:50	10:55	11:00	11:10
Test Request #/Location	LOT 3083	LOT 3081	LOT 3077	LOT 3079
Easting	498794	498794	498810	498843
Northing	6932086	6932108	6932148	6932136
Elevation (m)	0.6m BELOW FL	0.6m BELOW FL	0.6m BELOW FL	0.8m BELOW FL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13	13	11	11
Field Wet Density (FWD) t/m ³	2.22	2.20	2.18	2.21
Field Moisture Content %	10.2	9.8	9.7	10.0
Field Dry Density (FDD) t/m ³	2.01	2.00	1.99	2.01
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.31	2.29	2.28	2.28
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	-0.5	0.0
Hilf Density Ratio (%)	96.0	96.0	95.5	96.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-22
Issue Number: 1
Date Issued: 09/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5524
Date Sampled: 30/06/2021
Dates Tested: 30/06/2021 - 08/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1			
Sample Number	G21-5524E	G21-5524F	G21-5524G
Test Number	147	148	149
Date Tested	30/06/2021	30/06/2021	30/06/2021
Time Tested	11:20	11:40	12:00
Test Request #/Location	LOT 2041	LOT 3128	LOT 2165
Easting	498547	498881	498805
Northing	6931971	6931908	6931950
Elevation (m)	0.7m BELOW FL	1m BELOW FL	FINISHED LEVEL
Soil Description	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown	Clayey Sand. Orange-Brown
Test Depth (mm)	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5
Percentage of Wet Oversize (%)	11	12	11
Field Wet Density (FWD) t/m ³	2.22	2.20	2.23
Field Moisture Content %	10.0	9.7	9.0
Field Dry Density (FDD) t/m ³	2.02	2.00	2.05
Peak Converted Wet Density t/m ³	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.27	2.29
Moisture Variation (Wv) %	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0
Hilf Density Ratio (%)	97.0	96.5	97.5
Compaction Method	Standard	Standard	Standard
Report Remarks	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-23
Issue Number: 1
Date Issued: 14/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5565
Date Sampled: 07/07/2021
Dates Tested: 07/07/2021 - 12/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-5565A	G21-5565B	G21-5565C	G21-5565D
Test Number	150	151	152	153
Date Tested	07/07/2021	07/07/2021	07/07/2021	07/07/2021
Time Tested	10:00	10:10	10:30	10:40
Test Request #/Location	LOT 2052	LOT 2050	LOT 2048	LOT 2046
Easting	498543	498573	498599	498612
Northing	6931993	6931986	6932002	6931964
Layer / Reduced Level	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	11	12	12	13
Field Wet Density (FWD) t/m ³	2.22	2.21	2.22	2.25
Field Moisture Content %	10.3	10.6	9.7	10.3
Field Dry Density (FDD) t/m ³	2.01	2.00	2.03	2.04
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.29	2.28	2.31
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.5	0.0
Hilf Density Ratio (%)	97.0	96.5	97.5	97.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-23
Issue Number: 1
Date Issued: 14/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5565
Date Sampled: 07/07/2021
Dates Tested: 07/07/2021 - 12/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
 Geotech Field Supervisor
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-5565E	G21-5565F	G21-5565G	G21-5565H
Test Number	154	155	156	157
Date Tested	07/07/2021	07/07/2021	07/07/2021	07/07/2021
Time Tested	10:50	11:10	12:00	12:15
Test Request #/Location	LOT 2044	LOT 2042	LOT 2014	LOT 2012
Easting	498586	498557	498524	498527
Northing	6931955	6931971	6931954	6931916
Layer / Reduced Level	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown	Sandy Gravelly Clay. Orange-Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13	14	14	12
Field Wet Density (FWD) t/m ³	2.23	2.23	2.22	2.23
Field Moisture Content %	9.9	9.8	10.3	10.3
Field Dry Density (FDD) t/m ³	2.03	2.03	2.01	2.02
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.31	2.30	2.32	2.31
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.0	0.0
Hilf Density Ratio (%)	96.5	97.0	95.5	96.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-24
Issue Number: 1
Date Issued: 14/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5570
Date Sampled: 08/07/2021
Dates Tested: 08/07/2021 - 12/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-5570A	G21-5570B	G21-5570C	G21-5570D	G21-5570E	G21-5570F
Test Number	158	159	160	161	162	163
Date Tested	08/07/2021	08/07/2021	08/07/2021	08/07/2021	08/07/2021	08/07/2021
Time Tested	12:45	12:55	13:05	13:15	13:25	13:30
Test Request #/Location	LOT 2073	LOT 2075	LOT 2077	LOT 2079	LOT 3066	LOT 2065
Easting	498725	498700	498675	498648	498728	498730
Northing	6931952	6931953	6931953	6931949	6932014	6931989
Layer / Reduced Level	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Sandy Gravelly Clay, Orange-Brown	Sandy Gravelly Clay, Orange-Brown	Sandy Gravelly Clay, Orange-Brown	Sandy Gravelly Clay, Orange-Brown	Sandy Gravelly Clay, Orange-Brown	Sandy Gravelly Clay, Orange-Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	9	11	10	11	13	12
Field Wet Density (FWD) t/m ³	2.25	2.21	2.24	2.21	2.26	2.23
Field Moisture Content %	10.6	10.1	10.9	12.5	14.4	14.3
Field Dry Density (FDD) t/m ³	2.03	2.00	2.02	1.96	1.97	1.95
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.31	2.31	2.32	2.29	2.32	2.31
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	97.5	95.5	96.5	96.0	97.0	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC

Negative values = test is wet of OMC

Material Test Report

Report Number: GL21/028-25
Issue Number: 1
Date Issued: 15/07/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL21/028
Project Name: Everleigh Precinct 12 - SP2 - Level 1 Earthworks
Project Location: Teviot Road, Greenbank
Work Request: 5585
Dates Tested: 13/07/2021 - 14/07/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Gary Taylor
Geotech Field Supervisor
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-5585A	G21-5585B	G21-5585C	G21-5585D	G21-5585E	G21-5585F
Test Number	164	165	166	167	168	169
Date Tested	13/07/2021	13/07/2021	13/07/2021	13/07/2021	13/07/2021	13/07/2021
Time Tested	10:10	10:20	10:30	12:15	13:00	13:30
Test Request #/Location	LOT 2144	LOT 2146	LOT 2148	LOT 2142	LOT 3098	LOT 3096
Easting	498912	498882	498876	498913	498902	498871
Northing	6931849	6931861	6931885	6931882	6932130	6932125
Layer / Reduced Level	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL	FINISHED LEVEL
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	12	12	10	12	13	11
Field Wet Density (FWD) t/m ³	2.23	2.23	2.26	2.22	2.24	2.24
Field Moisture Content %	9.5	10.3	11.4	12.8	12.2	12.6
Field Dry Density (FDD) t/m ³	2.04	2.02	2.02	1.97	2.00	1.99
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.31	2.28	2.29	2.30	2.29
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	97.5	96.5	99.0	97.0	97.5	98.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC



Appendix C

Previous Level One Report



MORRISON GEOTECHNIC PTY LTD



MORRISON
GEOTECHNIC

Gold Coast Office
Job No: GL20/129
Ref No: 21014
Author: Ian Masman

15th February 2021

Shadforth's Civil
99 Sandalwood Lane
Forest Glen Qld 4556

ATTENTION: MR DAVID BUGDEN
Email: david.budgen@shadcivil.com.au

Dear Sir,

**RE: LEVEL ONE COMPLIANCE REPORT FOR
BULK EARTHWORKS FILLING OPERATIONS,
EVERLEIGH PRECINCT 12.1
TEVIOT ROAD, GREENBANK.**

Table of Contents

Table of Contents	1
1.0 INTRODUCTION	2
1.1 General.....	2
1.2 Previous Earthworks.....	6
1.3 The Project.....	8
3.1 Stripped Surface Assessment.....	10
3.1.1 Filling Operations.....	11
4.0 STATEMENT OF COMPLIANCE	13
5.0 EXCLUSIONS	13
6.0 LIMITATIONS	13
ATTACHMENTS:	14
Appendix A – Site Plans Showing Test Locations.....	14
Appendix B – Laboratory Test Results Reports.....	14
Appendix C – Partial Bulk Earthworks Filling Operations Report (DL18/096, dated 10 th September 2018).....	14

1.0 INTRODUCTION

1.1 General

This report presents results of Level One Earthworks Inspections and associated Compaction Compliance testing carried out on Earthworks Fill constructed at the Everleigh Estate – Precinct 12.1 development at Teviot Road, Greenbank.

Earthworks operations were constructed by Shadforth’s Civil (The Client).

Earthwork filling operations at Precinct 12.1 were carried out to form proposed residential lots and pavements and were carried between 11th November 2020 and 11th February 2021.

The areas of fill covered by this report are presented as Figure 1 and Figure 2 below.

Figures 1 & 2 presents the extent of earthworks as shown on Premise Earthworks Drawings C201B-C202B

Figure 3 presents the as constructed areas and actual areas of fill as shown on Shadforth’s Civil survey plan.

Figure 1: Extent of Fill - Premise Earthworks Drawings

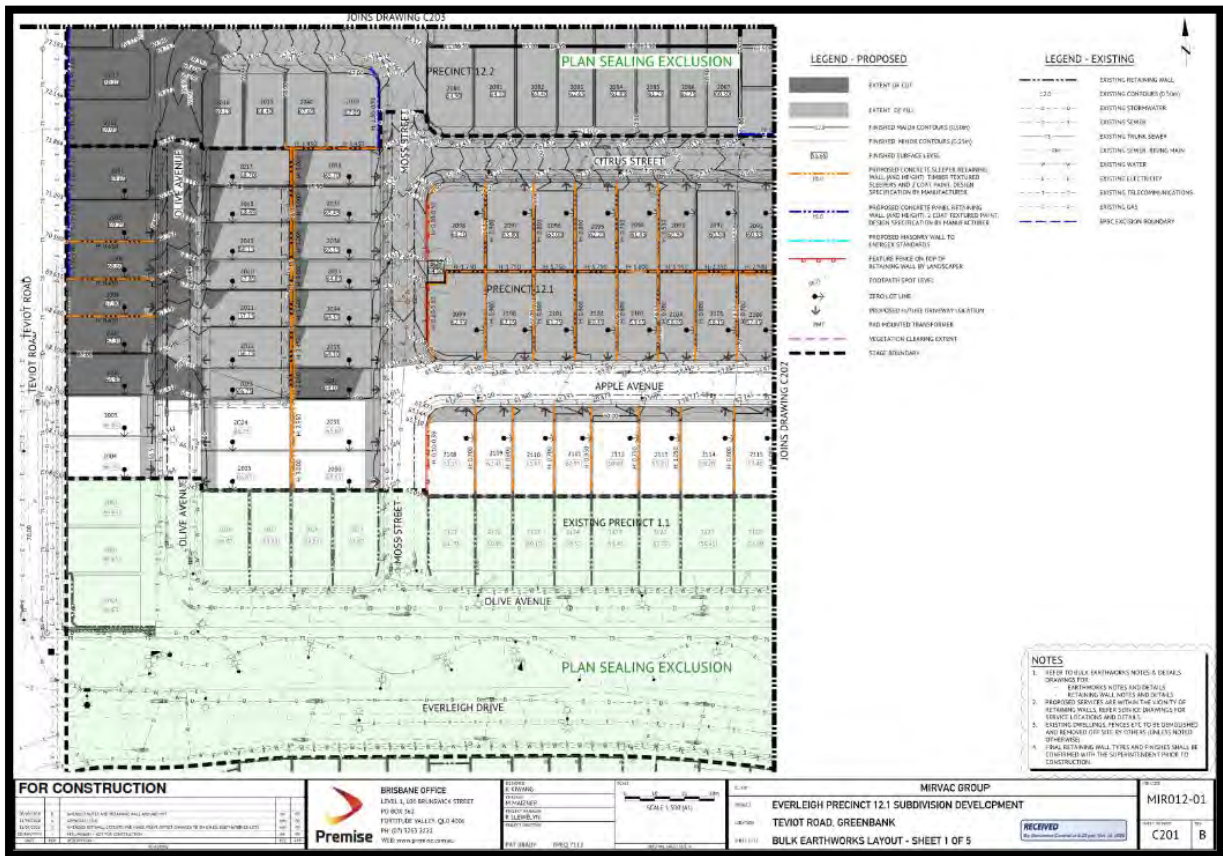


Figure 2: Extent of Fill - Premise Earthworks Drawings





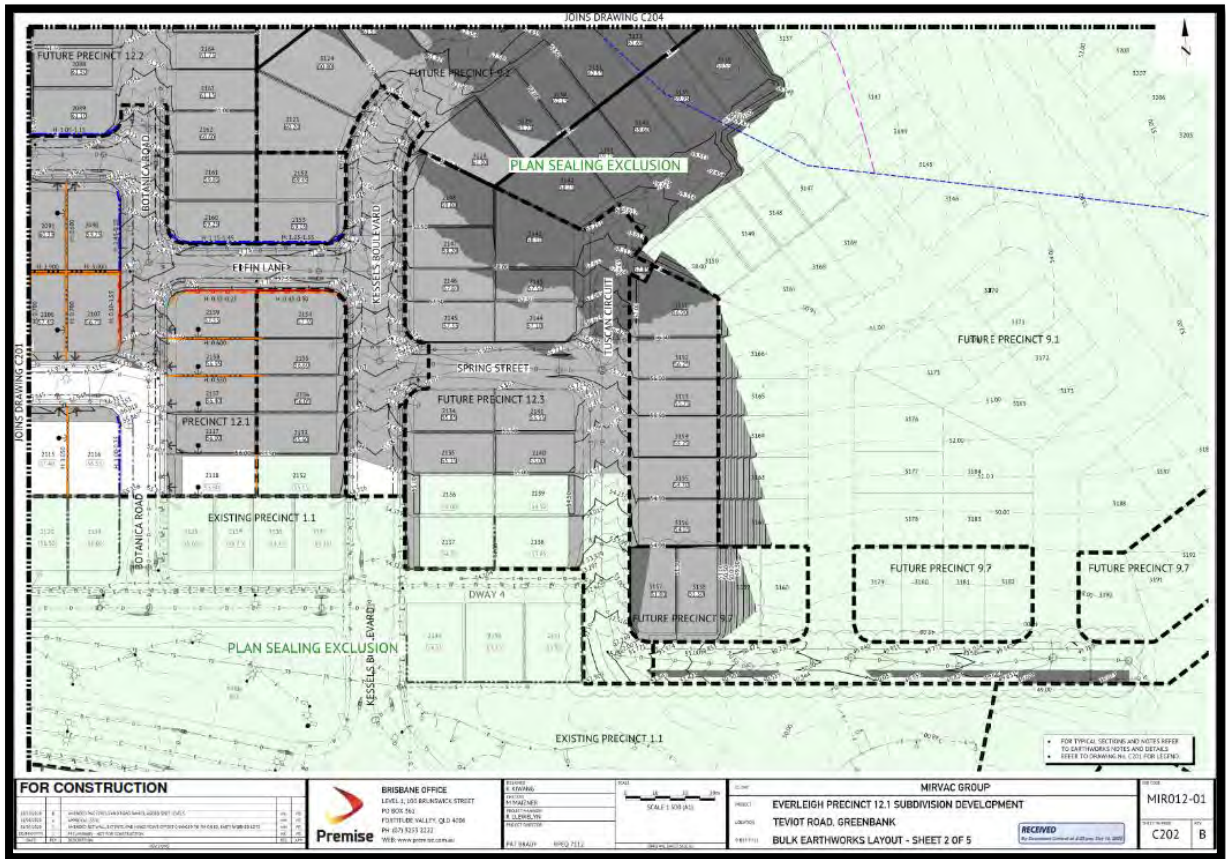


Figure 3: Actual Constructed Area of Fill – Shadforth’s Civil Survey Plan

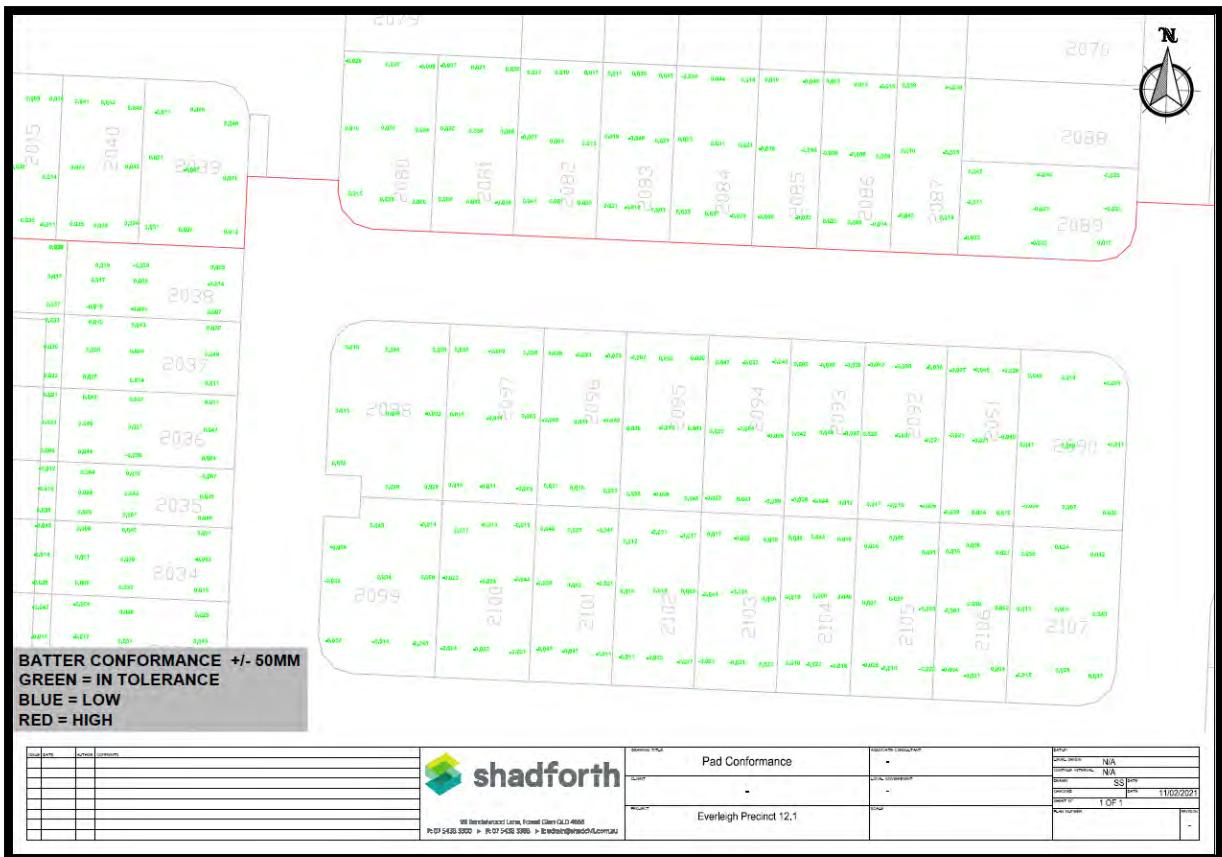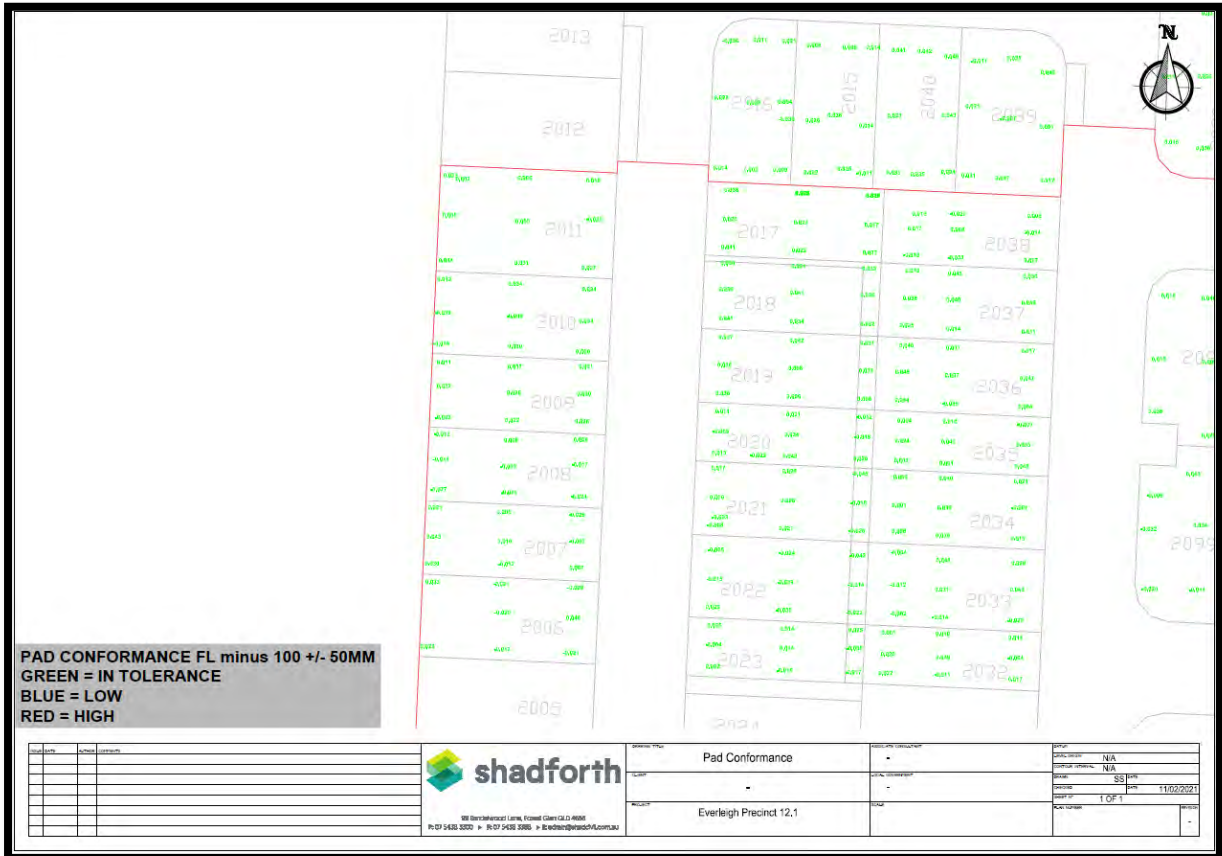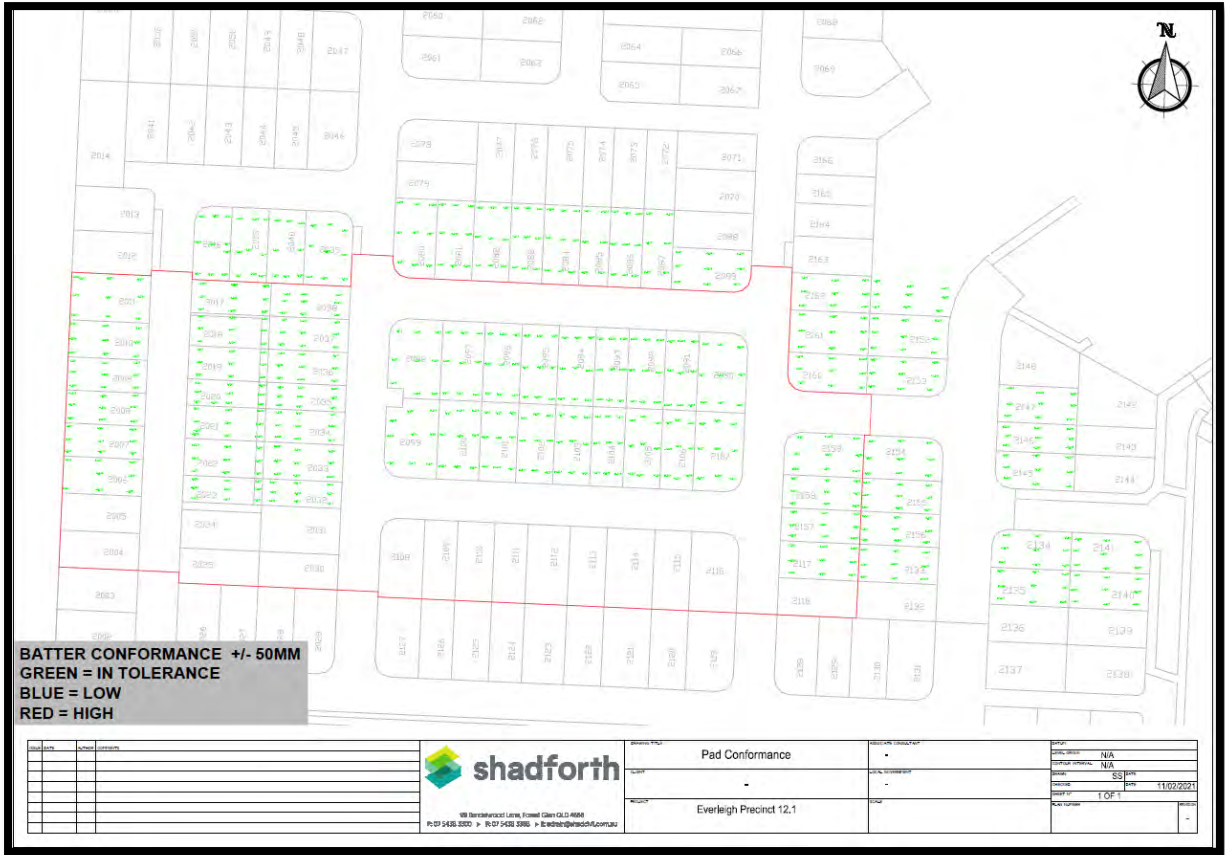

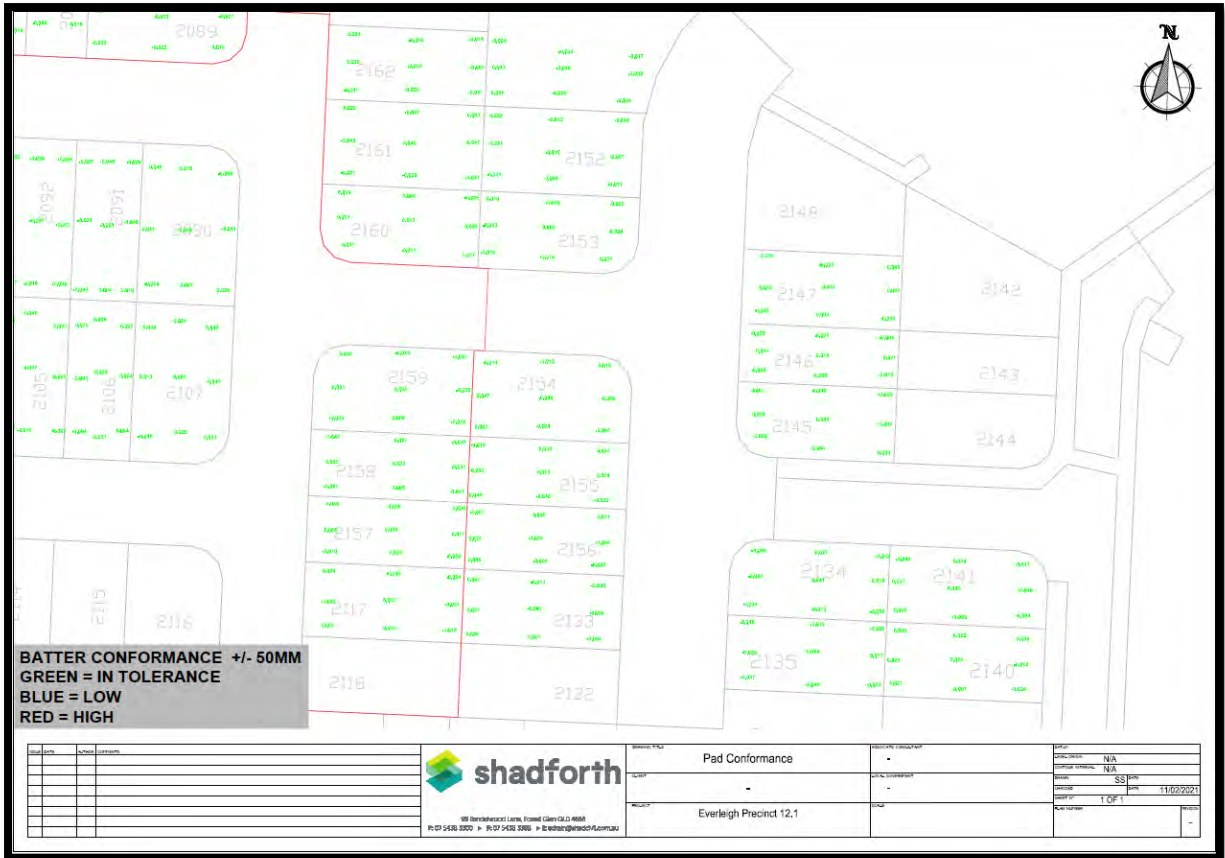

1.2 Previous Earthworks

Previous Earthworks have been carried out at The Site by Shadforths Civil between 19th April 2018 and 29th August 2018 with Quality Control Inspection and Testing was performed by Morrison Geotechnic.


Details of the previously placed fill material is contained in Morrison Geotechnic report “DL18/096 – Bulk Earthworks Operations, Everleigh Precinct 1.1 (Dated 10th September 2018)” and is contained in Appendix C of this report.



The extent of the existing fill is presented below as Figure 4.


The existing fill is considered to have been placed and compacted in an appropriately controlled manner and suitable for the support of the new fill placed between November and February 2021 to which this report relates to.

The remaining portions of the site, outside the areas shown in Figure 4, are believed to; as far as could be assessed, have not under gone any previous earthworks filling operations.

Figure 4: Extent of existing Fill – (DL18/096, Dated 10th September 2018)

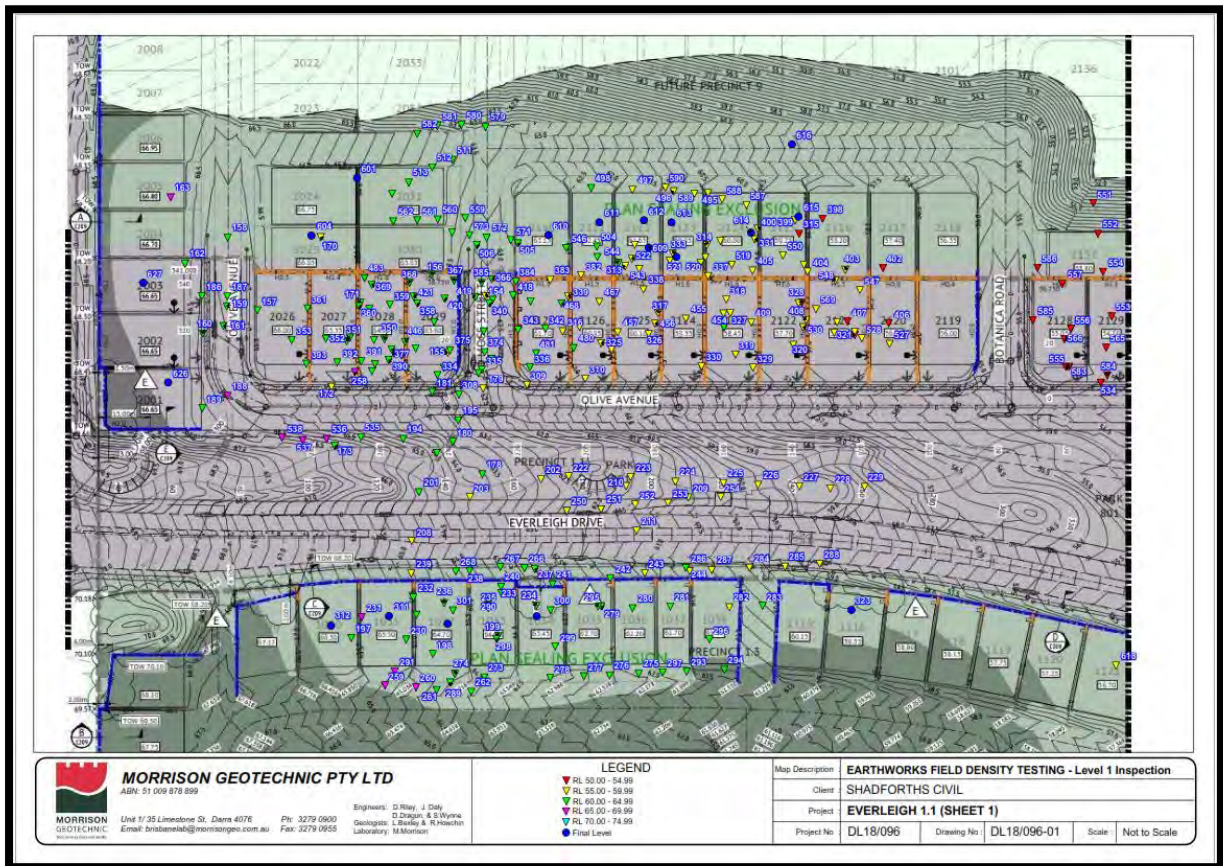

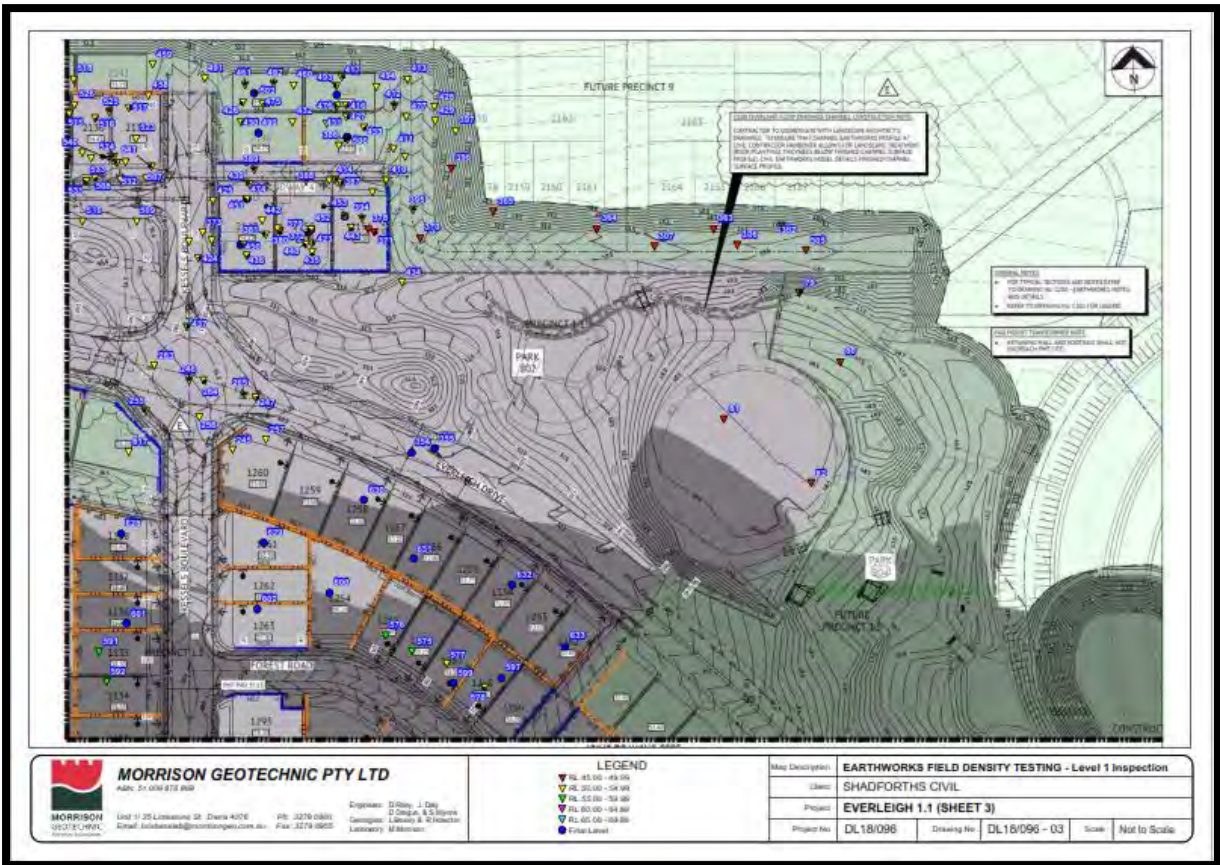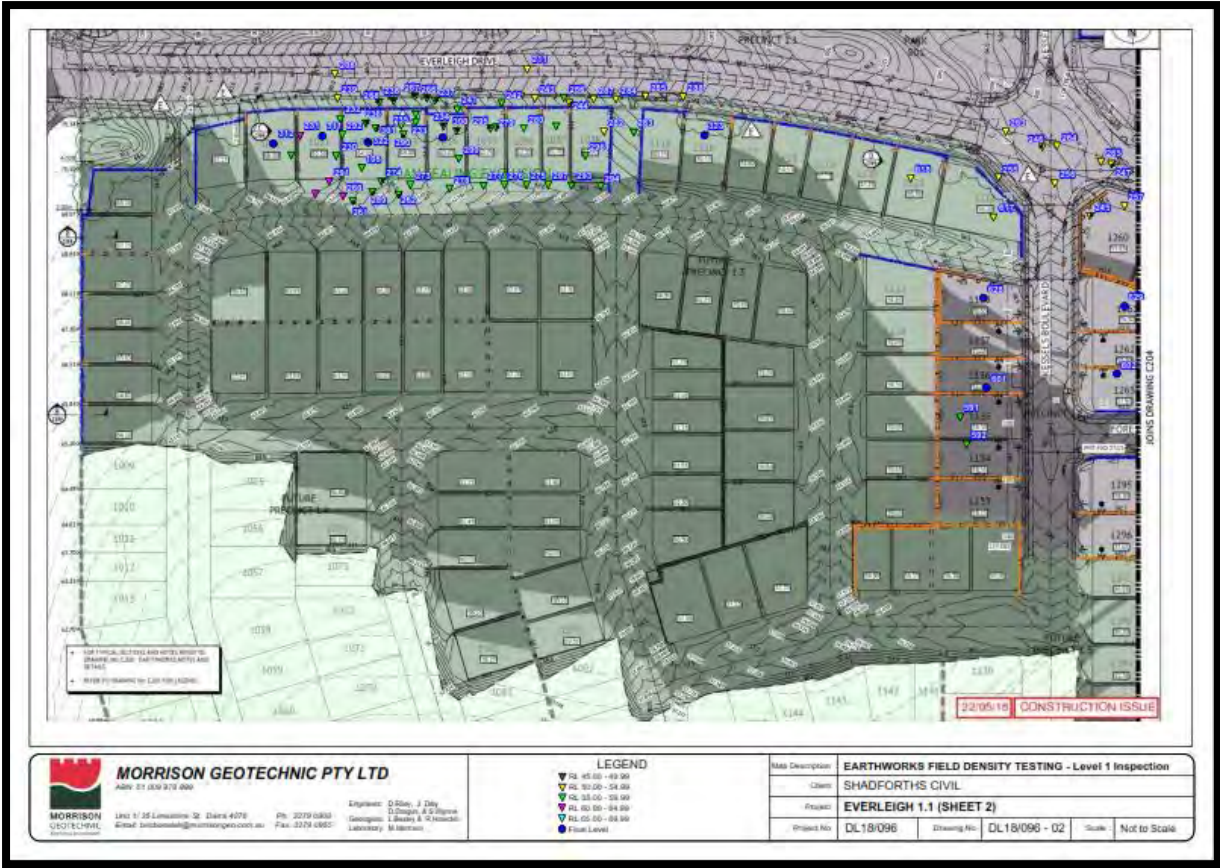

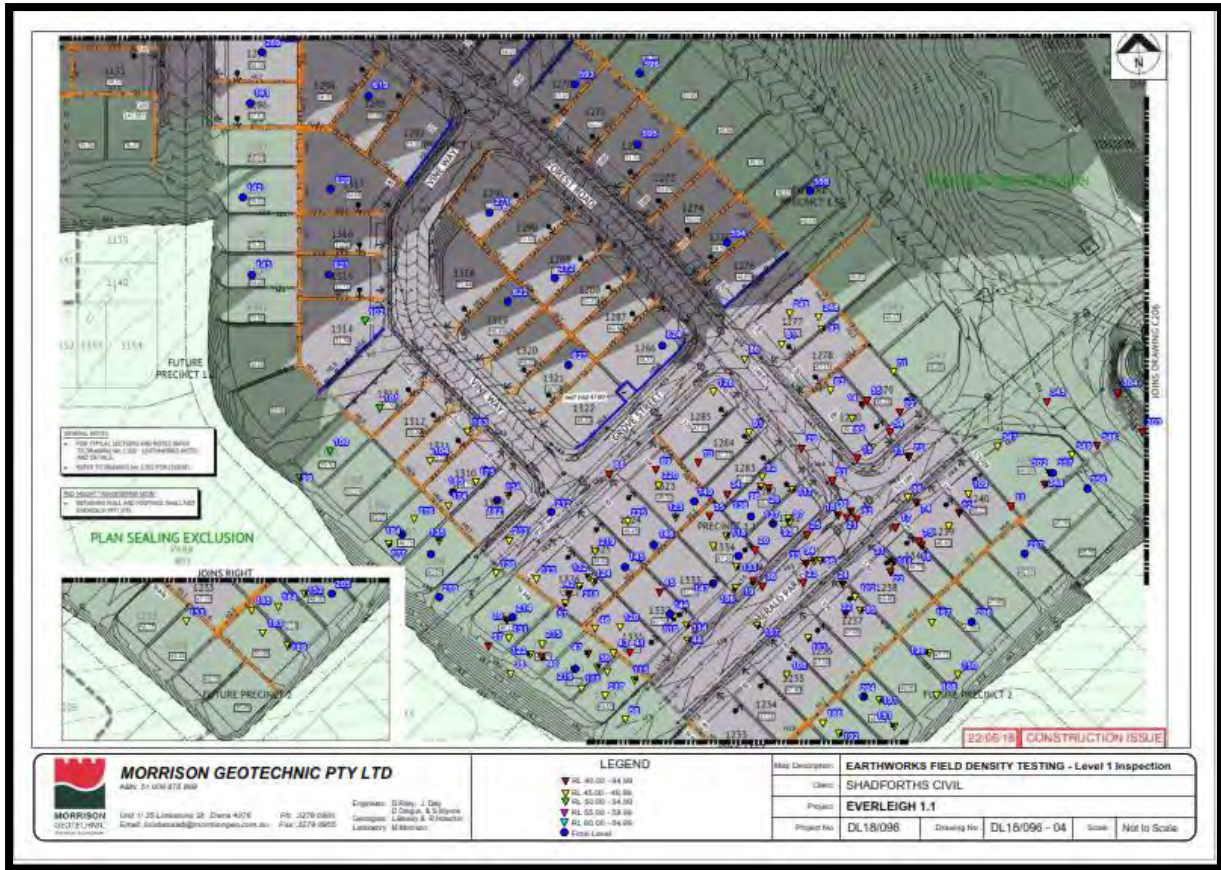

1.3 The Project

The purpose for filling at The Site was to support the following:

- A controlled fill surface below the subgrade along proposed pavements Olive Street, Moss Street, Citrus Street, Botanica Road, Elfin Lane, Kessels Blvd and Spring Street
- Residential building platforms on the proposed Lots.
- Underground services.

2.0 THE BRIEF

The Brief from the Client was limited to:

- Level One Inspection and Testing of the placement and compaction of fill materials in general accordance with AS3798 2007 – “Guidelines on Earthworks for Commercial and Residential Developments”.
- Relative Density Control Testing in accordance with AS1289 – Testing of Soils for Engineering Purposes and at frequencies required in AS3798 Table 8.1.
- Recommendations in Morrison Geotechnic report “recommended filling Earthworks specification” report 16520B, dated 25th June 2020.
- Notes on Premise Project Drawings

2.1 Additional Requirements

All fill at The Site was to be constructed in accordance with the Earthworks Specification as shown on Premise Drawing – MIR012-01 C210 Rev B.

The earthworks specification is presented as Figure 5 below.

Figure 5 Earthworks Specification

EARTHWORKS SPECIFICATION						
SPECIFICATION	DEPTH RANGE (m)				PAVEMENT SUBGRADE	TRENCH BACKFILL
	0.0 - 0.6	0.6 - 3.00	3.00 - 5.00	> 5.00		
CBR %	-	-	-	-	10	15
LAYER THICKNESS (mm)	300	300	300	300	BETWEEN SUBGRADE AND 0.3m BELOW	300
MAXIMUM PARTICLE SIZE (mm)	200	500	500	500	200	200
% PASSING 37.5mm	80% MIN	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES
% PASSING 0.075mm	30% MIN	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES AND AS3798
COMPACTION	95% STD	95% STD	95% STD	95% STD	100% STD	95% MOD IN ROADS AND 95% STD OUTSIDE ROADS
MOISTURE	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	60% - 90% OF OMC	+/- 2% OMC

NOTES:

1. OMC - OPTIMUM MOISTURE CONTENT
2. LAYER OF THICKNESS IS LIMITED TO 300mm TO ALLOW IDENTIFICATION OF LARGER PARTICLES AND ALLOW EVERY CHANCE OF BREAK DOWN IN FILLING OR REMOVAL.
3. TREATMENT OF ROCK TO SIZES ABOVE SHOULD BE CARRIED OUT IN CUT PRIOR TO LOADING TO FILL AREAS. TREATED ROCK TO BE APPROVED BY GITA PRIOR TO TRANSPORTING.
4. UPPER 0.6m, (PARTICULARLY IN AREAS OF DEEP FILL), OF THE FILL PROFILE TO BE RELATIVELY IMPERMEABLE HENCE INCREASE IN FINES COMPONENT.
5. PROOF ROLL TESTING ON EACH COMPACTED LAYER USING RUBBER WHEELED PLANT SUCH AS LOADED ADT'S OR LOADED SCRAPERS. UNFAVOURABLE DEFORMATION OF THE COMPACTED SURFACE UNDER LOAD OF ADT'S OR SCRAPERS WILL REQUIRE REPAIR PRIOR TO ADDITIONAL PLACEMENT.
6. MECHANICAL INTERLOCK METHODOLOGY IS NOT APPROPRIATE DUE TO POOR DURABILITY OF SITE WON SANDSTONE. FILL COMPOSITION IS REQUIRED TO INCLUDE AN APPROPRIATE SAND GRAVEL AND FINES COMPONENT CONFORMING TO THE REQUIREMENTS OF AS798.

KEY OUTCOMES FOR EARTHWORKS OPERATIONS

1. DELIVER RESIDENTIAL LOTS WITH FAVOURABLE LOT CLASSIFICATIONS - I.E - NO P CLASSIFICATIONS
2. FILL THICKNESS DOES NOT VARY MORE THAN 2m OVER A DISTANCE OF 10m
3. CONSTRUCT FILL AND LIMIT LONG TERM CREEP SETTLEMENTS TO WITHIN 0.5% TO 1.0% OF THE FILL THICKNESS
4. BUILDING PLATFORM THAT ALLOWS BUILDERS TO CONSTRUCT SLAB ON GROUND RAFTS USING LIGHT EARTHMOVING EQUIPMENT
5. MATERIAL WON FROM CUTS AND USED IN FILL WITH REQUIRE
 - CUTS IN ROCK AS WELL AS BLENDED WITH
 - CUTS IN FINER MATERIALS SUCH AS SANDS AND CLAYS
6. CREATING A FILL PLATFORM THAT IS ABLE TO BE TESTED IN ACCORDANCE WITH AS3798 AND AS1289

Lots and pavements where rock of medium strength or stronger was exposed at the final cut earthworks levels, was cut to a depth of approximately 0.6m below the final earthworks levels. The excavated rock was replaced using fill materials compliant with the specification requirements for materials within the 0.0m to 0.6m depth range as shown in Figure 5 and compacted accordingly.

3.0 METHODOLOGY

Earthworks, Inspections and Testing was carried out on the stripped ground surfaces and during the placement and compaction of fill materials.

Field and laboratory testing included a walk over assessments of the existing ground conditions, proof roll testing of the fill foundation, observation of filling and compaction activities, material compliance testing and compaction testing.

3.1 Stripped Surface Assessment

The fill areas covered by this report were stripped and cleared of visible loose materials, vegetation and topsoil.

Materials exposed after stripping and formed the fill foundation can be broadly summarised as:

- Natural - Silty Sand (SM) – at least dense, fine to medium grained sands, traces of low plasticity fines, grey – brown and moist.
- Natural – Sandy Clay (CI) – at least Very Stiff, medium plasticity, fine to medium grained sand, pale brown mottled orange and moist.
- Natural – Sandstone (XW-HW) – Extremely to Highly weathered, very low to low strength, orange – yellow brown
- Natural – Sandstone (MW-SW) – Moderately to Slightly weathered, medium, high and very high strength, yellow grey and pale grey
- Existing Fill – Clayey Sand (SC) fine to coarse sand, fine to coarse gravel, yellow brown and moist.
- Existing Fill – Gravelly Sand, Clay (CI) medium plasticity, fine to coarse sand, fine to coarse gravel, yellow / brown moist.

Following the stripped surface assessment of the fill areas, the foundation was approved for filling using the following process:

- Walk over assessments confirming that a competent natural foundation had been exposed.
- Proof roll testing using large sized truck carrying out multiple passes confirming no movement of the exposed natural or existing fill foundation.

Picture 1: View of The Site During Stripping Operations



3.1.1 Filling Operations

Fill materials were sourced and processed onsite and can be broadly summarised as: -

- Onsite - Clayey Sand Clay (SC), fine, medium plasticity fines with fine to coarse gravels, yellow - brown and moist.
- Onsite - Gravelly Sandy Clay (CI), medium plasticity fines, fine to coarse sand, fine to coarse gravel, yellow - brown and moist.
- Onsite – blasted and crushed sandstone with Gravelly Clayey Sand (SC), fine to coarse sand, fine to coarse gravel, low to medium plasticity fines with cobbles up to 200mm max.
- Onsite – Ripped and crushed sandstone.

Blasting operations were required in cut excavations to loosen high and very high strength sandstone . Materials obtained from blasted rock cuts as well as any large fragments obtained during the heavy ripping activities were processed using mechanical crushing plant.

Crushing operations were required to initially break down large rock fragments to sizes that generally comply with the clients Earthworks Specification (Figure 5). Treatment of the large rock fragments was continued using a “pineapple foot” vibrating roller and Cat 825 compactors as appropriate.

The general methodology for the rock crushing operations can be broadly summarised as: -

- Large rock fragments were broken down by a large “pineapple” roller with vibration
- Mechanical Crushing to reduce rock fragments to 200mm size or less in the top 600mm.
- Mixing crushed product with onsite materials using an excavator and placed into stockpiles.

Prior to placement the crushed and stockpiled materials were assessed to be suitable for use as fill and compliant with the Earthworks Specifications.

Placement and compaction of the fill materials was carried out using the following plant: -

- | | | |
|-----------------------------|--------------|-----------------------------------|
| • Water Carts | • Excavators | • 825 Compactors |
| • Vibrating Pad Foot Roller | • Grader | • Dozers |
| • Dump Trucks | • Scrapers | • Pineapple foot Vibrating Roller |

The bulk earthworks operations were observed to generally meet the Earthwork’s Specification as shown above in Figure 5 and the intent of AS3798 2007 (Guidelines on Earthworks for Commercial and Residential Developments).

A summary of the earthworks placement and compaction methodology is presented below: -

- Placement of fill was generally limited to 300mm layers for the entire fill thickness.
- Maximum particle size was observed to be 500mm max for fill below 0.6m from the final earthwork’s levels.
- Any exposed rock fragments greater than 500mm were effectively broken down by compaction plant or removed from the fill.

- Removed rock fragments were processed by crushing, blended with finer materials and returned to the fill areas.
- Continual proof roll testing of the placed and compacted fill layers was carried out using large rubber wheeled earthworks plant.
- Lots in cut where rock was exposed at the cut levels were excavated to approximately 0.6m below and replaced with processed and crushed fill materials.
- Fill was moisture conditioned at the fill source and during placement to achieve moisture contents suitable for compaction and the specification.

Our site representative observed the filling process as described above and was assessed to be consistent for the entire thickness of fill and generally compliant with The Earthworks Specification.

Compaction testing was carried out on the fill materials in accordance with Table 5.1 and Table 8.1 of AS3798 and tested in accordance with AS1289 Methods of Testing Soils for Engineering Purposes.

Testing achieved the required specification requirements of a minimum density ratio of 95% at moisture contents within +/- 2% of the Optimum Moisture Content (OMC).

Fill placed and compacted at measured density ratios less than 95% or outside a moisture content +/- 2% OMC were tined, moisture conditioned and re-compacted until the required specification was achieved. Retesting was carried out using Random Stratified Location methods.

The approximate locations of compaction testing are shown on the Marked-Up Site Plans contained in Appendix A. These test locations and levels were not obtained by survey and therefore should only be considered as approximate.

Picture 2: View of the Site During Construction



4.0 STATEMENT OF COMPLIANCE

Our representatives observed the relevant earthworks operations including the stripped surfaces, fill placement and compaction operations and carried out compaction tests in accordance with the required standard (AS3798 & AS1289). Testing of the fill material achieved the required specification requirements of a minimum density ratio of 95% at moisture contents within +/- 2% of the Optimum Moisture Content (OMC).

It is confirmed that Level One Inspection and Testing has been carried out on the filling operation and limited to the extent shown in Figure 2.

Based on the observations made by our Geotechnicians and the results of the field and laboratory tests, the placed and compacted fill at the above project has, as far as we have been able to assess, been constructed in general accordance with the intent of AS3798 and the Earthworks Specification.

The fill can be deemed to be "controlled" in accordance with AS2870.

5.0 EXCLUSIONS

This statement does not include any topsoil, which may be placed for use as dressing, trench backfill, or any other subsequent earthworks after 12th February 2021.

Assessments of material quality such as soaked CBR values and site classifications are excluded from this commission.

Our on-site attendance specifically excludes assessments of fill material quality and engineering properties that are outside the requirements of AS3798 – 2007 and the Earthworks Specification.

Footings and ground slabs for any structures constructed over natural soils or controlled fill should be designed to accommodate the characteristic ground surface movements and settlement potential. Assessments of these design parameters are beyond the scope of this Report.

6.0 LIMITATIONS

This Report has been prepared by Morrison Geotechnic Pty Ltd (**Morrison Geotechnic**), and may include contributions from Morrison Geotechnic's officers and employees, sub-contractors, sub-consultants or agents (**Contributors**).

This Report is for the sole benefit and use of Shadforth's Civil Pty Ltd (**Client**), its designers, clients and relevant statutory authorities for the sole purpose of providing geotechnical advice and recommendations in respect of the Bulk Earthworks Filling Operations, Precinct 12.1, Everleigh Estate (**Project**). The Report is only intended to address those issues expressly described in the Brief/ Work Instructions in this Report.

This Report should not be used or relied upon for any other purpose without Morrison Geotechnic's prior written consent. Morrison Geotechnic and the Contributors do not accept any responsibility or liability in any way whatsoever for the use or reliance of this Report by anyone other than Shadforth's Civil Pty Ltd (**Client**), its designers, its clients and relevant statutory authorities or by anyone else for any purpose other than that for which it has been prepared.

Except with Morrison Geotechnic's prior written consent, this Report may not be:

- (a) released to any other party, whether in whole or in part (other than to the Client's officers, employees, advisers, designers, clients and relevant statutory authorities).
- (b) used or relied upon by any other party.

Morrison Geotechnic and the Contributors do not accept any liability or responsibility whatsoever for, or in respect of, any use or reliance upon this Report by any other party. Morrison Geotechnic is not obliged to enter into discussions with any third party in respect of this Report.

The information (including technical information and information obtained through discussions) on which this report is based has been provided by the Client and third parties. Morrison Geotechnic and the Contributors:

- (a) have relied upon and presumed the accuracy of this information.
- (b) have not verified the accuracy or reliability of this information (other than as expressly stated in this Report).
- (c) have not made any independent investigations or enquiries in respect of those matters of which it has no actual knowledge at the time of giving this Report to the Client; and
- (d) make no warranty or guarantee, expressed or implied, as to the accuracy or reliability of this information.

Morrison Geotechnic and the Contributors do not accept responsibility or liability for any incorrect assumptions related to this Report. For the avoidance of doubt, this Report:


- (a) is not an environmental, contamination or hazardous materials assessment; may be invalid, incomplete or inaccurate (including errors in the scope of work, investigation methodology, observations, opinions and advice) where the information provided to Morrison Geotechnic was invalid, incomplete or inaccurate.
- (b) is limited to observations of those parts of the site described in Section 1.0.

No warranty or guarantee, whether express or implied, is made in respect of the geotechnical data, information, advice, opinions and recommendations present in this Report.

If further information becomes available, or additional assumptions need to be made, Morrison Geotechnic reserves its right to amend this Report.

If you have any queries regarding the above, please contact our Brisbane office.

Yours faithfully



MARK BALLARD (RPEQ 10223)

BEng (Civil), FIEAust, CPEng, RPEQ & NER

For and on Behalf of

MORRISON GEOTECHNIC PTY LIMITED

ATTACHMENTS:


Appendix A – Site Plans Showing Test Locations

Appendix B – Laboratory Test Results Reports

Appendix C – Partial Bulk Earthworks Filling Operations Report (DL18/096, dated 10th September 2018).

Appendix A

(Site Plan showing Test Locations)

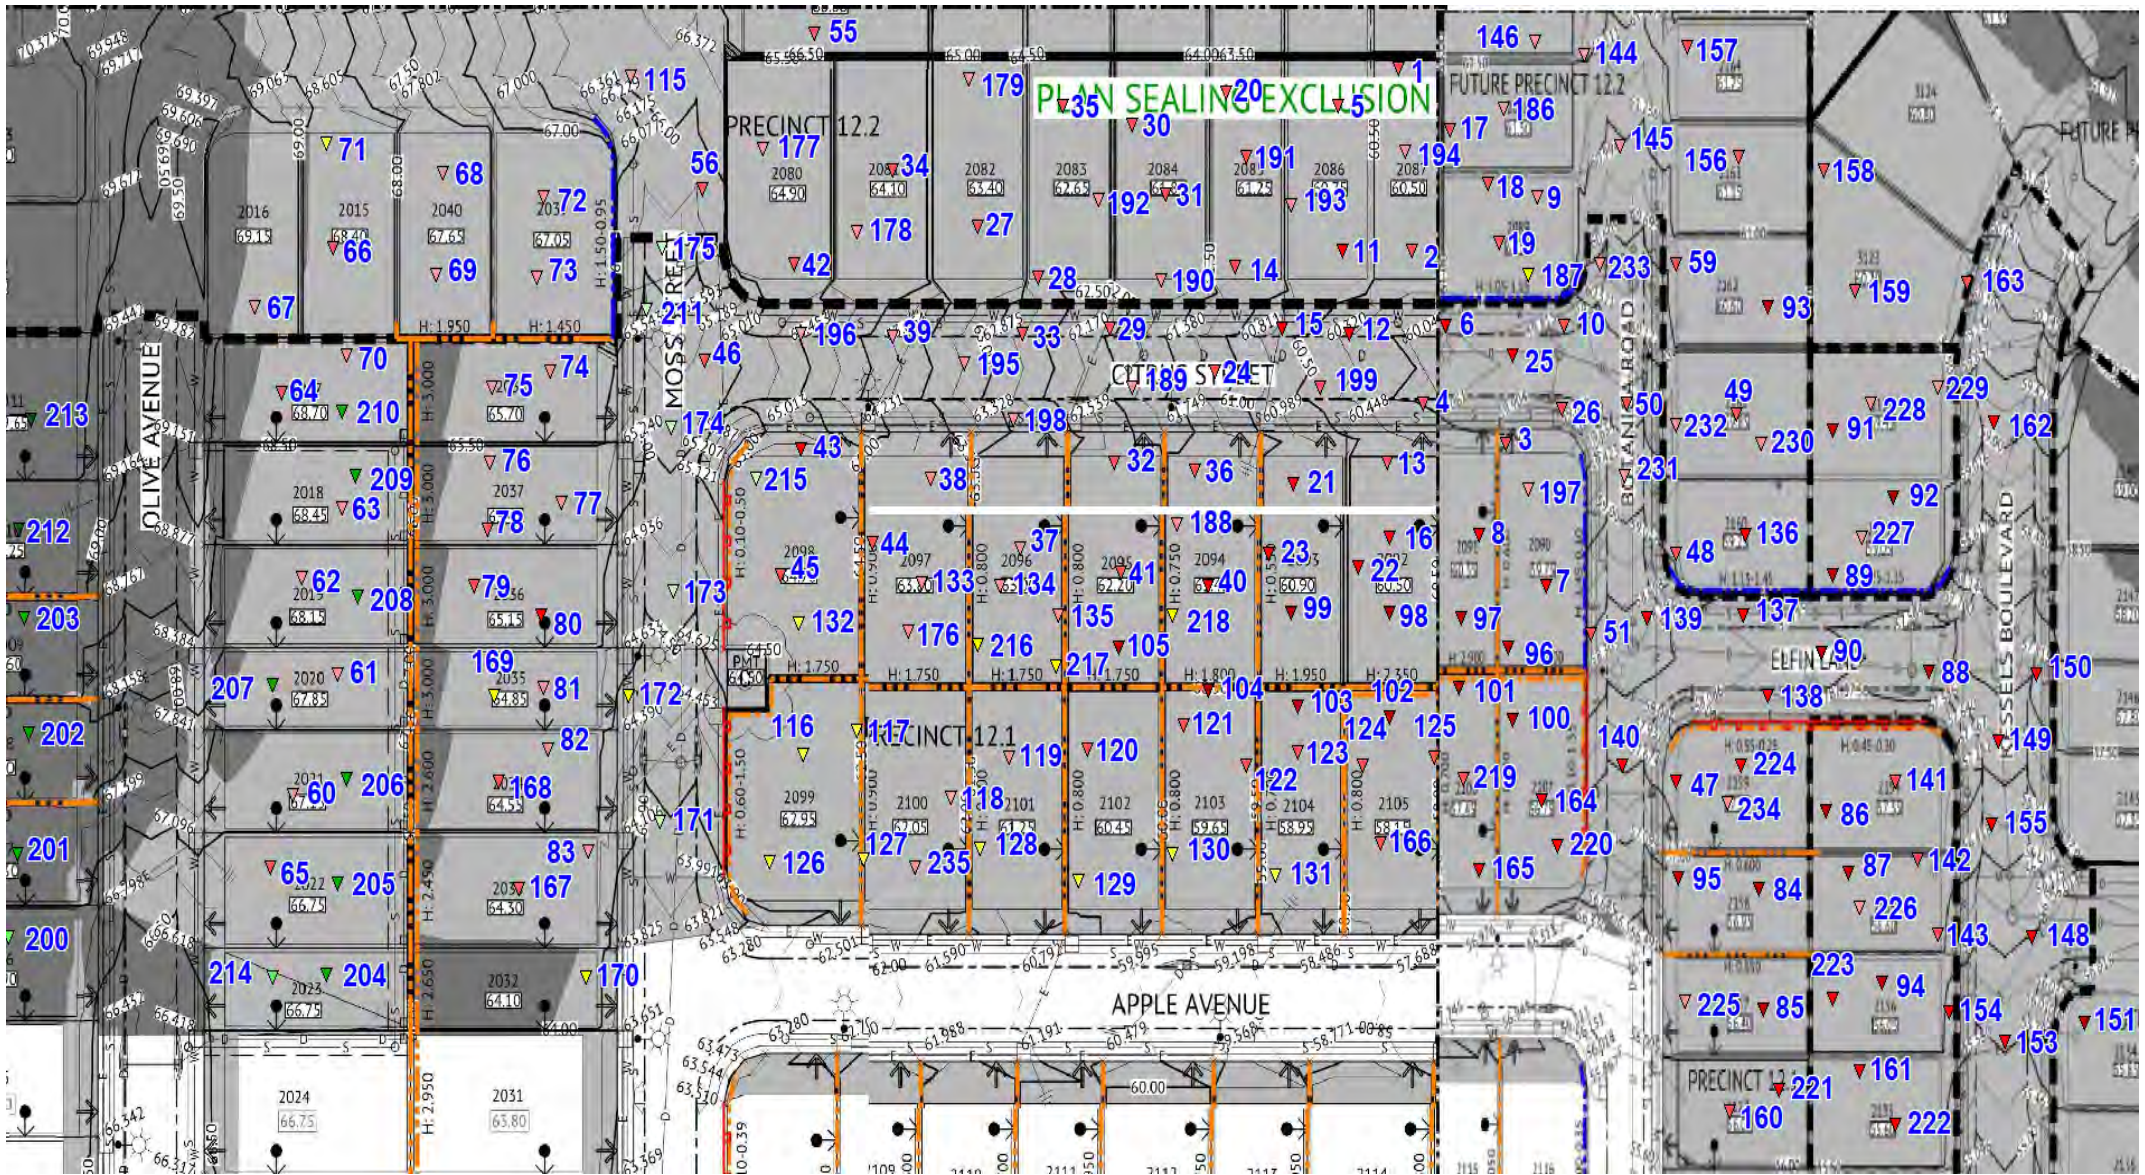

MORRISON
GEOTECHNIC

RL 55	▼	RL 63-65	▼
RL 55-57	▼	RL 65-67	▼
RL 57-59	▼	RL 67-69	▼
RL 59-61	▼	RL 69-71	▼
RL 61-63	▼		

Map Description :	Field Density Test Locations		
Client :	Shadforths Civil		
Project :	Everleigh Precinct 12.1		
Project No :	GL20/129	Date: 02.06.21	Scale : Not to Scale

Appendix B

(Laboratory Test Reports)

Material Test Report

Report Number: GL20/129-1
Issue Number: 1
Date Issued: 25/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4236
Dates Tested: 13/11/2020 - 16/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4236A	G20-4236B	G20-4236C	G20-4236D
Test Number	1	2	3	4
Date Tested	13/11/2020	13/11/2020	13/11/2020	13/11/2020
Time Tested	10:05	10:10	10:15	10:20
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8763	8768	8727	8730
Northing	1924	1908	1919	1907
Elevation (m)	58.6	58.0	58.2	57.8
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	3.0	4.4	16.2	4.1
Field Wet Density (FWD) t/m ³	2.23	2.25	2.20	2.26
Field Moisture Content %	10.9	10.1	11.6	11.8
Field Dry Density (FDD) t/m ³	2.01	2.04	1.97	2.03
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.20	2.19	2.26	2.22
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	101.5	102.5	97.5	102.0
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-1
Issue Number: 1
Date Issued: 25/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4236
Dates Tested: 13/11/2020 - 16/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4236E	G20-4236F	G20-4236G	G20-4236H
Test Number	5	6	7	8
Date Tested	13/11/2020	13/11/2020	13/11/2020	13/11/2020
Time Tested	10:25	10:30	10:35	10:40
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8735	8713	8719	8736
Northing	1891	1917	1907	1884
Elevation (m)	57.0	56.3	56.7	56.2
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	19.3	15.9	5.2	14.7
Field Wet Density (FWD) t/m ³	2.21	2.19	2.24	2.21
Field Moisture Content %	12.0	10.5	11.9	12.0
Field Dry Density (FDD) t/m ³	1.97	1.98	2.00	1.97
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.05	2.24	2.22	2.27
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	107.5	98.0	100.5	97.5
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-2
Issue Number: 1
Date Issued: 25/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4251
Dates Tested: 16/11/2020 - 24/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4251A	G20-4251B	G20-4251C	G20-4251D
Test Number	9	10	11	12
Date Tested	16/11/2020	16/11/2020	16/11/2020	16/11/2020
Time Tested	10:00	10:05	10:10	10:15
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8737	8740	8755	8741
Northing	1938	1918	1891	1897
Elevation (m)	60.1	57.8	55.8	56.4
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	12.1	13.6	13.7	15.7
Field Wet Density (FWD) t/m ³	2.22	2.25	2.26	2.20
Field Moisture Content %	10.6	9.4	9.3	9.0
Field Dry Density (FDD) t/m ³	2.00	2.06	2.07	2.02
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.26	2.28	2.30	2.30
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	-1.5	0.0	0.0	0.5
Hilf Density Ratio (%)	98.0	98.5	98.5	95.5
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-2
Issue Number: 1
Date Issued: 25/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4251
Dates Tested: 16/11/2020 - 24/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4251E	G20-4251F	G20-4251G	G20-4251H
Test Number	13	14	15	16
Date Tested	16/11/2020	16/11/2020	16/11/2020	16/11/2020
Time Tested	10:20	10:25	10:30	10:35
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8727	8744	8767	8752
Northing	1935	1909	1875	1882
Elevation (m)	58.9	57.1	55.0	55.5
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13.1	11.7	12.9	14.9
Field Wet Density (FWD) t/m ³	2.26	2.22	2.24	2.20
Field Moisture Content %	9.6	9.3	10.3	10.1
Field Dry Density (FDD) t/m ³	2.06	2.03	2.03	2.00
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.27	2.28	2.30	2.28
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.5
Hilf Density Ratio (%)	99.5	97.5	97.0	96.5
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-3
Issue Number: 1
Date Issued: 30/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4260
Dates Tested: 17/11/2020 - 23/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4260A	G20-4260B	G20-4260C	G20-4260D
Test Number	17	18	19	20
Date Tested	17/11/2020	17/11/2020	17/11/2020	17/11/2020
Time Tested	10:00	10:05	10:10	10:15
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8746	8751	8757	8712
Northing	1931	1925	1918	1936
Elevation (m)	58.5	58.3	58.1	57.3
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	12.6	14.4	13.4	16.4
Field Wet Density (FWD) t/m ³	2.26	2.21	2.26	2.23
Field Moisture Content %	9.6	7.6	8.8	8.8
Field Dry Density (FDD) t/m ³	2.06	2.06	2.08	2.05
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.32	2.28	2.31	2.28
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	97.5	97.0	98.0	98.0
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-3
Issue Number: 1
Date Issued: 30/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4260
Dates Tested: 17/11/2020 - 23/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4260E	G20-4260F	G20-4260G	G20-4260H
Test Number	21	22	23	24
Date Tested	17/11/2020	17/11/2020	17/11/2020	17/11/2020
Time Tested	10:20	10:25	10:30	10:35
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8722	8730	8719	8709
Northing	1888	1880	1882	1902
Elevation (m)	56.5	56.9	56.1	57.3
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	14.6	12.0	9.8	17.6
Field Wet Density (FWD) t/m ³	2.20	2.22	2.26	2.22
Field Moisture Content %	10.0	10.5	9.5	8.7
Field Dry Density (FDD) t/m ³	2.00	2.01	2.06	2.04
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.26	2.27	2.30	2.30
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.0
Hilf Density Ratio (%)	97.5	98.0	98.0	96.5
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-4
Issue Number: 1
Date Issued: 30/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4292
Dates Tested: 23/11/2020 - 24/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4292A	G20-4292B	G20-4292C	G20-4292D	G20-4292E	G20-4292F
Test Number	25	26	27	28	29	30
Date Tested	23/11/2020	23/11/2020	23/11/2020	23/11/2020	23/11/2020	23/11/2020
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8760	8767	8675	8685	8693	8698
Northing	1903	1897	1921	1915	1907	1933
Elevation (m)	56.9	57.5	57.2	58.1	57.7	57.9
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	14.9	16.4	13.9	15.5	16.4	14.3
Field Wet Density (FWD) t/m ³	2.14	2.17	2.18	2.20	2.23	2.21
Field Moisture Content %	7.9	10.6	9.3	8.7	11.1	12.0
Field Dry Density (FDD) t/m ³	1.99	1.96	2.00	2.02	2.01	1.97
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.24	2.26	2.27	2.30	2.33	2.30
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.5	0.5	0.0	0.5
Hilf Density Ratio (%)	95.5	96.0	96.5	95.5	96.0	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-4
Issue Number: 1
Date Issued: 30/11/2020
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4292
Dates Tested: 23/11/2020 - 24/11/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4292G	G20-4292H	G20-4292I	G20-4292J	G20-4292K	G20-4292L
Test Number	31	32	33	34	35	36
Date Tested	23/11/2020	23/11/2020	23/11/2020	23/11/2020	23/11/2020	23/11/2020
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8702	8694	8683	8664	8688	8707
Northing	1922	1890	1906	1926	1934	1890
Elevation (m)	57.1	58.8	57.9	57.5	57.9	58.4
Soil Description	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown	Sandy Gravelly Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13.6	12.2	11.7	13.6	15.0	14.7
Field Wet Density (FWD) t/m ³	2.23	2.20	2.19	2.19	2.25	2.22
Field Moisture Content %	9.1	8.4	11.8	10.6	9.5	11.3
Field Dry Density (FDD) t/m ³	2.04	2.03	1.96	1.98	2.05	1.99
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.28	2.25	2.26	2.27	2.33	2.30
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	97.5	97.5	97.0	96.5	96.5	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-5
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4322
Date Sampled: 24/11/2020
Dates Tested: 24/11/2020 - 10/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Remarks: AS 1289.5.7.1 and 1289.2.1.1 laboratory Testing carried out by Morrison Geotechnic's Darra Laboratory. NATA Accreditation No. 1169, Site No. 1162.
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1			
Sample Number	G20-4322A	G20-4322B	G20-4322C
Test Number	37	38	39
Date Tested	24/11/2020	24/11/2020	24/11/2020
Time Tested	10:10	10:20	10:30
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8681	8669	8662
Northing	1883	1890	1907
Elevation (m)	59.4	59.6	59.1
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0.0	19.4	0.0
Field Wet Density (FWD) t/m ³	2.10	2.01	2.05
Field Moisture Content %	9.0	8.1	9.7
Field Dry Density (FDD) t/m ³	1.92	1.86	1.87
Peak Converted Wet Density t/m ³	2.04	**	2.03
Adjusted Peak Converted Wet Density t/m ³	**	2.09	**
Moisture Variation (Wv) %	4.5	**	4.5
Adjusted Moisture Variation %	**	4.0	**
Hilf Density Ratio (%)	103.0	96.0	101.0
Compaction Method	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-6
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4352
Date Sampled: 27/11/2020
Dates Tested: 27/11/2020 - 04/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4352A	G20-4352B	G20-4352C	G20-4352D	G20-4352E	G20-4352F
Test Number	40	41	42	43	44	45
Date Tested	27/11/2020	27/11/2020	27/11/2020	27/11/2020	27/11/2020	27/11/2020
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8710	8695	8649	8651	8659	8644
Northing	1879	1879	1915	1892	1883	1878
Elevation (m)	56.5	57.1	57.3	56.9	57.7	57.9
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	9.8	11.0	8.2	10.9	9.6	11.5
Field Wet Density (FWD) t/m ³	2.17	2.19	2.16	2.19	2.21	2.18
Field Moisture Content %	11.9	10.1	10.7	9.6	10.6	12.6
Field Dry Density (FDD) t/m ³	1.94	1.99	1.96	2.00	2.00	1.93
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.21	2.20	2.23	2.22	2.22	2.25
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	-0.5	0.5	0.0	0.5	0.5	0.5
Hilf Density Ratio (%)	98.5	99.5	97.0	98.5	99.5	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-6
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4352
Date Sampled: 27/11/2020
Dates Tested: 27/11/2020 - 04/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4352G	G20-4352H	G20-4352I	G20-4352J	G20-4352K	G20-4352L
Test Number	46	47	48	49	50	51
Date Tested	27/11/2020	27/11/2020	27/11/2020	27/11/2020	27/11/2020	27/11/2020
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8635	8793	8792	8803	8780	8775
Northing	1903	1852	1881	1898	1899	1869
Elevation (m)	57.2	56.9	58.1	58.3	58.9	58.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	9.0	12.1	9.6	11.8	11.6	10.5
Field Wet Density (FWD) t/m ³	2.21	2.19	2.25	2.21	2.17	2.18
Field Moisture Content %	9.5	10.4	13.1	11.8	13.0	11.1
Field Dry Density (FDD) t/m ³	2.02	1.98	1.99	1.98	1.92	1.96
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.19	2.26	2.23	2.21	2.25	2.20
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.0	0.5	0.5
Hilf Density Ratio (%)	101.0	97.0	101.0	100.0	96.5	99.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-7
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4373
Date Sampled: 30/11/2020
Dates Tested: 30/11/2020 - 07/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4373A	G20-4373B	G20-4373C	G20-4373D
Test Number	52	53	54	55
Date Tested	30/11/2020	30/11/2020	30/11/2020	30/11/2020
Time Tested	10:00	10:05	10:10	10:15
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8674	8658	8646	8651
Northing	1947	1950	1949	1942
Elevation (m)	58.1	58.5	59.1	58.2
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12.3	13.4	12.7	13.9
Field Wet Density (FWD) t/m ³	2.18	2.20	2.21	2.17
Field Moisture Content %	9.4	9.0	11.3	9.1
Field Dry Density (FDD) t/m ³	1.99	2.01	1.98	1.99
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.25	2.27	2.24	2.23
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	96.5	96.5	98.5	97.5
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-7
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4373
Date Sampled: 30/11/2020
Dates Tested: 30/11/2020 - 07/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4373E	G20-4373F	G20-4373G	G20-4373H
Test Number	56	57	58	59
Date Tested	30/11/2020	30/11/2020	30/11/2020	30/11/2020
Time Tested	10:20	10:25	10:30	10:35
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8635	8635	8757	8792
Northing	1925	1950	1949	1914
Elevation (m)	58.9	58.0	59.0	58.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	11.9	12.6	13.9	11.4
Field Wet Density (FWD) t/m ³	2.20	2.19	2.20	2.22
Field Moisture Content %	10.6	10.9	10.7	9.6
Field Dry Density (FDD) t/m ³	1.99	1.97	1.98	2.03
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.24	2.23	2.25	2.25
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.5	0.0	0.5	0.5
Hilf Density Ratio (%)	98.0	98.0	98.0	99.0
Compaction Method	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-8
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4398
Date Sampled: 03/12/2020
Dates Tested: 03/12/2020 - 07/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4398A	G20-4398B	G20-4398C	G20-4398D	G20-4398E	G20-4398F
Test Number	60	61	62	63	64	65
Date Tested	03/12/2020	03/12/2020	03/12/2020	03/12/2020	03/12/2020	03/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8575	8582	8577	8583	8575	8572
Northing	1852	1865	1877	1886	1899	1842
Elevation (m)	59.9	60.1	60.2	59.7	58.9	58.2
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12.0	12.6	13.9	14.0	12.9	10.7
Field Wet Density (FWD) t/m ³	2.16	2.20	2.21	2.18	2.14	2.20
Field Moisture Content %	14.3	14.4	14.7	14.4	14.0	13.6
Field Dry Density (FDD) t/m ³	1.89	1.92	1.93	1.91	1.88	1.93
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.24	2.25	2.23	2.21	2.26	2.26
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.5	0.5	0.0	0.0
Hilf Density Ratio (%)	96.5	97.5	99.0	98.5	95.0	97.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-8
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4398
Date Sampled: 03/12/2020
Dates Tested: 03/12/2020 - 07/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4398G	G20-4398H	G20-4398I	G20-4398J	G20-4398K	G20-4398L
Test Number	66	67	68	69	70	71
Date Tested	03/12/2020	03/12/2020	03/12/2020	03/12/2020	03/12/2020	03/12/2020
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8581	8571	8596	8596	8585	8583
Northing	1917	1913	1926	1917	1903	1931
Elevation (m)	58.5	59.9	60.1	60.3	59.7	61.1
Soil Description	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown	Clayey Sand. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	11.3	12.5	19.7	18.8	19.5	19.2
Field Wet Density (FWD) t/m ³	2.22	2.17	2.21	2.18	2.22	2.20
Field Moisture Content %	13.3	14.2	13.2	12.8	13.4	12.1
Field Dry Density (FDD) t/m ³	1.96	1.90	1.95	1.94	1.96	1.96
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.23	2.22	2.22	2.21	2.25	2.25
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.0	0.5	0.5
Hilf Density Ratio (%)	99.5	98.0	99.5	99.0	99.0	98.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-9
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4416
Dates Tested: 07/12/2020 - 10/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4416A	G20-4416B	G20-4416C	G20-4416D	G20-4416E	G20-4416F
Test Number	72	73	74	75	76	77
Date Tested	07/12/2020	07/12/2020	07/12/2020	07/12/2020	07/12/2020	07/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8612	8610	8612	8606	8607	8616
Northing	1924	1916	1903	1899	1890	1888
Elevation (m)	60.5	60.8	60.1	60.5	60.9	59.3
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	11.4	14.7	15.1	9.2	15.2	16.6
Field Wet Density (FWD) t/m ³	2.18	2.21	2.16	2.21	2.17	2.20
Field Moisture Content %	11.0	11.1	10.9	8.9	11.0	11.5
Field Dry Density (FDD) t/m ³	1.96	1.99	1.94	2.03	1.96	1.97
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.11	2.13	2.13	2.12	2.14	2.12
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	2.0	1.0	2.0	2.0	1.5	1.5
Hilf Density Ratio (%)	103.5	103.5	101.5	104.5	101.5	103.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-9
Issue Number: 1
Date Issued: 04/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4416
Dates Tested: 07/12/2020 - 10/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4416G	G20-4416H	G20-4416I	G20-4416J	G20-4416K	G20-4416L
Test Number	78	79	80	81	82	83
Date Tested	07/12/2020	07/12/2020	07/12/2020	07/12/2020	07/12/2020	07/12/2020
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8606	8603	8611	8611	8614	8618
Northing	1883	1876	1874	1864	1856	1842
Elevation (m)	58.9	57.8	56.9	59.2	59.6	60.1
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	13.8	11.2	13.7	14.7	15.2	14.3
Field Wet Density (FWD) t/m ³	2.23	2.20	2.19	2.17	2.19	2.17
Field Moisture Content %	9.5	8.6	9.1	12.3	11.8	12.0
Field Dry Density (FDD) t/m ³	2.04	2.03	2.01	1.93	1.96	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.13	2.09	2.13	2.15	2.18	2.18
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	1.5	2.5	2.0	0.5	0.5	0.5
Hilf Density Ratio (%)	104.5	105.5	103.0	101.0	100.5	99.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-10
Issue Number: 1
Date Issued: 06/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4428
Dates Tested: 09/12/2020 - 10/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4428A	G20-4428B	G20-4428C	G20-4428D	G20-4428E	G20-4428F
Test Number	84	85	86	87	88	89
Date Tested	09/12/2020	09/12/2020	09/12/2020	09/12/2020	09/12/2020	09/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8808	8809	8820	8825	8843	8824
Northing	1839	1825	1848	1840	1865	1878
Elevation (m)	52.0	51.6	52.3	52.7	51.9	51.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	10.1	11.5	14.3	14.6	15.4	17.2
Field Wet Density (FWD) t/m ³	2.19	2.20	2.21	2.17	2.20	2.19
Field Moisture Content %	12.9	12.4	12.1	11.4	12.1	13.1
Field Dry Density (FDD) t/m ³	1.94	1.95	1.97	1.95	1.96	1.93
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.21	2.22	2.21	2.21	2.22	2.20
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	-2.0	-1.5	-1.0	-1.0	-0.5	-0.5
Hilf Density Ratio (%)	99.0	98.5	100.0	98.5	99.0	99.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-10
Issue Number: 1
Date Issued: 06/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4428
Dates Tested: 09/12/2020 - 10/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G20-4428G	G20-4428H	G20-4428I	G20-4428J	G20-4428K	G20-4428L
Test Number	90	91	92	93	94	95
Date Tested	09/12/2020	09/12/2020	09/12/2020	09/12/2020	09/12/2020	09/12/2020
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8819	8823	8837	8809	8833	8792
Northing	1868	1895	1886	1911	1826	1838
Elevation (m)	52.7	53.0	52.7	53.1	52.1	51.8
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	13.1	17.2	14.1	16.5	18.1	17.5
Field Wet Density (FWD) t/m ³	2.22	2.19	2.20	2.21	2.19	2.18
Field Moisture Content %	13.9	12.9	13.1	12.7	11.9	12.2
Field Dry Density (FDD) t/m ³	1.95	1.94	1.94	1.96	1.95	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.24	2.24	2.27	2.22	2.21	2.23
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	-1.5	-0.5	-2.0	-0.5	1.5	1.5
Hilf Density Ratio (%)	99.5	97.5	97.0	99.5	99.0	98.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-11
Issue Number: 1
Date Issued: 06/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4448
Dates Tested: 11/12/2020 - 15/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4448A	G20-4448B	G20-4448C	G20-4448D	G20-4448E
Test Number	96	97	98	99	100
Date Tested	11/12/2020	11/12/2020	11/12/2020	11/12/2020	11/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8758	8747	8734	8720	8759
Northing	1868	1871	1873	1874	1859
Elevation (m)	54.1	53.7	54.0	52.9	53.3
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13	15	13	16	14
Field Wet Density (FWD) t/m ³	2.18	2.21	2.20	2.16	2.18
Field Moisture Content %	13.8	15.0	15.6	11.4	12.1
Field Dry Density (FDD) t/m ³	1.92	1.92	1.90	1.94	1.94
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.25	2.28	2.26	2.24	2.24
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	-0.5	-0.5	0.0	0.0	0.0
Hilf Density Ratio (%)	97.0	96.5	97.0	96.5	97.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-11
Issue Number: 1
Date Issued: 06/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4448
Dates Tested: 11/12/2020 - 15/12/2020
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	G20-4448F	G20-4448G	G20-4448H	G20-4448I	G20-4448J
Test Number	101	102	103	104	105
Date Tested	11/12/2020	11/12/2020	11/12/2020	11/12/2020	11/12/2020
Time Tested	10:25	10:30	10:35	10:40	10:45
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8748	8736	8722	8711	8696
Northing	1864	1863	1865	1866	1869
Elevation (m)	53.1	53.7	54.2	54.7	54.0
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	16	13	12	18	14
Field Wet Density (FWD) t/m ³	2.19	2.20	2.18	2.19	2.18
Field Moisture Content %	10.4	12.9	8.3	12.1	8.6
Field Dry Density (FDD) t/m ³	1.98	1.95	2.01	1.96	2.01
Peak Converted Wet Density t/m ³	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.26	2.28	2.23	2.30	2.24
Moisture Variation (Wv) %	**	**	**	**	**
Adjusted Moisture Variation %	-0.5	0.0	0.5	-0.5	0.0
Hilf Density Ratio (%)	97.0	96.5	97.5	95.0	97.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-12
Issue Number: 1
Date Issued: 12/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4462
Dates Tested: 22/12/2020 - 04/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	G20-4462A	G20-4462B	G20-4462C	G20-4462D	G20-4462E
Test Number	106	107	108	109	110
Date Tested	22/12/2020	22/12/2020	22/12/2020	22/12/2020	22/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8561	8569	8582	8583	8592
Northing	1973	1966	1972	1947	1959
Elevation (m)	60.1	60.4	60.0	59.3	59.3
Soil Description	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	1.99	1.99	2.03	2.06	2.05
Field Moisture Content %	19.7	18.3	19.8	18.6	19.7
Field Dry Density (FDD) t/m ³	1.66	1.68	1.69	1.74	1.71
Peak Converted Wet Density t/m ³	2.06	2.05	2.06	2.04	2.06
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	-1.0	-0.5	-1.0	0.0	-1.5
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	96.5	97.0	98.5	101.0	99.0
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-12
Issue Number: 1
Date Issued: 12/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4462
Dates Tested: 22/12/2020 - 04/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	G20-4462F	G20-4462G	G20-4462H	G20-4462I	G20-4462J
Test Number	111	112	113	114	115
Date Tested	22/12/2020	22/12/2020	22/12/2020	22/12/2020	22/12/2020
Time Tested	10:25	10:30	10:35	10:40	10:45
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8600	8611	8620	8627	8627
Northing	1948	1961	1950	1946	1938
Elevation (m)	59.5	60.3	60.1	58.9	59.1
Soil Description	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.01	2.01	2.00	2.03	2.01
Field Moisture Content %	19.3	21.6	20.7	20.3	20.0
Field Dry Density (FDD) t/m ³	1.68	1.66	1.65	1.69	1.67
Peak Converted Wet Density t/m ³	2.07	2.03	2.04	2.04	2.05
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	-0.5	-0.5	-0.5	-0.5	-0.5
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	97.0	99.5	98.0	99.5	98.0
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-13
Issue Number: 1
Date Issued: 12/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4463
Dates Tested: 22/12/2020 - 06/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	G20-4463A	G20-4463B	G20-4463C	G20-4463D	G20-4463E
Test Number	116	117	118	119	120
Date Tested	22/12/2020	22/12/2020	22/12/2020	22/12/2020	22/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8649	8657	8671	8680	8692
Northing	1857	1858	1854	1856	1856
Elevation (m)	62.0	61.3	60.4	59.1	59.0
Soil Description	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	1.98	2.01	2.03	2.01	2.04
Field Moisture Content %	18.4	19.4	18.0	16.9	18.0
Field Dry Density (FDD) t/m ³	1.68	1.68	1.72	1.72	1.73
Peak Converted Wet Density t/m ³	2.06	2.06	2.06	2.04	2.04
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	-0.5	-0.5	-0.5	0.0	-0.5
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	96.5	97.5	98.5	99.0	100.0
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-13
Issue Number: 1
Date Issued: 12/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4463
Dates Tested: 22/12/2020 - 06/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	G20-4463F	G20-4463G	G20-4463H	G20-4463I	G20-4463J
Test Number	121	122	123	124	125
Date Tested	22/12/2020	22/12/2020	22/12/2020	22/12/2020	22/12/2020
Time Tested	10:25	10:30	10:35	10:40	10:45
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8706	8715	8723	8733	8642
Northing	1859	1855	1856	1855	1856
Elevation (m)	58.3	57.7	57.3	57.5	57.1
Soil Description	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.06	1.99	1.98	2.04	2.00
Field Moisture Content %	17.7	17.7	19.7	19.4	17.7
Field Dry Density (FDD) t/m ³	1.75	1.69	1.65	1.71	1.70
Peak Converted Wet Density t/m ³	2.04	2.05	2.03	2.07	2.03
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	-1.0	-0.5	-0.5	-1.0	0.0
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	100.5	97.0	97.0	98.5	98.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-14
Issue Number: 1
Date Issued: 12/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4465
Dates Tested: 23/12/2020 - 08/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	G20-4465A	G20-4465B	G20-4465C	G20-4465D	G20-4465E
Test Number	126	127	128	129	130
Date Tested	23/12/2020	23/12/2020	23/12/2020	23/12/2020	23/12/2020
Time Tested	10:00	10:05	10:10	10:15	10:20
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8646	8658	8675	8690	8705
Northing	1843	1844	1847	1844	1845
Elevation (m)	62.9	62.1	61.9	61.5	61.4
Soil Description	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.04	2.02	1.99	2.02	2.04
Field Moisture Content %	21.2	19.5	20.1	19.8	20.2
Field Dry Density (FDD) t/m ³	1.69	1.69	1.66	1.69	1.69
Peak Converted Wet Density t/m ³	2.03	2.05	2.05	2.04	2.03
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	-1.0	-0.5	-1.0	-0.5	-0.5
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	101.0	98.5	97.0	99.0	100.5
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-14
Issue Number: 1
Date Issued: 12/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4465
Dates Tested: 23/12/2020 - 08/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G20-4465F	G20-4465G	G20-4465H	G20-4465I	G20-4465J
Test Number	131	132	133	134	135
Date Tested	23/12/2020	23/12/2020	23/12/2020	23/12/2020	23/12/2020
Time Tested	10:25	10:30	10:35	10:40	10:45
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8719	8649	8668	8678	8687
Northing	1844	1873	1883	1878	1875
Elevation (m)	61.1	61.2	60.7	60.5	60.1
Soil Description	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown	Gravelly Sandy Clay. Orange-Brown
Test Depth (mm)	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0
Field Wet Density (FWD) t/m ³	1.98	2.00	2.04	2.05	2.02
Field Moisture Content %	20.1	20.4	20.2	18.7	19.7
Field Dry Density (FDD) t/m ³	1.65	1.66	1.70	1.73	1.69
Peak Converted Wet Density t/m ³	2.01	2.07	2.04	2.05	2.02
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Variation (Wv) %	-0.5	-1.5	-0.5	-1.0	-0.5
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	99.0	96.5	100.0	100.0	100.0
Compaction Method	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-15
Issue Number: 1
Date Issued: 28/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4498
Dates Tested: 11/01/2021 - 13/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4498A	G21-4498B	G21-4498C	G21-4498D	G21-4498E	G21-4498F
Test Number	136	137	138	139	140	141
Date Tested	11/01/2021	11/01/2021	11/01/2021	11/01/2021	11/01/2021	11/01/2021
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8805	8805	8810	8786	8782	8838
Northing	1883	1872	1863	1870	1854	1852
Elevation (m)	55.9	56.1	56.3	56.0	56.5	58.2
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	13	10	13	14	10	7
Field Wet Density (FWD) t/m ³	2.20	2.21	2.19	2.20	2.17	2.18
Field Moisture Content %	13.6	10.8	11.0	11.7	11.9	13.2
Field Dry Density (FDD) t/m ³	1.94	1.99	1.97	1.97	1.94	1.93
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.17	2.10	2.11	2.14	2.11	2.14
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	-1.0	0.5	1.5	0.0	0.5	-0.5
Hilf Density Ratio (%)	101.5	105.0	103.5	102.5	102.5	102.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-15
Issue Number: 1
Date Issued: 28/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4498
Dates Tested: 11/01/2021 - 13/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4498G	G21-4498H	G21-4498I	G21-4498J	G21-4498K	G21-4498L
Test Number	142	143	144	145	146	147
Date Tested	11/01/2021	11/01/2021	11/01/2021	11/01/2021	11/01/2021	11/01/2021
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8842	8844	8782	8772	8763	8738
Northing	1842	1832	1929	1940	1943	1961
Elevation (m)	58.1	58.9	60.3	60.9	61.0	60.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	13	9	16	15	10	11
Field Wet Density (FWD) t/m ³	2.20	2.18	2.21	2.19	2.21	2.18
Field Moisture Content %	14.0	12.7	9.7	13.7	13.2	12.8
Field Dry Density (FDD) t/m ³	1.93	1.93	2.01	1.93	1.96	1.93
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.17	2.15	2.13	2.13	2.13	2.13
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	-1.0	-1.0	0.0	0.0	0.0	-0.5
Hilf Density Ratio (%)	101.0	101.5	104.0	102.5	104.0	102.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-16
Issue Number: 1
Date Issued: 28/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4500
Dates Tested: 12/01/2021 - 20/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-4500A	G21-4500B	G21-4500C	G21-4500D
Test Number	148	149	150	151
Date Tested	12/01/2021	12/01/2021	12/01/2021	12/01/2021
Time Tested	10:00	10:05	10:10	10:15
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8863	8857	8866	8875
Northing	1834	1857	1878	1820
Elevation (m)	55.2	55.9	55.4	54.9
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12	12	12	12
Field Wet Density (FWD) t/m ³	2.16	2.19	2.21	2.19
Field Moisture Content %	18.4	13.0	10.5	15.2
Field Dry Density (FDD) t/m ³	1.83	1.94	2.00	1.90
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.07	2.21	2.22	2.20
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	-0.5	0.0	0.0	0.0
Hilf Density Ratio (%)	104.5	99.0	99.5	99.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-16
Issue Number: 1
Date Issued: 28/01/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4500
Dates Tested: 12/01/2021 - 20/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-4500E	G21-4500F	G21-4500G	G21-4500H
Test Number	152	153	154	155
Date Tested	12/01/2021	12/01/2021	12/01/2021	12/01/2021
Time Tested	10:20	10:25	10:30	10:35
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8888	8859	8848	8854
Northing	1817	1822	1822	1850
Elevation (m)	55.8	56.0	55.7	55.9
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	13	14	15	14
Field Wet Density (FWD) t/m ³	2.20	2.15	2.17	2.16
Field Moisture Content %	9.7	10.5	10.1	11.9
Field Dry Density (FDD) t/m ³	2.00	1.95	1.98	1.93
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.25	2.22	2.20	2.17
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	98.0	97.0	99.0	99.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-17
Issue Number: 2 - This version supersedes all previous issues
Reissue Reason: Removal of Samples
Date Issued: 02/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4541
Dates Tested: 18/01/2021 - 21/01/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4541C	G21-4541D	G21-4541E	G21-4541F	G21-4541G	G21-4541H
Test Number	158	159	160	161	162	163
Date Tested	18/01/2021	18/01/2021	18/01/2021	18/01/2021	18/01/2021	18/01/2021
Time Tested	10:10	10:15	10:20	10:25	10:30	10:35
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8822	8827	8803	8826	8856	8848
Northing	1925	1912	1813	1814	1895	1913
Elevation (m)	57.9	58.0	58.2	56.8	56.9	58.2
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	9	11	11	8	10	14
Field Wet Density (FWD) t/m ³	2.10	2.12	2.10	2.13	2.11	2.11
Field Moisture Content %	7.3	10.2	7.3	8.4	6.2	9.2
Field Dry Density (FDD) t/m ³	1.96	1.93	1.96	1.96	1.99	1.93
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.17	2.17	2.20	2.17	2.13	2.18
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.5	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	97.0	98.0	95.5	98.0	99.0	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-18
Issue Number: 1
Date Issued: 05/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4562
Dates Tested: 21/01/2021 - 01/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-4562A	G21-4562B	G21-4562C	G21-4562D	G21-4562E	G21-4562F
Test Number	164	165	166	167	168	169
Date Tested	21/01/2021	21/01/2021	21/01/2021	21/01/2021	21/01/2021	21/01/2021
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8763	8752	8735	8608	8605	8605
Northing	1849	1841	1846	1841	1853	1865
Elevation (m)	56.5	56.9	57.0	57.1	57.5	63.0
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12	13	10	14	9	12
Field Wet Density (FWD) t/m ³	2.05	2.08	2.09	2.07	2.10	2.09
Field Moisture Content %	9.3	10.5	9.8	9.7	10.2	10.1
Field Dry Density (FDD) t/m ³	1.87	1.88	1.91	1.89	1.91	1.90
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.10	2.12	2.08	2.13	2.14	2.13
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.0	0.5	0.0	0.0	0.0
Hilf Density Ratio (%)	97.5	98.0	100.5	97.0	98.5	98.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-18
Issue Number: 1
Date Issued: 05/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4562
Dates Tested: 21/01/2021 - 01/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4562G	G21-4562H	G21-4562I	G21-4562J	G21-4562K	G21-4562L
Test Number	170	171	172	173	174	175
Date Tested	21/01/2021	21/01/2021	21/01/2021	21/01/2021	21/01/2021	21/01/2021
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8618	8630	8627	8631	8629	8628
Northing	1829	1847	1863	1877	1895	1916
Elevation (m)	62.9	63.3	63.0	64.1	63.8	64.0
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12	14	11	12	11	14
Field Wet Density (FWD) t/m ³	2.08	2.10	2.10	2.06	2.08	2.07
Field Moisture Content %	9.7	9.9	10.5	10.8	10.7	10.0
Field Dry Density (FDD) t/m ³	1.89	1.91	1.90	1.86	1.88	1.88
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.11	2.12	2.12	2.16	2.12	2.12
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.5	0.5	0.0	0.5	0.0
Hilf Density Ratio (%)	98.5	99.0	98.5	95.5	98.0	97.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-19
Issue Number: 1
Date Issued: 05/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4569
Dates Tested: 22/01/2021 - 04/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4569A	G21-4569B	G21-4569C	G21-4569D	G21-4569E	G21-4569F
Test Number	176	177	178	179	180	181
Date Tested	22/01/2021	22/01/2021	22/01/2021	22/01/2021	22/01/2021	22/01/2021
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8665	8644	8659	8675	8688	8674
Northing	1874	1928	1918	1937	1948	1966
Elevation (m)	60.1	60.2	60.5	59.9	60.6	60.1
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	11	12	15	10	9	12
Field Wet Density (FWD) t/m ³	2.10	2.11	2.12	2.10	2.10	2.11
Field Moisture Content %	11.1	11.7	12.1	11.6	11.7	11.2
Field Dry Density (FDD) t/m ³	1.89	1.89	1.90	1.89	1.88	1.90
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.15	2.17	2.15	2.19	2.16	2.16
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.0	0.0	0.0	0.0	0.5
Hilf Density Ratio (%)	98.0	97.5	99.0	96.5	97.0	97.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-19
Issue Number: 1
Date Issued: 05/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4569
Dates Tested: 22/01/2021 - 04/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4569G	G21-4569H	G21-4569I	G21-4569J	G21-4569K	G21-4569L
Test Number	182	183	184	185	186	187
Date Tested	22/01/2021	22/01/2021	22/01/2021	22/01/2021	22/01/2021	22/01/2021
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8656	8701	8711	8725	8759	8765
Northing	1968	1951	1946	1944	1934	1917
Elevation (m)	61.1	60.7	60.3	60.8	61.0	61.3
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	12	11	14	10	12	10
Field Wet Density (FWD) t/m ³	2.12	2.11	2.10	2.10	2.11	2.12
Field Moisture Content %	10.3	11.8	11.0	16.9	12.7	10.5
Field Dry Density (FDD) t/m ³	1.92	1.89	1.89	1.80	1.88	1.92
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.20	2.19	2.19	2.16	2.14	2.20
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.5	0.0	0.5	0.0
Hilf Density Ratio (%)	96.0	96.5	96.0	97.0	99.0	96.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-20
Issue Number: 1
Date Issued: 10/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4588
Dates Tested: 27/01/2021 - 09/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4588A	G21-4588B	G21-4588C	G21-4588D	G21-4588E	G21-4588F
Test Number	188	189	190	191	192	193
Date Tested	27/01/2021	27/01/2021	27/01/2021	27/01/2021	27/01/2021	27/01/2021
Time Tested	10:00	10:05	10:10	10:15	10:20	10:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8705	8700	8703	8714	8693	8721
Northing	1886	1901	1915	1929	1923	1924
Elevation (m)	59.5	59.9	59.1	58.9	59.8	59.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	11	8	10	12	10	13
Field Wet Density (FWD) t/m ³	2.16	2.13	2.17	2.18	2.15	2.12
Field Moisture Content %	9.1	8.1	9.0	10.0	11.2	11.2
Field Dry Density (FDD) t/m ³	1.98	1.97	1.99	1.98	1.93	1.91
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.21	2.17	2.20	2.20	2.19	2.19
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	-0.5	0.0	0.5	0.0	0.5	0.0
Hilf Density Ratio (%)	97.5	98.5	98.5	99.0	98.5	97.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-20
Issue Number: 1
Date Issued: 10/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4588
Dates Tested: 27/01/2021 - 09/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
Senior Technician
NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4588G	G21-4588H	G21-4588I	G21-4588J	G21-4588K	G21-4588L
Test Number	194	195	196	197	198	199
Date Tested	27/01/2021	27/01/2021	27/01/2021	27/01/2021	27/01/2021	27/01/2021
Time Tested	10:30	10:35	10:40	10:45	10:50	10:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8737	8670	8651	8663	8681	8724
Northing	1931	1903	1907	1888	1897	1902
Elevation (m)	59.2	60.0	59.4	59.0	59.7	58.8
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	9	12	13	12	11	9
Field Wet Density (FWD) t/m ³	2.11	2.16	2.17	2.17	2.16	2.15
Field Moisture Content %	10.8	10.0	10.1	7.3	9.2	7.4
Field Dry Density (FDD) t/m ³	1.91	1.96	1.97	2.02	1.98	2.00
Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.17	2.20	2.22	2.21	2.20	2.20
Moisture Variation (Wv) %	**	**	**	**	**	**
Adjusted Moisture Variation %	0.5	0.0	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	97.5	98.0	97.5	98.0	98.0	98.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-21
Issue Number: 1
Date Issued: 10/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4604
Dates Tested: 28/01/2021 - 04/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1				
Sample Number	G21-4604A	G21-4604B	G21-4604C	G21-4604D
Test Number	200	201	202	203
Date Tested	28/01/2021	28/01/2021	28/01/2021	28/01/2021
Time Tested	10:00	10:10	10:20	10:30
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8533	8535	8536	8537
Northing	1833	1845	1859	1873
Elevation (m)	66.5	67.2	67.8	68.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	13	12	11	12
Field Wet Density (FWD) t/m ³	2.26	2.28	2.24	2.27
Field Moisture Content %	11.7	11.4	11.6	10.1
Field Dry Density (FDD) t/m ³	2.02	2.05	2.01	2.06
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.31	2.29	2.32	2.30
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	98.0	99.5	96.5	98.5
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-22
Issue Number: 1
Date Issued: 15/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4625
Dates Tested: 01/02/2021 - 05/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-4625A	G21-4625B	G21-4625C	G21-4625D
Test Number	204	205	206	207
Date Tested	01/02/2021	01/02/2021	01/02/2021	01/02/2021
Time Tested	10:00	10:05	10:10	10:15
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8581	8582	8584	8573
Northing	1830	1841	1853	1864
Elevation (m)	67.1	67.3	67.5	67.2
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	10	12	12	10
Field Wet Density (FWD) t/m ³	2.23	2.26	2.22	2.24
Field Moisture Content %	11.1	12.4	10.1	11.2
Field Dry Density (FDD) t/m ³	2.01	2.01	2.02	2.02
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.27	2.27	2.30	2.29
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.5	0.0
Hilf Density Ratio (%)	98.5	99.5	96.5	98.0
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-22
Issue Number: 1
Date Issued: 15/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4625
Dates Tested: 01/02/2021 - 05/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	G21-4625E	G21-4625F	G21-4625G	G21-4625H
Test Number	208	209	210	211
Date Tested	01/02/2021	01/02/2021	01/02/2021	01/02/2021
Time Tested	10:20	10:25	10:30	10:35
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8587	8588	8583	8628
Northing	1877	1890	1898	1909
Elevation (m)	67.6	67.7	67.5	64.0
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150
Sieve used to determine oversize (mm)	37.5	37.5	37.5	37.5
Percentage of Wet Oversize (%)	11	14	9	11
Field Wet Density (FWD) t/m ³	2.26	2.24	2.28	2.25
Field Moisture Content %	11.0	11.4	11.0	12.7
Field Dry Density (FDD) t/m ³	2.04	2.01	2.05	2.00
Peak Converted Wet Density t/m ³	**	**	**	**
Adjusted Peak Converted Wet Density t/m ³	2.29	2.31	2.29	2.29
Moisture Variation (Wv) %	**	**	**	**
Adjusted Moisture Variation %	0.0	0.0	0.0	0.0
Hilf Density Ratio (%)	98.5	96.5	99.0	98.0
Compaction Method	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-23
Issue Number: 1
Date Issued: 15/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4666
Dates Tested: 11/02/2021 - 12/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4666A	G21-4666B	G21-4666C	G21-4666D	G21-4666E	G21-4666F
Test Number	212	213	214	215	216	217
Date Tested	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021
Time Tested	08:00	08:05	08:10	08:15	08:20	08:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8532	8537	8574	8643	8675	8687
Northing	1884	1898	1830	1889	1872	1869
Elevation (m)	69.2	69.5	66.7	64.7	63.0	62.8
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.00	2.00	2.01	2.00	2.02	2.01
Field Moisture Content %	11.1	10.8	10.8	10.9	11.1	11.3
Field Dry Density (FDD) t/m ³	1.80	1.80	1.82	1.80	1.82	1.80
Peak Converted Wet Density t/m ³	2.04	2.07	2.09	2.07	2.10	2.10
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Moisture Variation (Wv) %	0.5	0.0	0.0	0.0	0.5	0.0
Adjusted Moisture Variation %	**	**	**	**	**	**
Hilf Density Ratio (%)	98.0	96.5	96.5	96.5	96.0	95.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-23
Issue Number: 1
Date Issued: 15/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4666
Dates Tested: 11/02/2021 - 12/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4666G	G21-4666H	G21-4666I	G21-4666J	G21-4666K	G21-4666L
Test Number	218	219	220	221	222	223
Date Tested	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021
Time Tested	08:30	08:35	08:40	08:45	08:50	08:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8703	8749	8766	8811	8835	8825
Northing	1875	1856	1843	1813	1811	1826
Elevation (m)	61.4	57.4	56.0	55.4	55.7	56.0
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.02	2.04	2.03	2.05	2.01	2.00
Field Moisture Content %	11.3	11.7	11.6	11.1	11.6	11.2
Field Dry Density (FDD) t/m ³	1.81	1.83	1.82	1.84	1.80	1.80
Peak Converted Wet Density t/m ³	2.09	2.11	2.09	2.09	2.10	2.08
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Moisture Variation (Wv) %	0.5	0.0	0.0	1.0	-1.0	0.5
Adjusted Moisture Variation %	**	**	**	**	**	**
Hilf Density Ratio (%)	96.5	97.0	97.0	98.0	95.5	96.0
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-23
Issue Number: 1
Date Issued: 15/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4666
Dates Tested: 11/02/2021 - 12/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD \pm 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4666M	G21-4666N	G21-4666O	G21-4666P	G21-4666Q	G21-4666R
Test Number	224	225	226	227	228	229
Date Tested	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021
Time Tested	09:00	09:05	09:10	09:15	09:20	09:25
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8808	8695	8828	8832	8833	8843
Northing	1852	1825	1836	1882	1898	1899
Elevation (m)	55.8	59.4	59.6	59.0	59.5	59.8
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.03	2.02	2.01	2.00	2.01	2.04
Field Moisture Content %	11.4	11.0	12.1	11.7	12.6	12.1
Field Dry Density (FDD) t/m ³	1.82	1.82	1.80	1.79	1.79	1.82
Peak Converted Wet Density t/m ³	2.09	2.09	2.07	2.06	2.05	2.07
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Moisture Variation (Wv) %	0.0	0.0	1.5	1.5	1.5	1.5
Adjusted Moisture Variation %	**	**	**	**	**	**
Hilf Density Ratio (%)	97.0	96.5	97.5	97.0	98.5	98.5
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Material Test Report

Report Number: GL20/129-23
Issue Number: 1
Date Issued: 15/02/2021
Client: SHADFORTH'S CIVIL PTY LTD
 99 SANDALWOOD LANE, FOREST GLEN QLD 4556
Contact: David, Callum
Project Number: GL20/129
Project Name: Everleigh Estate Precinct 12.1 - Level 1 Earthworks
Project Location: Teviot Rd, Greenbank
Work Request: 4666
Dates Tested: 11/02/2021 - 12/02/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: 95% STD ± 2% OMC
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Accredited for compliance with ISO/IEC 17025 - Testing

Approved Signatory: Nick Dobson
 Senior Technician
 NATA Accredited Laboratory Number: 1169

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1						
Sample Number	G21-4666S	G21-4666T	G21-4666U	G21-4666V	G21-4666W	G21-4666X
Test Number	230	231	232	233	234	235
Date Tested	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021	11/02/2021
Time Tested	09:30	09:35	09:40	09:45	09:50	09:55
Test Request #/Location	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL	GENERAL FILL
Easting	8811	8781	8795	8780	8799	8667
Northing	1895	1889	1896	1915	1850	1844
Elevation (m)	59.0	59.5	60.0	60.0	60.2	59.5
Soil Description	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown	Gravelly Sandy Clay. Brown
Test Depth (mm)	150	150	150	150	150	150
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0	0	0	0	0	0
Field Wet Density (FWD) t/m ³	2.02	2.01	2.04	2.02	2.06	2.04
Field Moisture Content %	10.9	11.2	10.7	10.9	11.0	10.7
Field Dry Density (FDD) t/m ³	1.82	1.81	1.85	1.82	1.86	**
Peak Converted Wet Density t/m ³	2.06	2.04	2.05	2.06	2.06	2.08
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**	**
Moisture Variation (Wv) %	1.5	1.5	1.5	1.5	1.5	1.5
Adjusted Moisture Variation %	**	**	**	**	**	**
Hilf Density Ratio (%)	98.0	98.5	99.5	98.0	100.0	**
Compaction Method	Standard	Standard	Standard	Standard	Standard	Standard
Report Remarks	**	**	**	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC
 Negative values = test is wet of OMC

Appendix C
(DL18/096 – Partial Bulk
Earthworks Filling Operations
Report, dated 10th September
2018)

Brisbane Office
 Job No: DL18/096
 Ref No: 13748
 Author: L. McDowall

10th September 2018

Shadforths Civil Pty Ltd
 99 Sandalwood Lane
 Forest Glen Qld 4556

ATTENTION: MR DAVID BUDGEN
 Email: david.budgen@shadcivil.com.au
 Cc: leo.copelin@shadcivil.com.au

Dear Sir,

**RE: LEVEL ONE COMPLIANCE REPORT FOR
 BULK EARTHWORKS FILLING OPERATIONS
 EVERLEIGH PRECINCT 1.1
 TEVIOT ROAD, GREENBANK**

Table of Contents

1.0	INTRODUCTION	2
1.1	General.....	2
1.2	Previous Earthworks	3
1.3	The Project	3
2.0	THE BRIEF	3
3.0	METHODOLOGY	4
3.1	Stripped Surface Assessment.....	4
3.2	Filling Operations	5
4.0	STATEMENT OF COMPLIANCE	8
5.0	EXCLUSIONS	8
6.0	LIMITATIONS	8
	ATTACHMENTS:	
	Appendix A – Site Plan Showing Test Locations	
	Appendix B – Laboratory Test Results Reports	
	Brochure – “Important Information About Your Geotechnical Report”	



1.0 INTRODUCTION

1.1 General

This report presents results of Level One Earthworks Inspections and associated Compaction Compliance testing carried out on Earthworks Fill constructed to form the following at the Everleigh Precinct 1.1 Development at Greenbank Road, Greenbank (The Site): -

- Residential Lots
- Embankments below Subgrade and

The work was commissioned by Mr. David Budgen representing Shadforths Civil Pty Ltd (The Client), using Purchase Order 2161 - 11002.

Earthworks operations were constructed by Bachmann's Plant Hire Pty Ltd and The Client.

Earthworks filling operations were carried out intermittently between 19th April 2018 and 29th August 2018.

Picture 1: Aerial View of the Site (Image Source: Nearmap.com 17th August 2018).



1.2 Previous Earthworks

Previous earthworks filling was present at The Site. The existing fill was localised and associated with Dam Walls that were located at the North Eastern and Southern portion of The Site.

The dams were dewatered, the dam walls were demolished, and the associated fill was sorted to remove any contaminates and unsuitable materials and then re-used as structural fill.

1.3 The Project

The purpose for filling at The Site is to construct a Residential Subdivision which includes new pavements, residential building platforms, WSUD and associated underground services.

Premise Engineering Pty Ltd, Earthworks Layout Plans, Job Code MIR001-01, Drawing Numbers C202 – C207, Revision F, dated 27th June 2018, indicates the extents and thickness of fill to be constructed at The Site.

This plan is a reasonable representation of the fill covered by this report with the following exceptions:

- Fill was constructed on the following:
 - Lot 1124 to Lot 1137
 - Lot 1244 to Lot 1159
 - Lot 1264 to Lot 1276
 - Lot 1290 to Lot 1294
 - Lot 1315 to Lot 1318
- Rock was exposed at the design cut levels on these lots.
- The rock was excavated to a depth of approximately 0.5m below the design earthworks levels and replaced by filling.
- Filling operations were conducted outside the stage boundary in the plan sealing exclusion zone to the North and South of Precinct 1.1. These areas boarder Future Precinct 1.3 to the south and Future precinct 9 to the north.

The actual thickness of fill on an individual Lot can be obtained from the Developer as a Lot Disclosure Plan.

The Site is located within the Everleigh Precinct Subdivision Development and is bounded by future Residential Developments to the North, East, South and West.

2.0 THE BRIEF

The Brief from the Client was limited to:

- Level One Inspection and Testing of the placement and compaction of fill materials in accordance with AS3798 2007 – “Guidelines on Earthworks for Commercial and Residential Developments”,
- Relative Density Control Testing in accordance with AS1289 – Testing of Soils for Engineering Purposes and at frequencies required in AS3798 Table 8.1.
- Logan City Council Project Specifications
- Notes on Premise Earthworks Drawings and Quality Assurance Documentation.
- Recommendations detailed in Morrison Geotechnic Report No. 13382 dated 7th June 2018.

3.0 METHODOLOGY

Earthworks Inspection and Testing was carried out on the stripped and exposed ground surfaces and during the placement and compaction of fill materials.

Field and laboratory testing included a walk over assessments of the existing ground conditions, observation of filling and compaction activities and field density testing using a nuclear soil moisture density gauge and Hilf compactions. All work was carried out in accordance with AS 3798 (Guidelines on Earthworks for Commercial and Residential Developments) and AS1289 (Testing of Soils for Engineering Purposes).

3.1 Stripped Surface Assessment

The fill areas at The Site were observed to be stripped and cleared of visible organic matter, deleterious, loose and unsuitable materials to depths exposing suitable natural ground. Existing dams were dewatered, and sediments and water affected soils were removed to depths exposing competent natural soils

Materials exposed after stripping and clearing the site which formed the fill foundation can be broadly summarised as:

- Natural - Silty Sand (SM) – At least dense, fine to medium grained sands, traces of low plasticity clay, grey – brown and moist.
- Natural – Sandy Clay (CI) – Very stiff, medium plasticity, fine to medium grained sand, pale brown mottled orange and moist.
- Natural – Sandstone Rock (XW-DW) – Extremely weathered to distinctly weathered, medium strength, orange – yellow mottled brown – grey.

Following the stripped surface assessment of the fill areas, the fill foundation was approved for filling using the following process:

- Walk over assessments confirming that the competent ground was exposed.
- Proof roll testing using large sized truck carrying out multiple passes confirming no movement of the exposed natural foundation.

Picture 2: View of the Stripped Surface Prior to Filling Operations



Picture 3: View of the Stripped Surface Prior to Filling Operations



3.2 Filling Operations

Fill materials were sourced from onsite cuts, road box excavations, trench excavations and borrow areas to the North of The Site.

Materials used as fill can be broadly summarized as: -

- Clayey Sand (SC), fine to coarse sand, medium plasticity fines, with fine to course gravel, yellow brown and moist.
- Gravelly Sandy Clay (CI), medium plasticity fines, fine to coarse sand, fine to course gravel, yellow - brown and moist.

Placement and compaction of the fill materials was carried out using the following plant:

- D6, D8, D10 and D11 Dozers
- Excavators
- Pad foot Rollers
- Scrapers
- Articulated Water Trucks
- Body Trucks
- Skid Steer Loader
- Graders
- Articulated Dump Trucks
- 825 and 815 Compactors

The fill materials were moisture conditioned at the fill source and during placement to moisture contents suitable for compaction. Deleterious materials such as organics, sticks, roots and over size particles were sorted and removed during placement or were rejected for use. Occasional oversize particles

including cobbles and boulders may be present in the deeper fill profile, however are not considered to affect the fill as a mass.

Placement of the fill materials was carried out in layers appropriate for the above plant and compacted using the above plant carrying out multiple passes.

Our representative observed the filling process as described above and was assessed to be consistent for the entire thickness of fill.

Field density tests and laboratory compactions were carried out on the fill materials in accordance with Table 5.1 and 8.1 of AS3798 2007 (Guidelines on Earthworks for Commercial and Residential Developments) and tested to AS1289 test methods (Testing of Soils for Engineering Purposes).

Testing achieved the required specification of 95% of the Hilf Density for fill supporting pavements and residential lots. .

Fill was required to be placed at moisture contents within the tolerance of -2% to +3% of the Optimum Moisture Content.

Due to construction complexities, a delay between placement of the fill and testing of the fill occurred. This resulted in some loss of moisture from the surficial layer of the fill due to natural drying processes. Based on the visual and tactile assessments of the fill material by the Morrison Geotechnic site representative at the time of placement, the fill was placed at moisture contents within the Moisture Content specification criteria.

Fill placed and compacted at measured density ratios less than 95% were tyned, moisture conditioned and re-compacted until the required specification was achieved. Retesting was carried out using Random Stratified Location methods.

The Location of the field density tests are shown on the Site Plan contained in Appendix A. These test locations and levels were not obtained by survey and therefore should only be considered as approximate.

Picture 4: View of the Site During Construction



Picture 5: View of the Site During Construction



Picture 6: View of the Site During Construction



4.0 STATEMENT OF COMPLIANCE

Our representatives observed the relevant earthworks operations including the stripped surface, fill placement and compaction operations and carried out field density tests and laboratory compaction tests in accordance with the required standard (AS3798, AS1289) and Specification. Testing achieved the required specification of 95% Standard at the test locations.

It is confirmed that Level One Inspection and Testing has been carried out on the earthworks fill to form the residential Lots and embankments below subgrade. Based on the observations made by our Geotechnicians and the results of the field and laboratory tests, the placed and compacted fill at the above project has, as far as we have been able to assess, been constructed in general accordance with the intent of AS3798 and the Specifications.

The fill can be deemed to be “controlled” in accordance with AS2870.

5.0 EXCLUSIONS

This statement does not include any top soil, which may be placed for use as dressing, trench backfill or any other subsequent earthworks after 29th August 2018.

Material placed in the Park Area of Precinct 1.1 was not placed under Level One Conditions as detailed in AS3798 and is excluded from this report.

Assessments of material quality such as soaked CBR and site classifications are excluded from this commission.

Our on-site attendance specifically excludes assessments of fill material quality and engineering properties that are outside the requirements of AS3798 – 2007.

Footings and ground slabs for any structures constructed over natural soils or controlled fill should be designed to accommodate the characteristic ground surface movements and settlement potential.

Assessments of these design parameters are beyond the scope of this Report.

6.0 LIMITATIONS

This Report has been prepared by Morrison Geotechnic Pty Ltd (**Morrison Geotechnic**), and may include contributions from Morrison Geotechnic’s officers and employees, sub-contractors, sub-consultants or agents (**Contributors**).

This Report is for the sole benefit and use of Shadforths Civil Pty Ltd (**Client**), its designers, clients and relevant statutory authorities for the sole purpose of providing geotechnical advice and recommendations in respect of the Everleigh Precinct 1.1 Subdivision Development, Teviot Road, Greenbank (**Project**). The Report is only intended to address those issues expressly described in the Brief/ Work Instructions in this Report.

This Report should not be used or relied upon for any other purpose without Morrison Geotechnic’s prior written consent. Morrison Geotechnic and the Contributors do not accept any responsibility or liability in any way whatsoever for the use or reliance of this Report by anyone other than CCA Winslow (**Client**), its designers, its clients and relevant statutory authorities or by anyone else for any purpose other than that for which it has been prepared.

Except with Morrison Geotechnic’s prior written consent, this Report may not be:

- (a) released to any other party, whether in whole or in part (other than to the Client’s officers, employees, advisers, designers, clients and relevant statutory authorities);
- (b) used or relied upon by any other party.

Morrison Geotechnic and the Contributors, do not accept any liability or responsibility whatsoever for, or in respect of, any use or reliance upon this Report by any other party. Morrison Geotechnic is not obliged to enter into discussions with any third party in respect of this Report.

The information (including technical information and information obtained through discussions) on which this report is based has been provided by the Client and third parties. Morrison Geotechnic and the Contributors:

- (a) have relied upon and presumed the accuracy of this information;
- (b) have not verified the accuracy or reliability of this information (other than as expressly stated in this Report);
- (c) have not made any independent investigations or enquiries in respect of those matters of which it has no actual knowledge at the time of giving this Report to the Client; and
- (d) make no warranty or guarantee, expressed or implied, as to the accuracy or reliability of this information.

Morrison Geotechnic and the Contributors do not accept responsibility or liability for any incorrect assumptions related to this Report. For the avoidance of doubt, this Report:


- (a) is not an environmental, contamination or hazardous materials assessment; may be invalid, incomplete or inaccurate (including errors in the scope of work, investigation methodology, observations, opinions and advice) where the information provided to Morrison Geotechnic was invalid, incomplete or inaccurate;
- (b) is limited to observations of those parts of the site described in Section 1.0.

No warranty or guarantee, whether express or implied, is made in respect of the geotechnical data, information, advice, opinions and recommendations present in this Report.

If further information becomes available, or additional assumptions need to be made, Morrison Geotechnic reserves its right to amend this Report.

If you have any queries regarding the above, please contact our Brisbane office.

Yours faithfully



LIAM McDOWALL


For and on behalf of
MORRISON GEOTECHNIC PTY LIMITED

ATTACHMENTS:

Appendix A – Site Plans Showing Test Locations
Appendix B – Laboratory Test Results Reports
Brochure – “Important Information About Your Geotechnical Report”

APPENDIX A

**Site Plan
Test Locations**

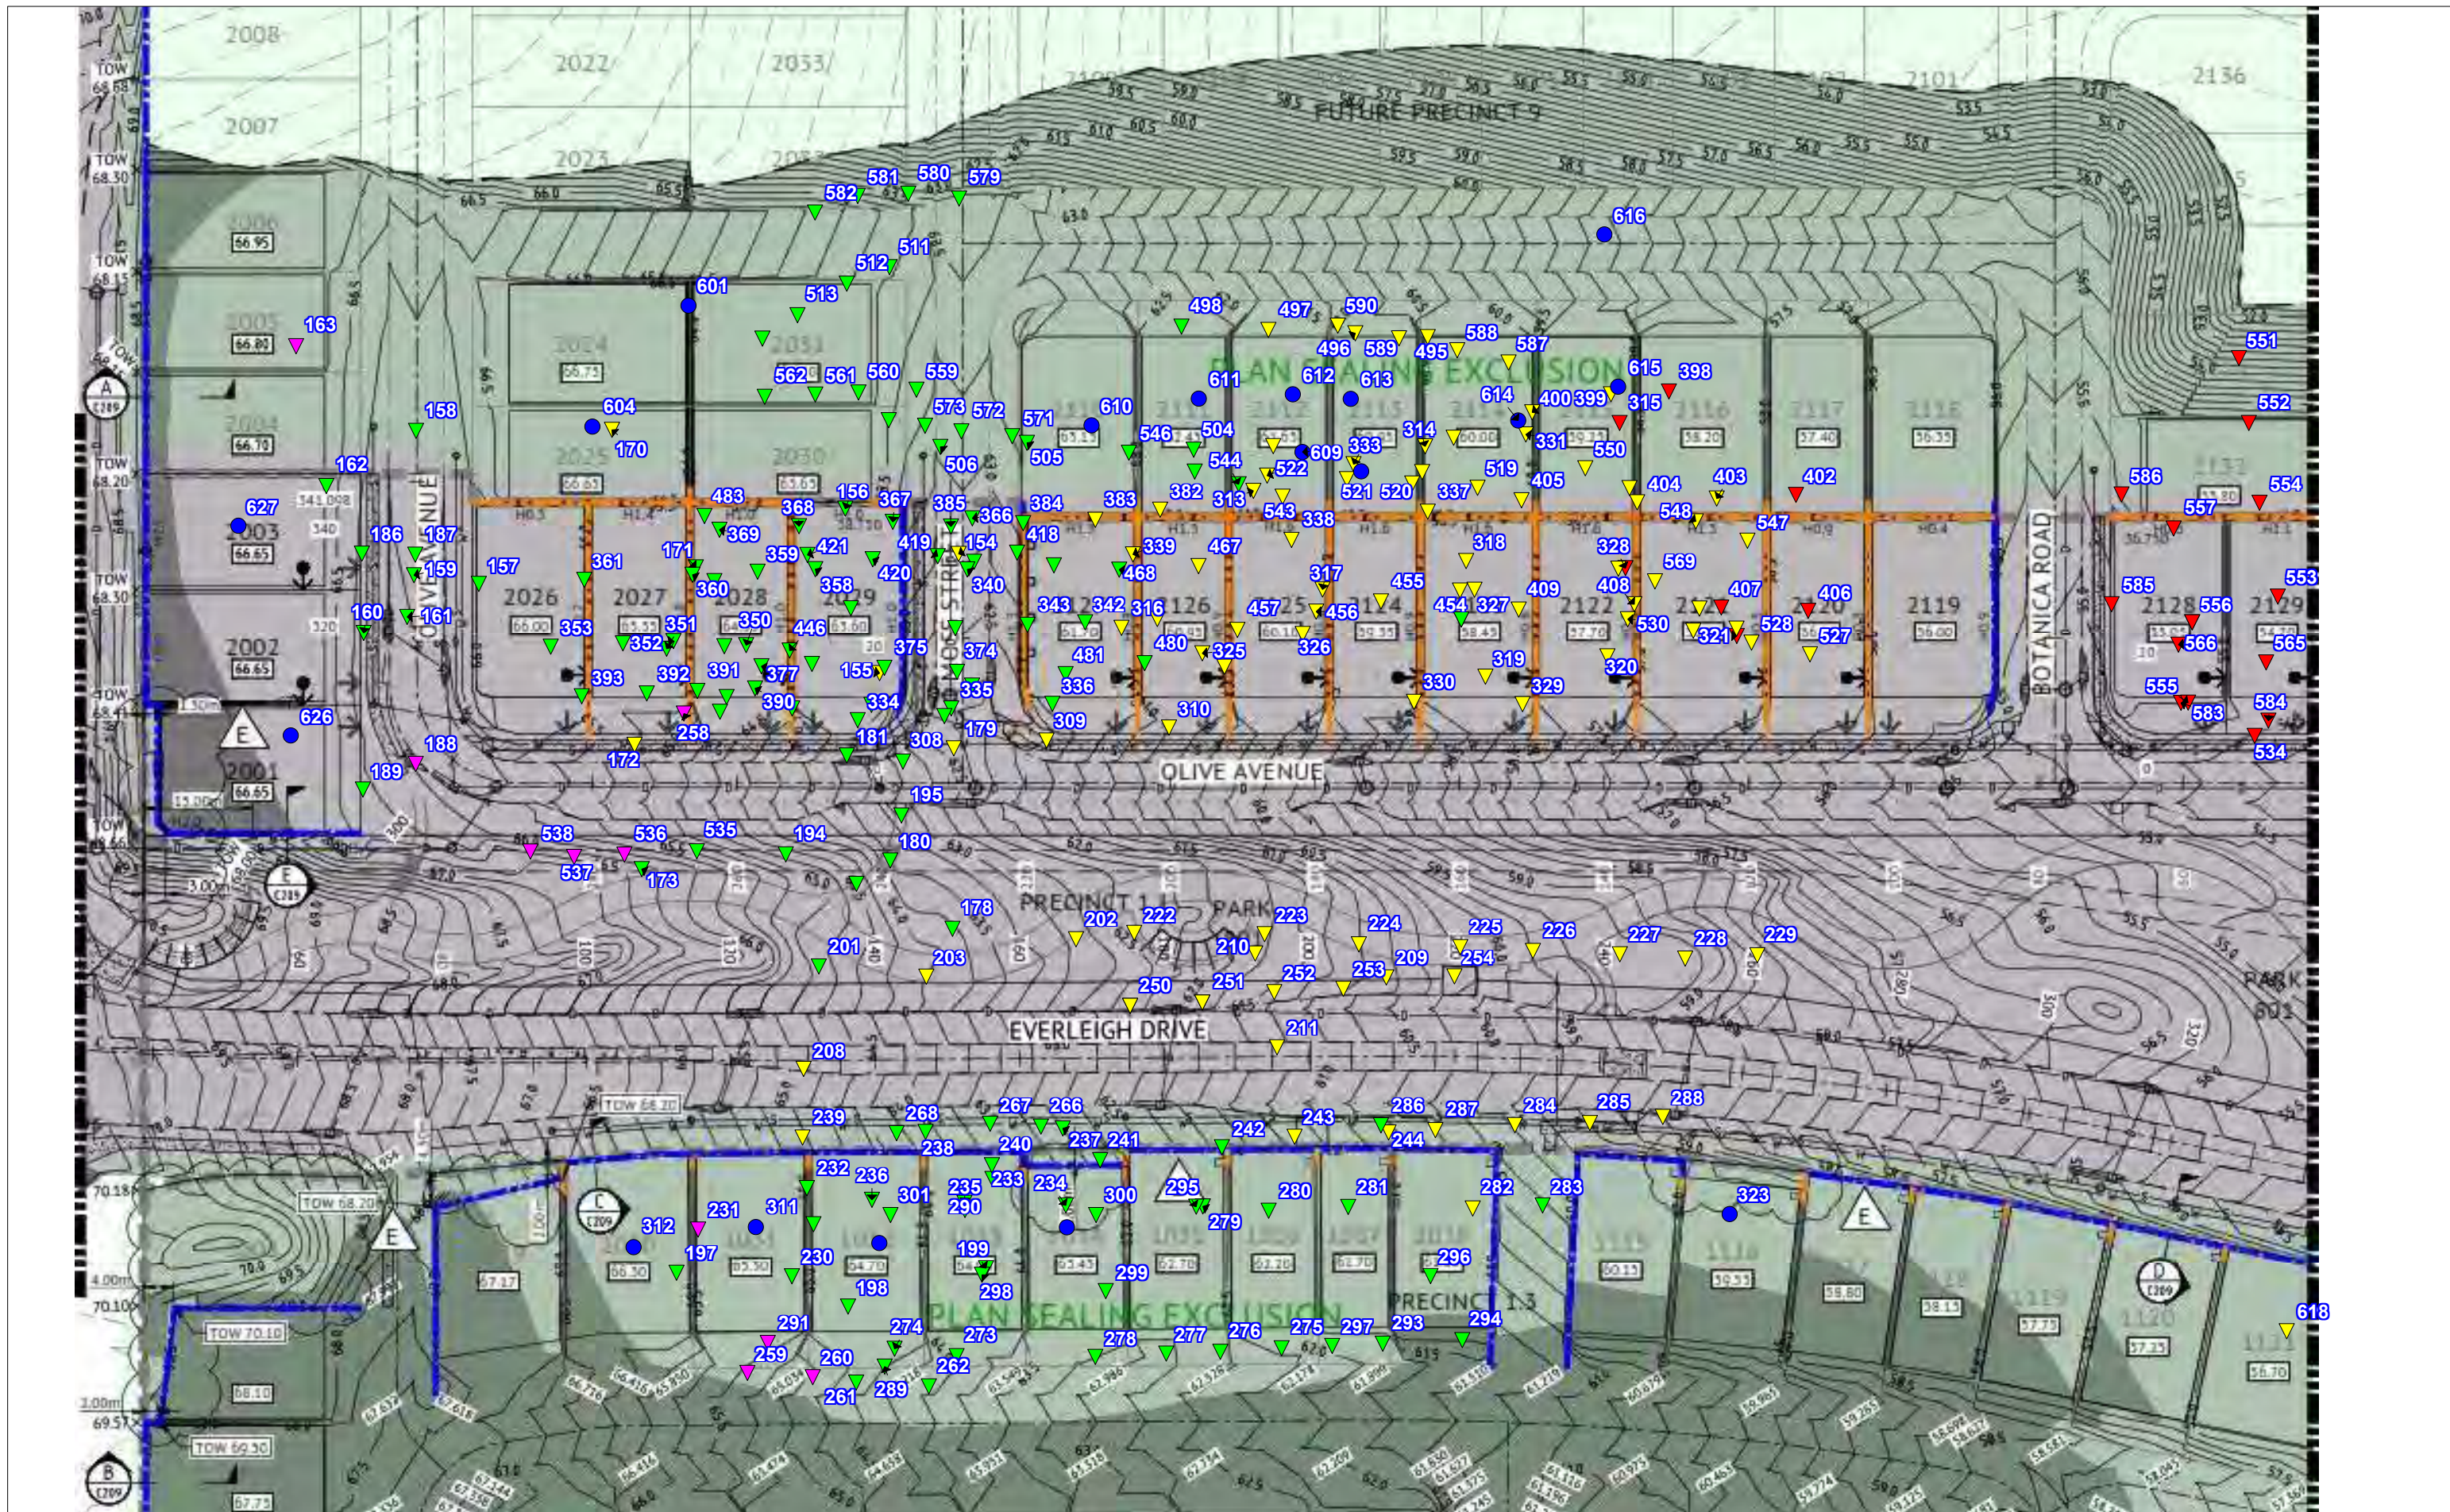

MORRISON GEOTECHNIC PTY LTD

ABN: 51 009 878 899


Unit 1/ 35 Limestone St, Darra 4076 Ph: 3279 0900
 Email: brisbanelab@morrisongeo.com.au Fax: 3279 0955

Engineers: D.Riley, J. Daly
 D.Dragun, & S.Wynne
 Geologists: L.Bexley & R.Howchin
 Laboratory: M.Morrison

LEGEND

- ▼ RL 50.00 - 54.99
- ▼ RL 55.00 - 59.99
- ▼ RL 60.00 - 64.99
- ▼ RL 65.00 - 69.99
- ▼ RL 70.00 - 74.99
- Final Level

Map Description :	EARTHWORKS FIELD DENSITY TESTING - Level 1 Inspection		
Client :	SHADFORTHS CIVIL		
Project :	EVERLEIGH 1.1 (SHEET 1)		
Project No :	DL18/096	Drawing No :	DL18/096-01
		Scale :	Not to Scale

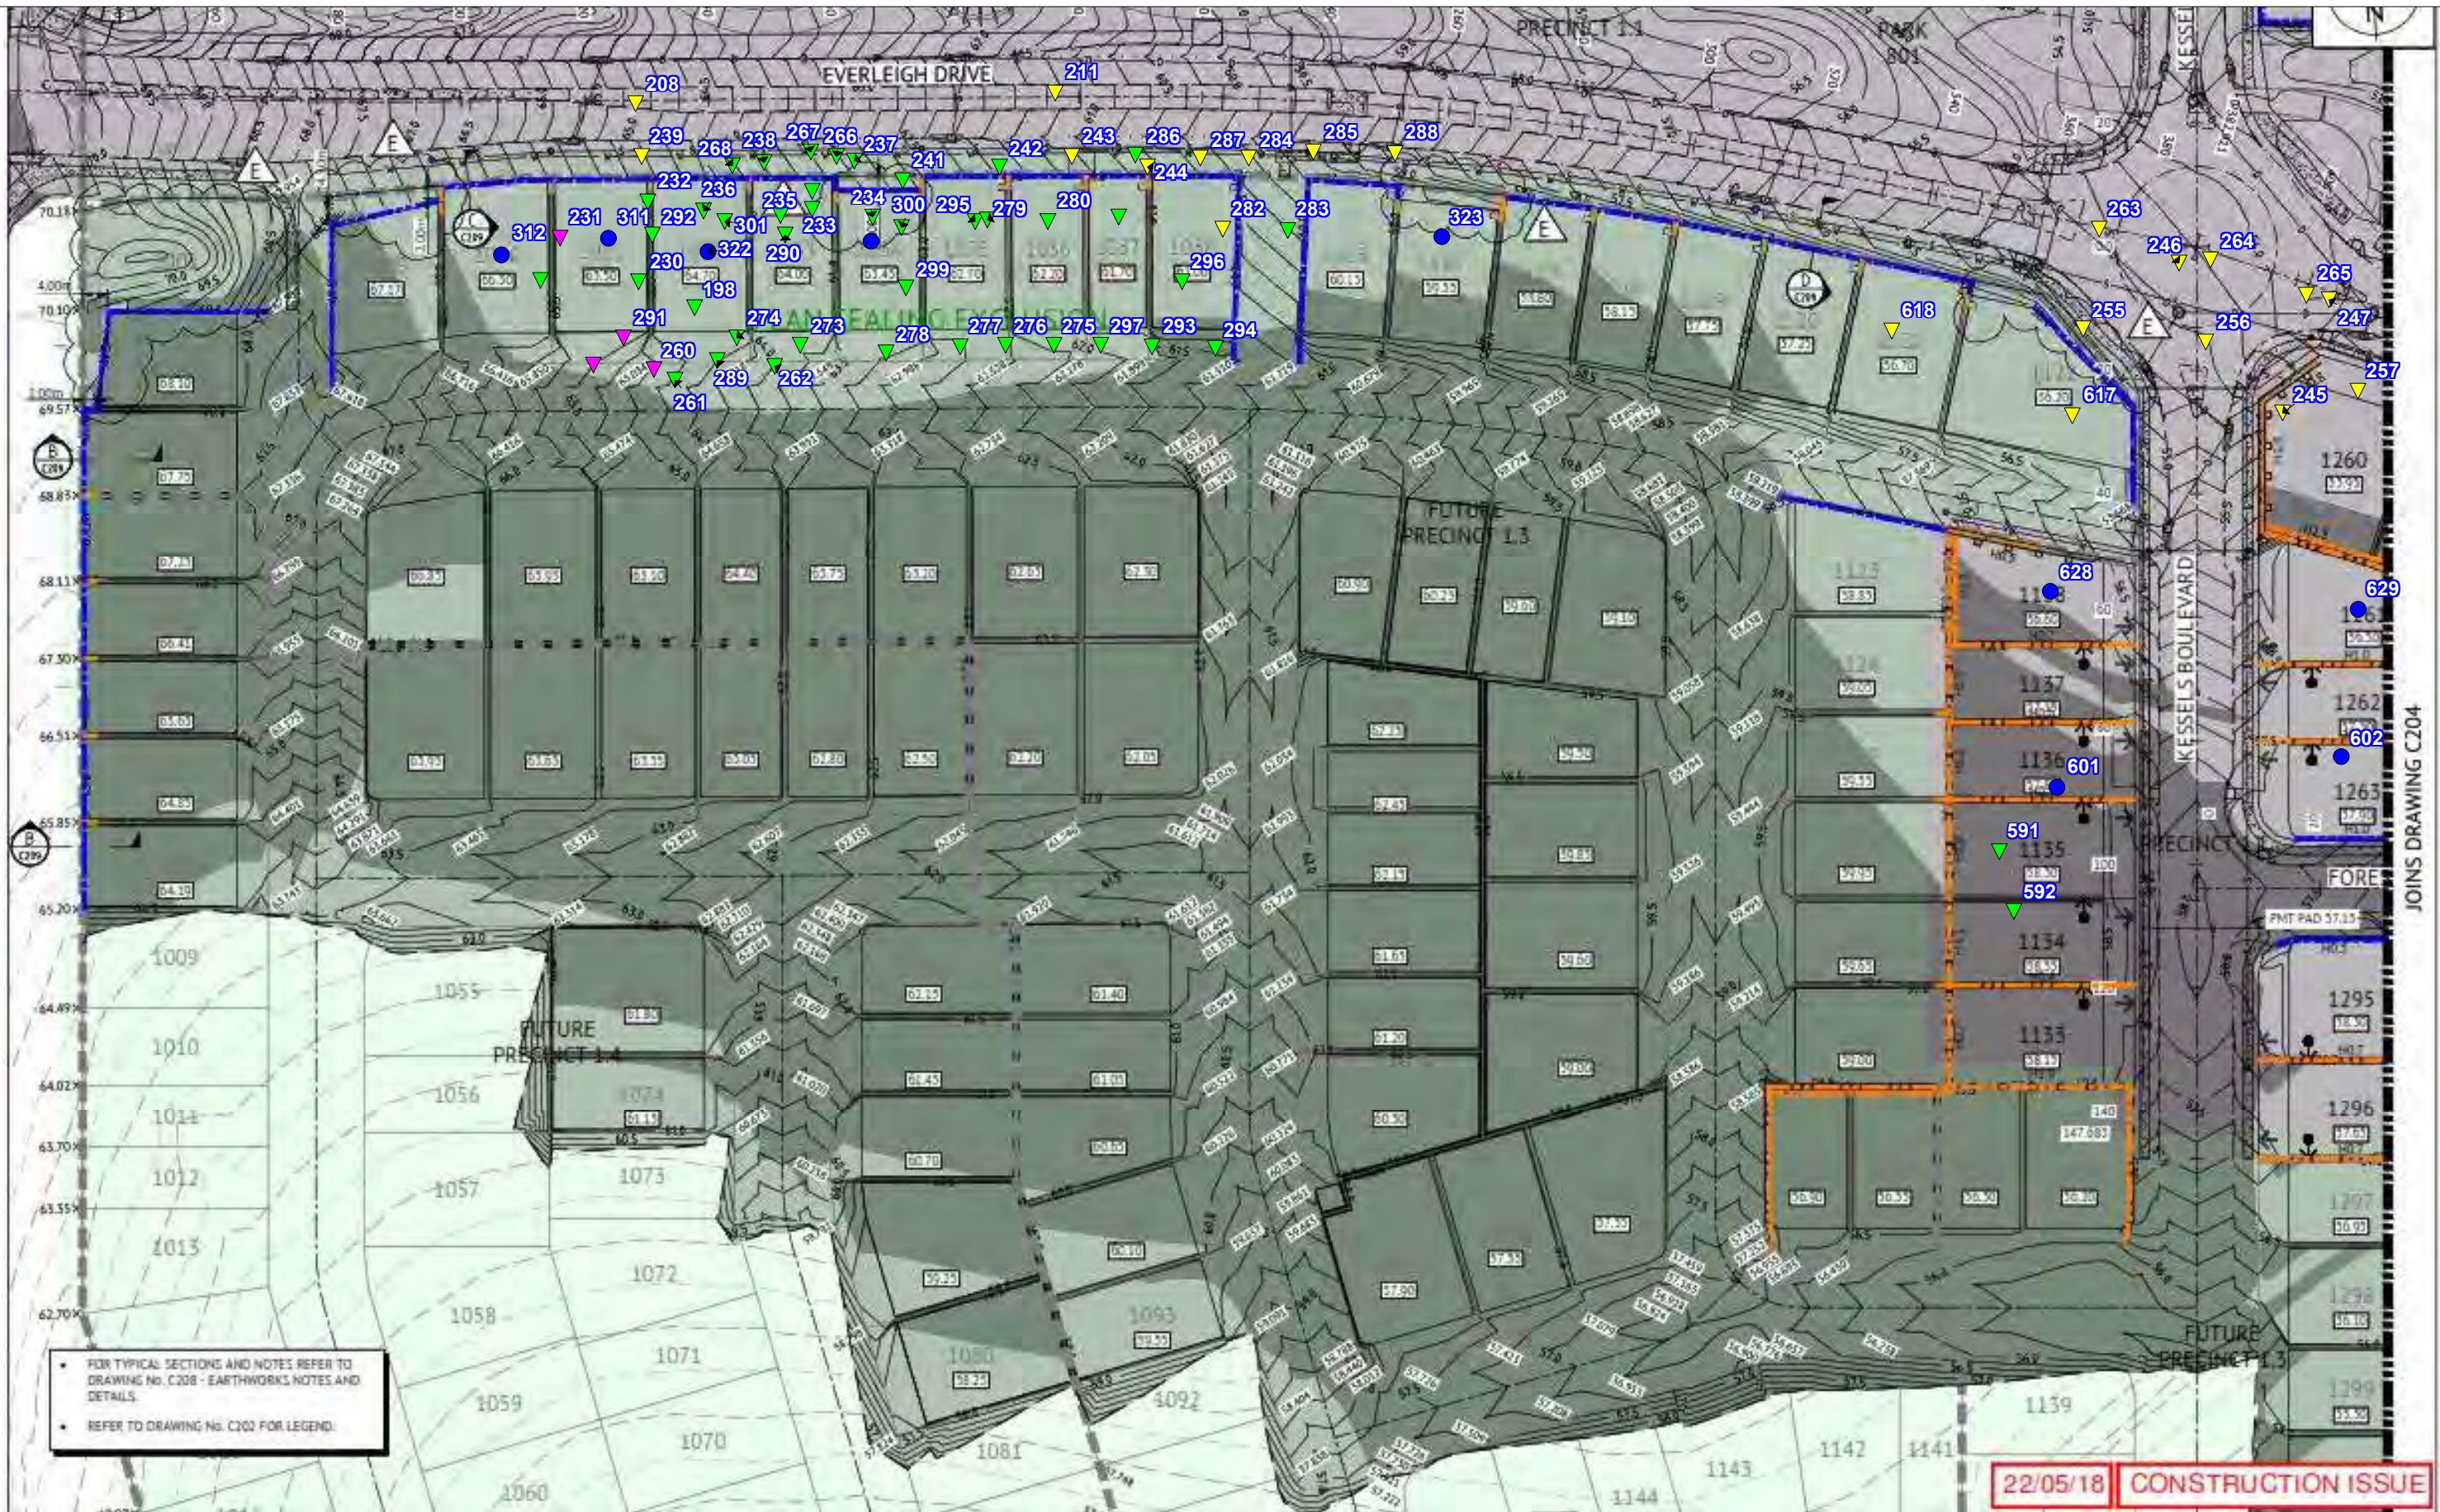

FOR TYPICAL SECTIONS AND NOTES REFER TO DRAWING No. C208 - EARTHWORKS NOTES AND DETAILS.
REFER TO DRAWING No. C202 FOR LEGEND.

22/05/18 CONSTRUCTION ISSUE



MORRISON GEOTECHNIC PTY LTD
ABN: 51 009 878 899


Unit 1/ 35 Limestone St, Darra 4076 Ph: 3279 0900
Email: brisbanelab@morrisongeo.com.au Fax: 3279 0955

Engineers: D.Riley, J. Daly, D.Dragun, & S.Wynne
Geologists: L.Bexley & R.Howchin
Laboratory: M.Morrison

LEGEND

- ▼ RL 45.00 - 49.99
- ▲ RL 50.00 - 54.99
- ▼ RL 55.00 - 59.99
- ▲ RL 60.00 - 64.99
- ▲ RL 65.00 - 69.99
- Final Level

Map Description :	EARTHWORKS FIELD DENSITY TESTING - Level 1 Inspection		
Client :	SHADFORTH CIVIL		
Project :	EVERLEIGH 1.1 (SHEET 2)		
Project No :	DL18/096	Drawing No :	DL18/096 - 02
		Scale :	Not to Scale

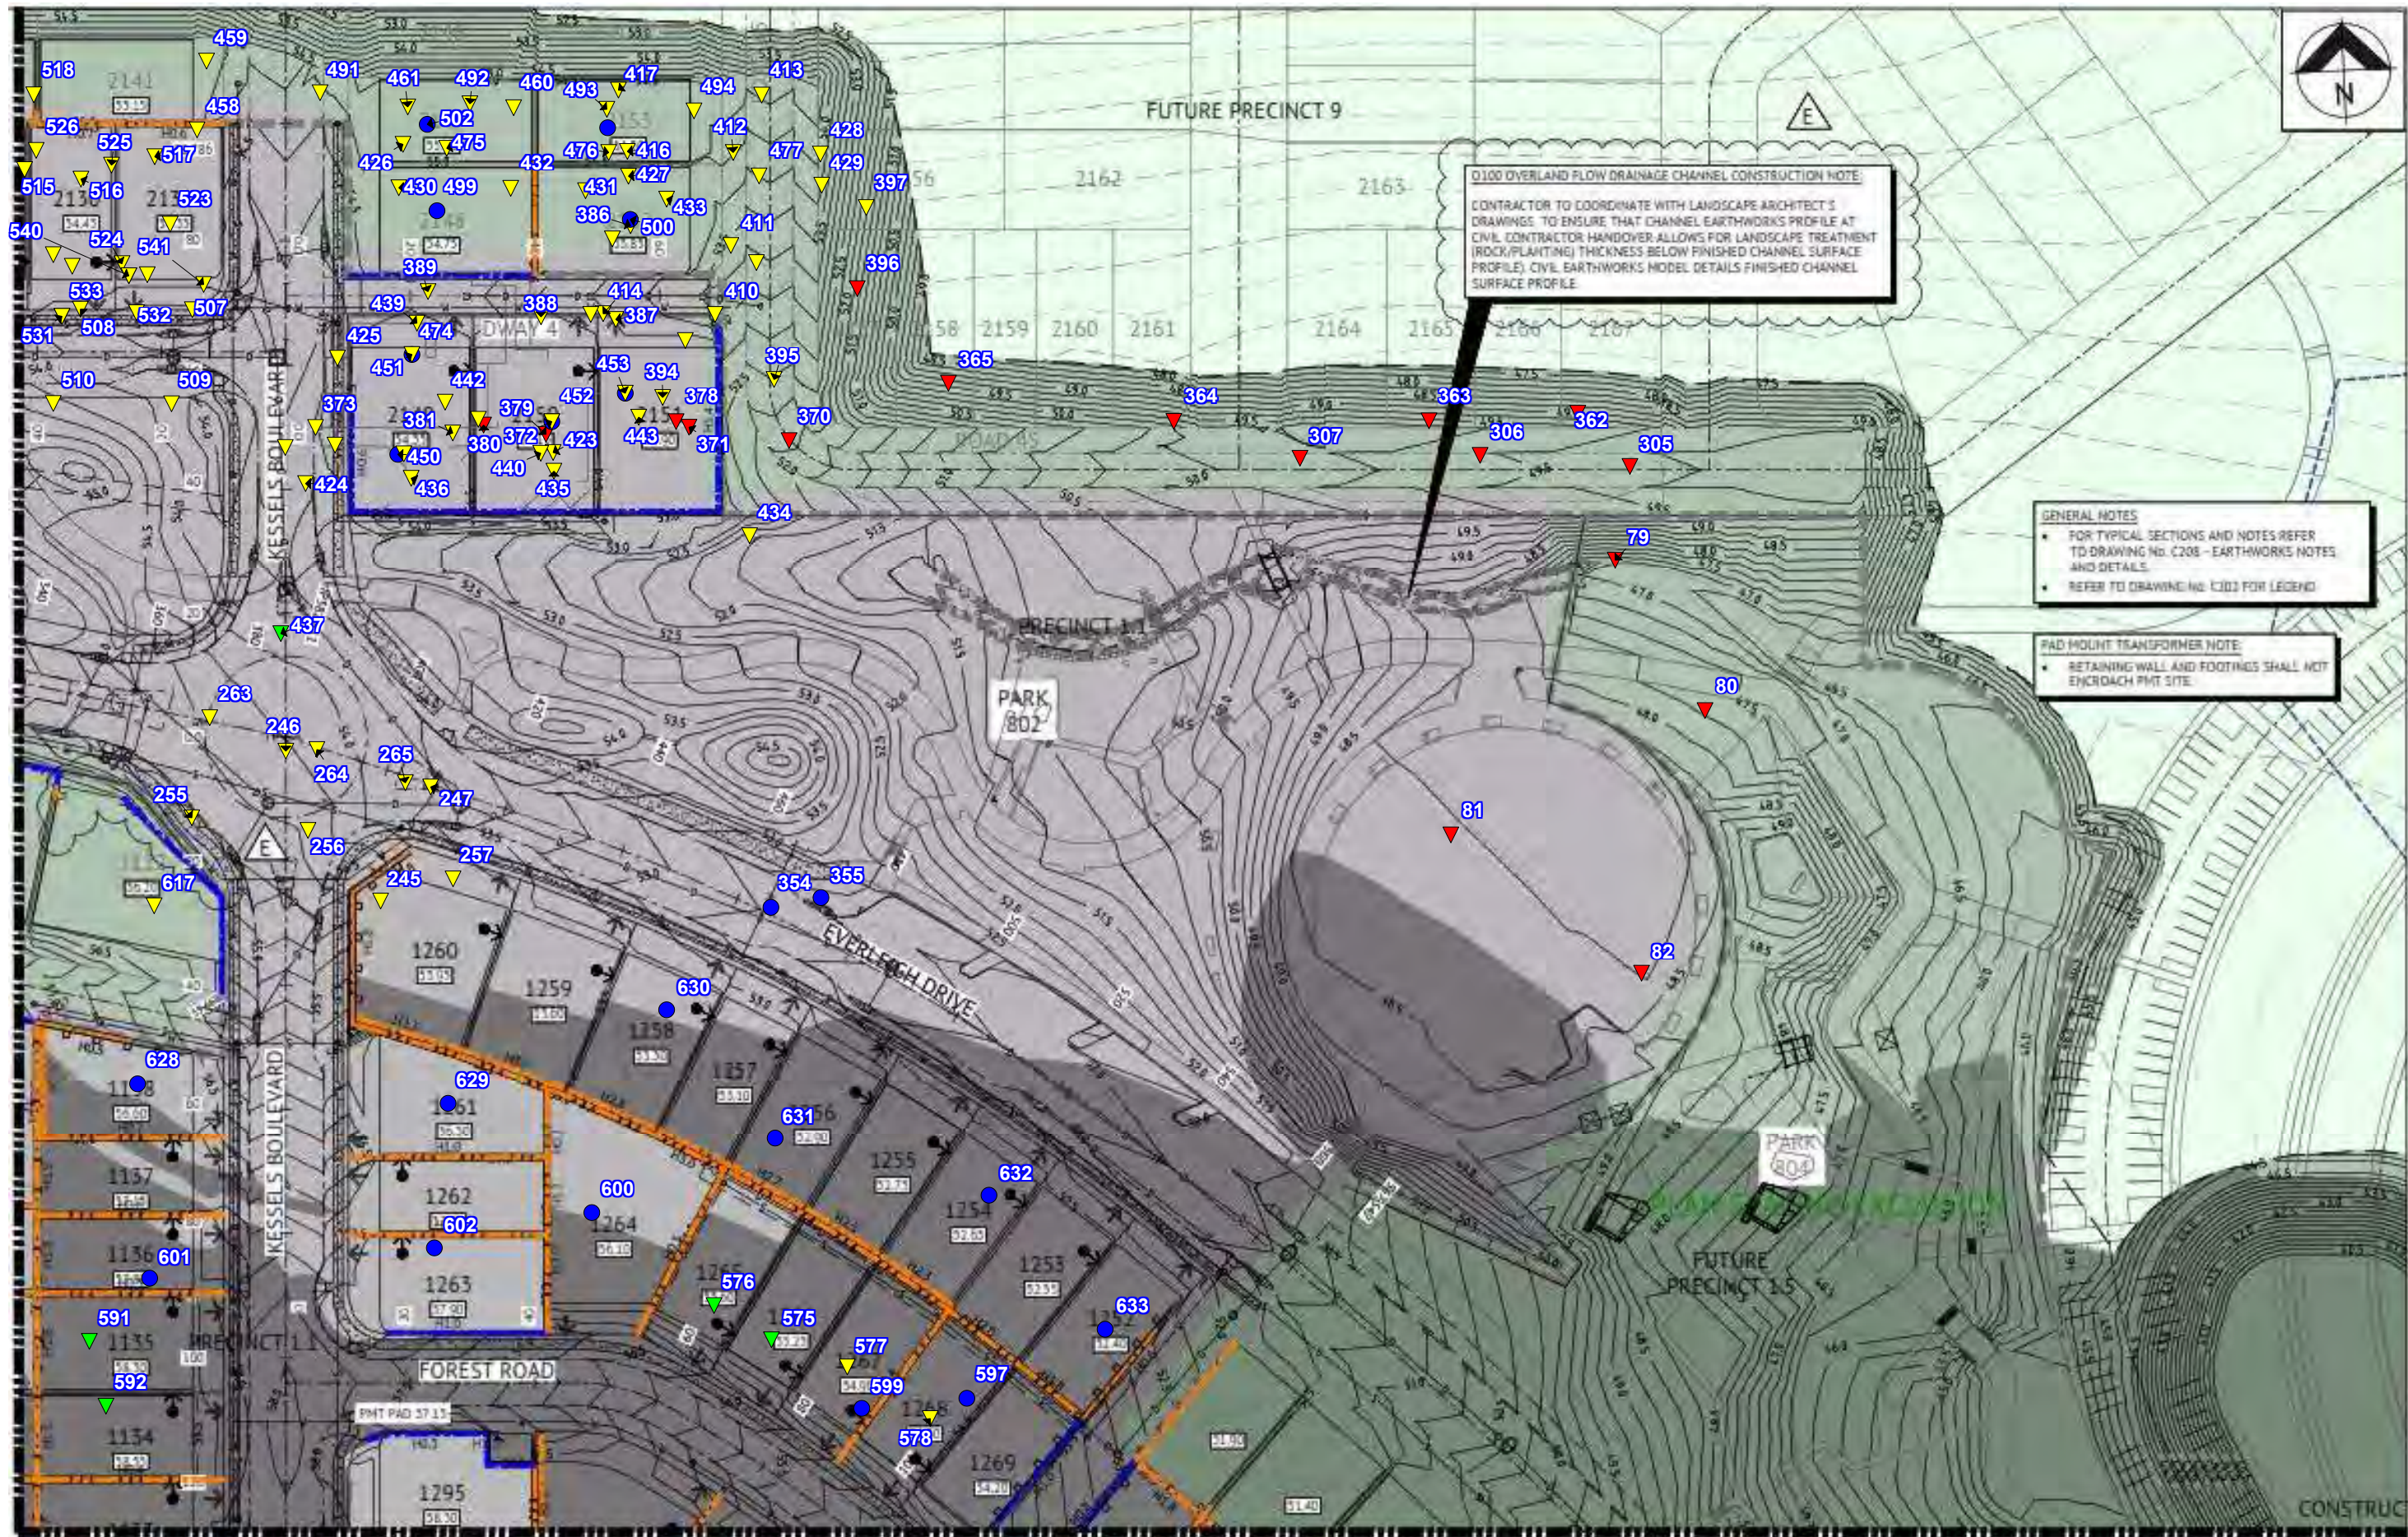

0100 OVERLAND FLOW DRAINAGE CHANNEL CONSTRUCTION NOTE:
 CONTRACTOR TO COORDINATE WITH LANDSCAPE ARCHITECT'S DRAWINGS TO ENSURE THAT CHANNEL EARTHWORKS PROFILE AT CIVIL CONTRACTOR HANDOVER ALLOWS FOR LANDSCAPE TREATMENT (ROCK/PLANTING) THICKNESS BELOW FINISHED CHANNEL SURFACE PROFILE. CIVIL EARTHWORKS MODEL DETAILS FINISHED CHANNEL SURFACE PROFILE.

GENERAL NOTES
 • FOR TYPICAL SECTIONS AND NOTES REFER TO DRAWING NO. C208 - EARTHWORKS NOTES AND DETAILS.
 • REFER TO DRAWING NO. C303 FOR LEGEND

RAD MOUNT TRANSFORMER NOTE:
 • RETAINING WALL AND FOOTINGS SHALL NOT ENCRoACH PMT SITE.



MORRISON GEOTECHNIC PTY LTD
 ABN: 51 009 878 899


Unit 1/ 35 Limestone St, Darra 4076 Ph: 3279 0900
 Email: brisbanelab@morrisongeo.com.au Fax: 3279 0955

Engineers: D.Riley, J. Daly
 D.Dragun, & S.Wynne
 Geologists: L.Bexley & R.Howchin
 Laboratory: M.Morrison

LEGEND

- ▼ RL 45.00 - 49.99
- ▼ RL 50.00 - 54.99
- ▼ RL 55.00 - 59.99
- ▼ RL 60.00 - 64.99
- ▼ RL 65.00 - 69.99
- Final Level

Map Description :	EARTHWORKS FIELD DENSITY TESTING - Level 1 Inspection		
Client :	SHADFORTH'S CIVIL		
Project :	EVERLEIGH 1.1 (SHEET 3)		
Project No :	DL18/096	Drawing No :	DL18/096 - 03
		Scale :	Not to Scale

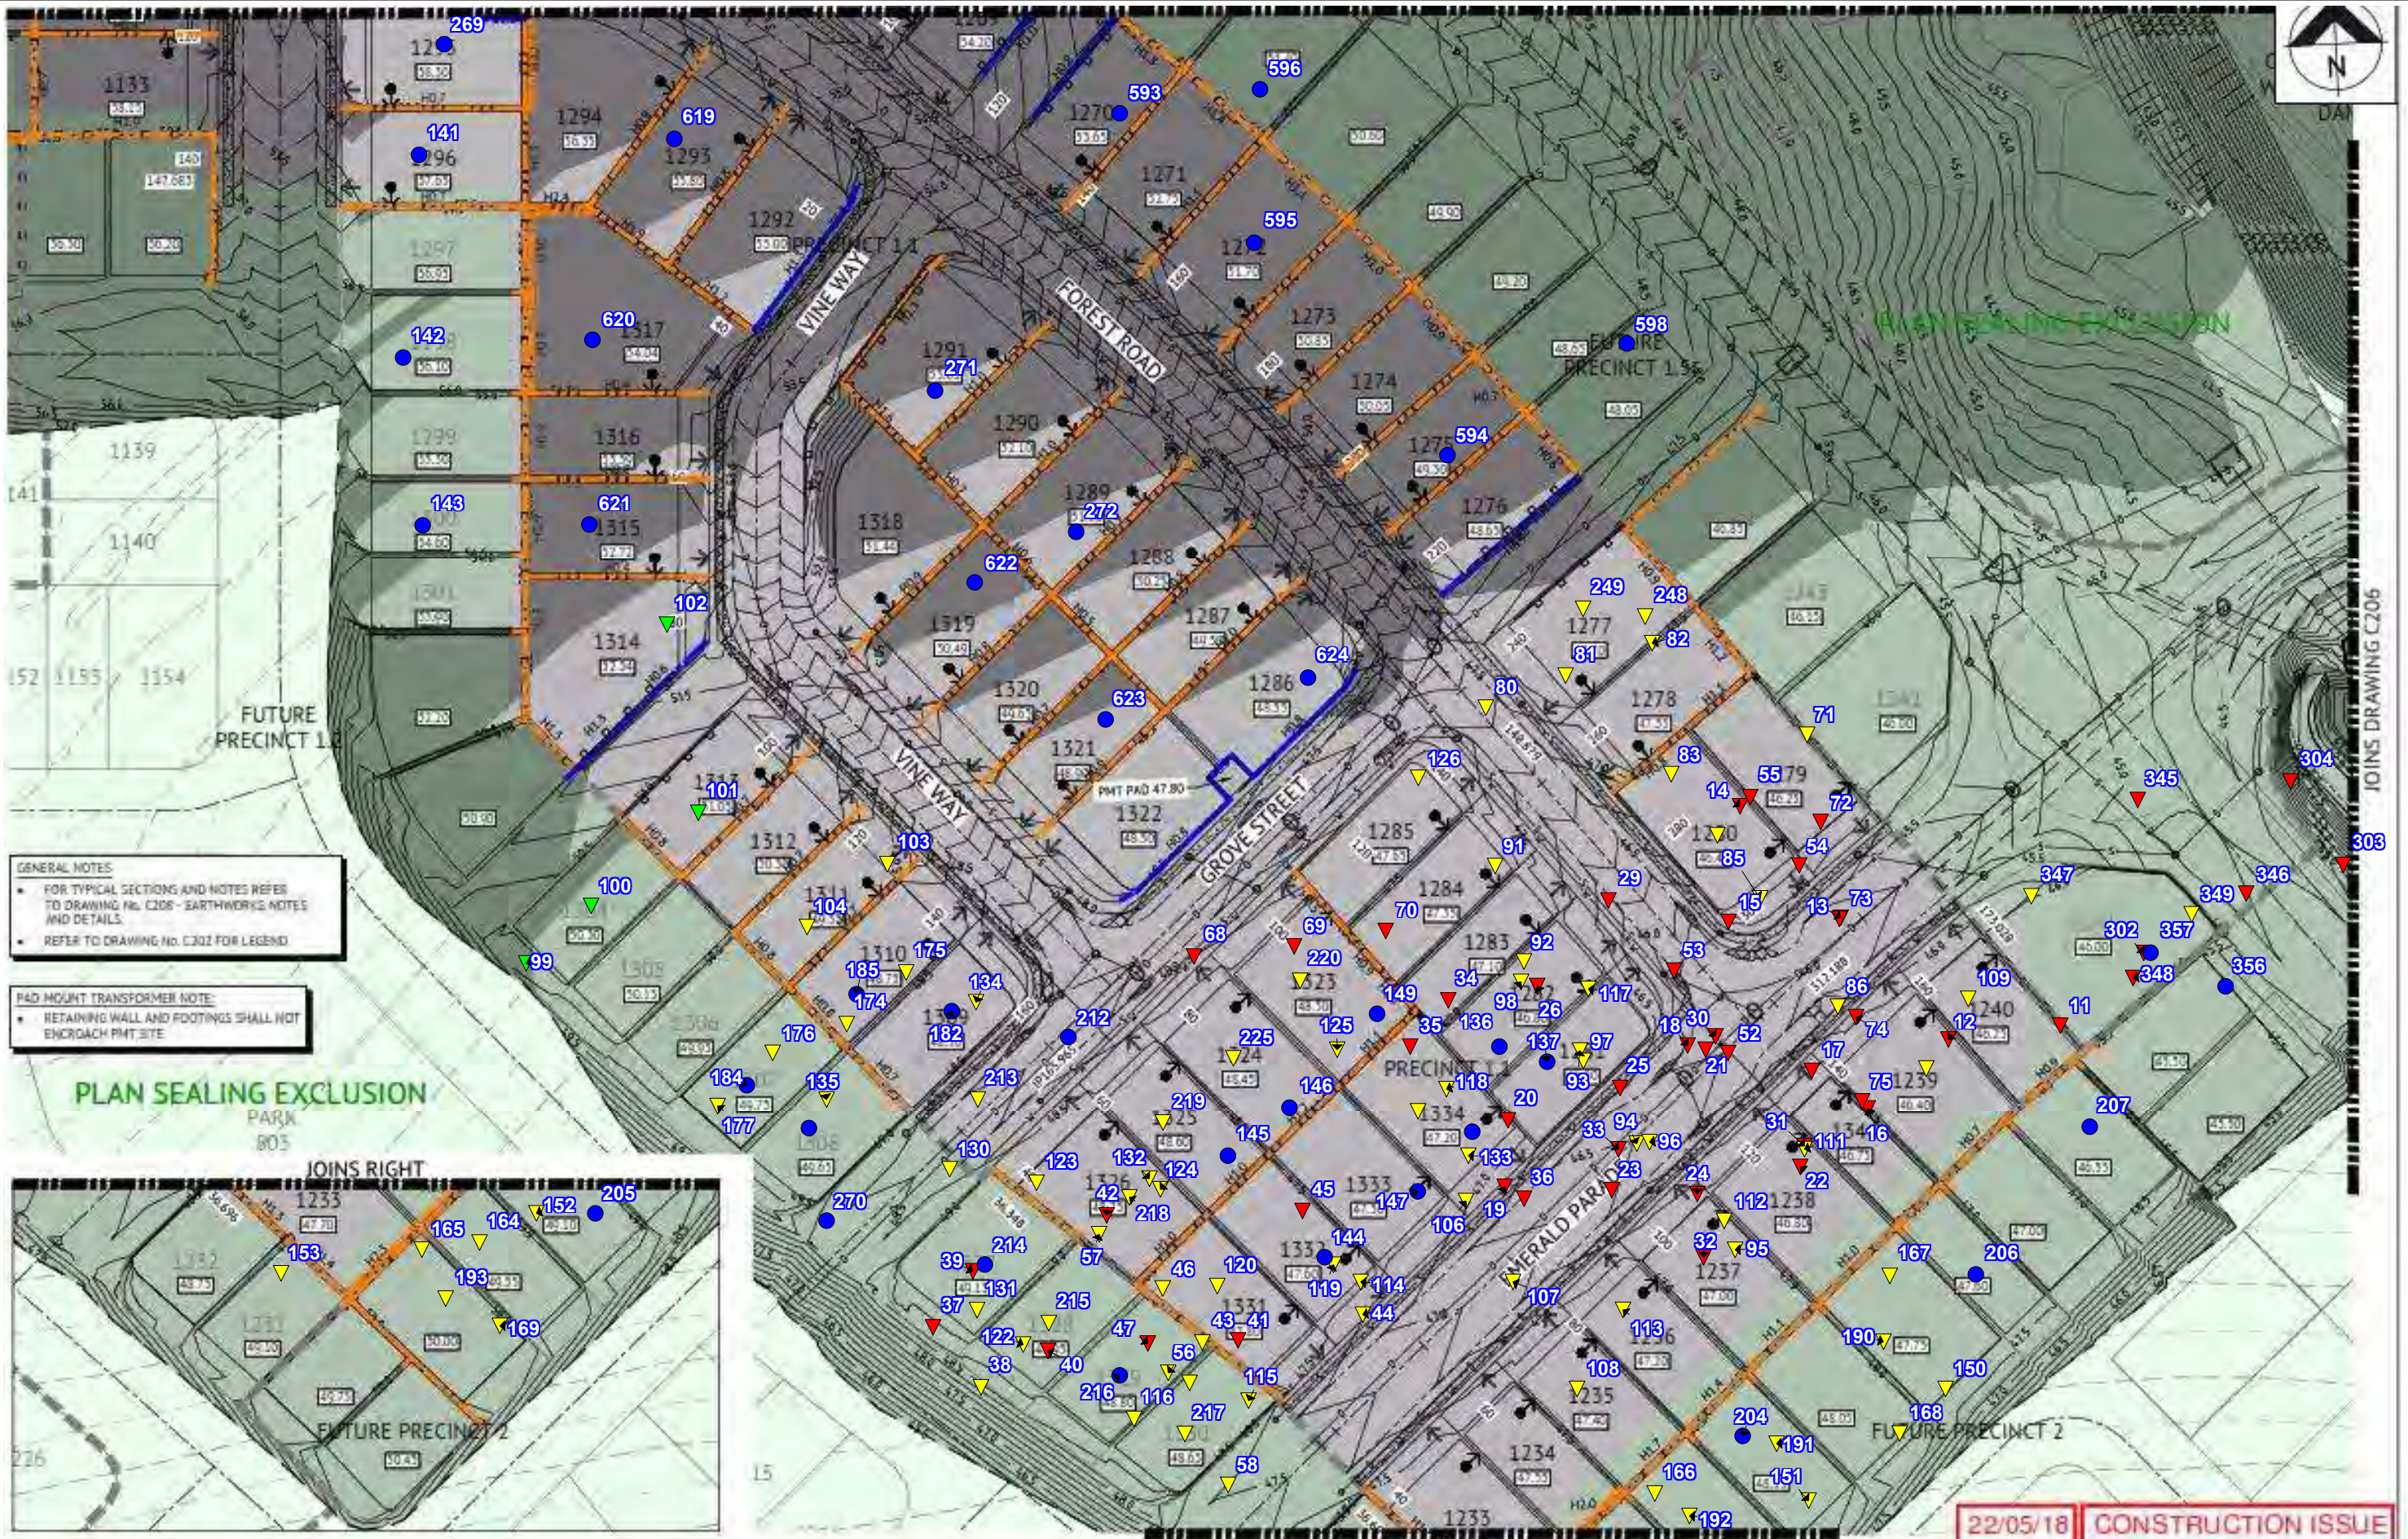


GENERAL NOTES

- FOR TYPICAL SECTIONS AND NOTES REFER TO DRAWING NO. C206 - EARTHWORKS NOTES AND DETAILS.
- REFER TO DRAWING NO. C302 FOR LEGEND.

PAD MOUNT TRANSFORMER NOTE:

- RETAINING WALL AND FOOTINGS SHALL NOT ENCRoACH PMT SITE.

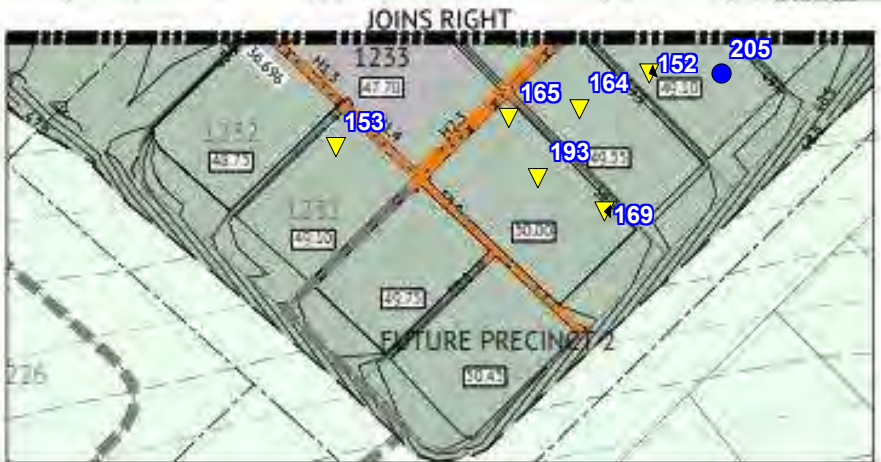

22/05/18 CONSTRUCTION ISSUE



MORRISON GEOTECHNIC PTY LTD

ABN: 51 009 878 899


Unit 1/ 35 Limestone St, Darra 4076 Ph: 3279 0900
 Email: brisbanelab@morrisongeo.com.au Fax: 3279 0955

Engineers: D.Riley, J. Daly
 D.Dragun, & S.Wynne
 Geologists: L.Bexley & R.Howchin
 Laboratory: M.Morrison

LEGEND

- ▼ RL 40.00 - 44.99
- ▲ RL 45.00 - 49.99
- ▼ RL 50.00 - 54.99
- ▲ RL 55.00 - 59.99
- ▼ RL 60.00 - 64.99
- Final Level

Map Description :	EARTHWORKS FIELD DENSITY TESTING - Level 1 Inspection		
Client :	SHADFORTH CIVIL		
Project :	EVERLEIGH 1.1		
Project No :	DL18/096	Drawing No :	DL18/096 - 04
		Scale :	Not to Scale

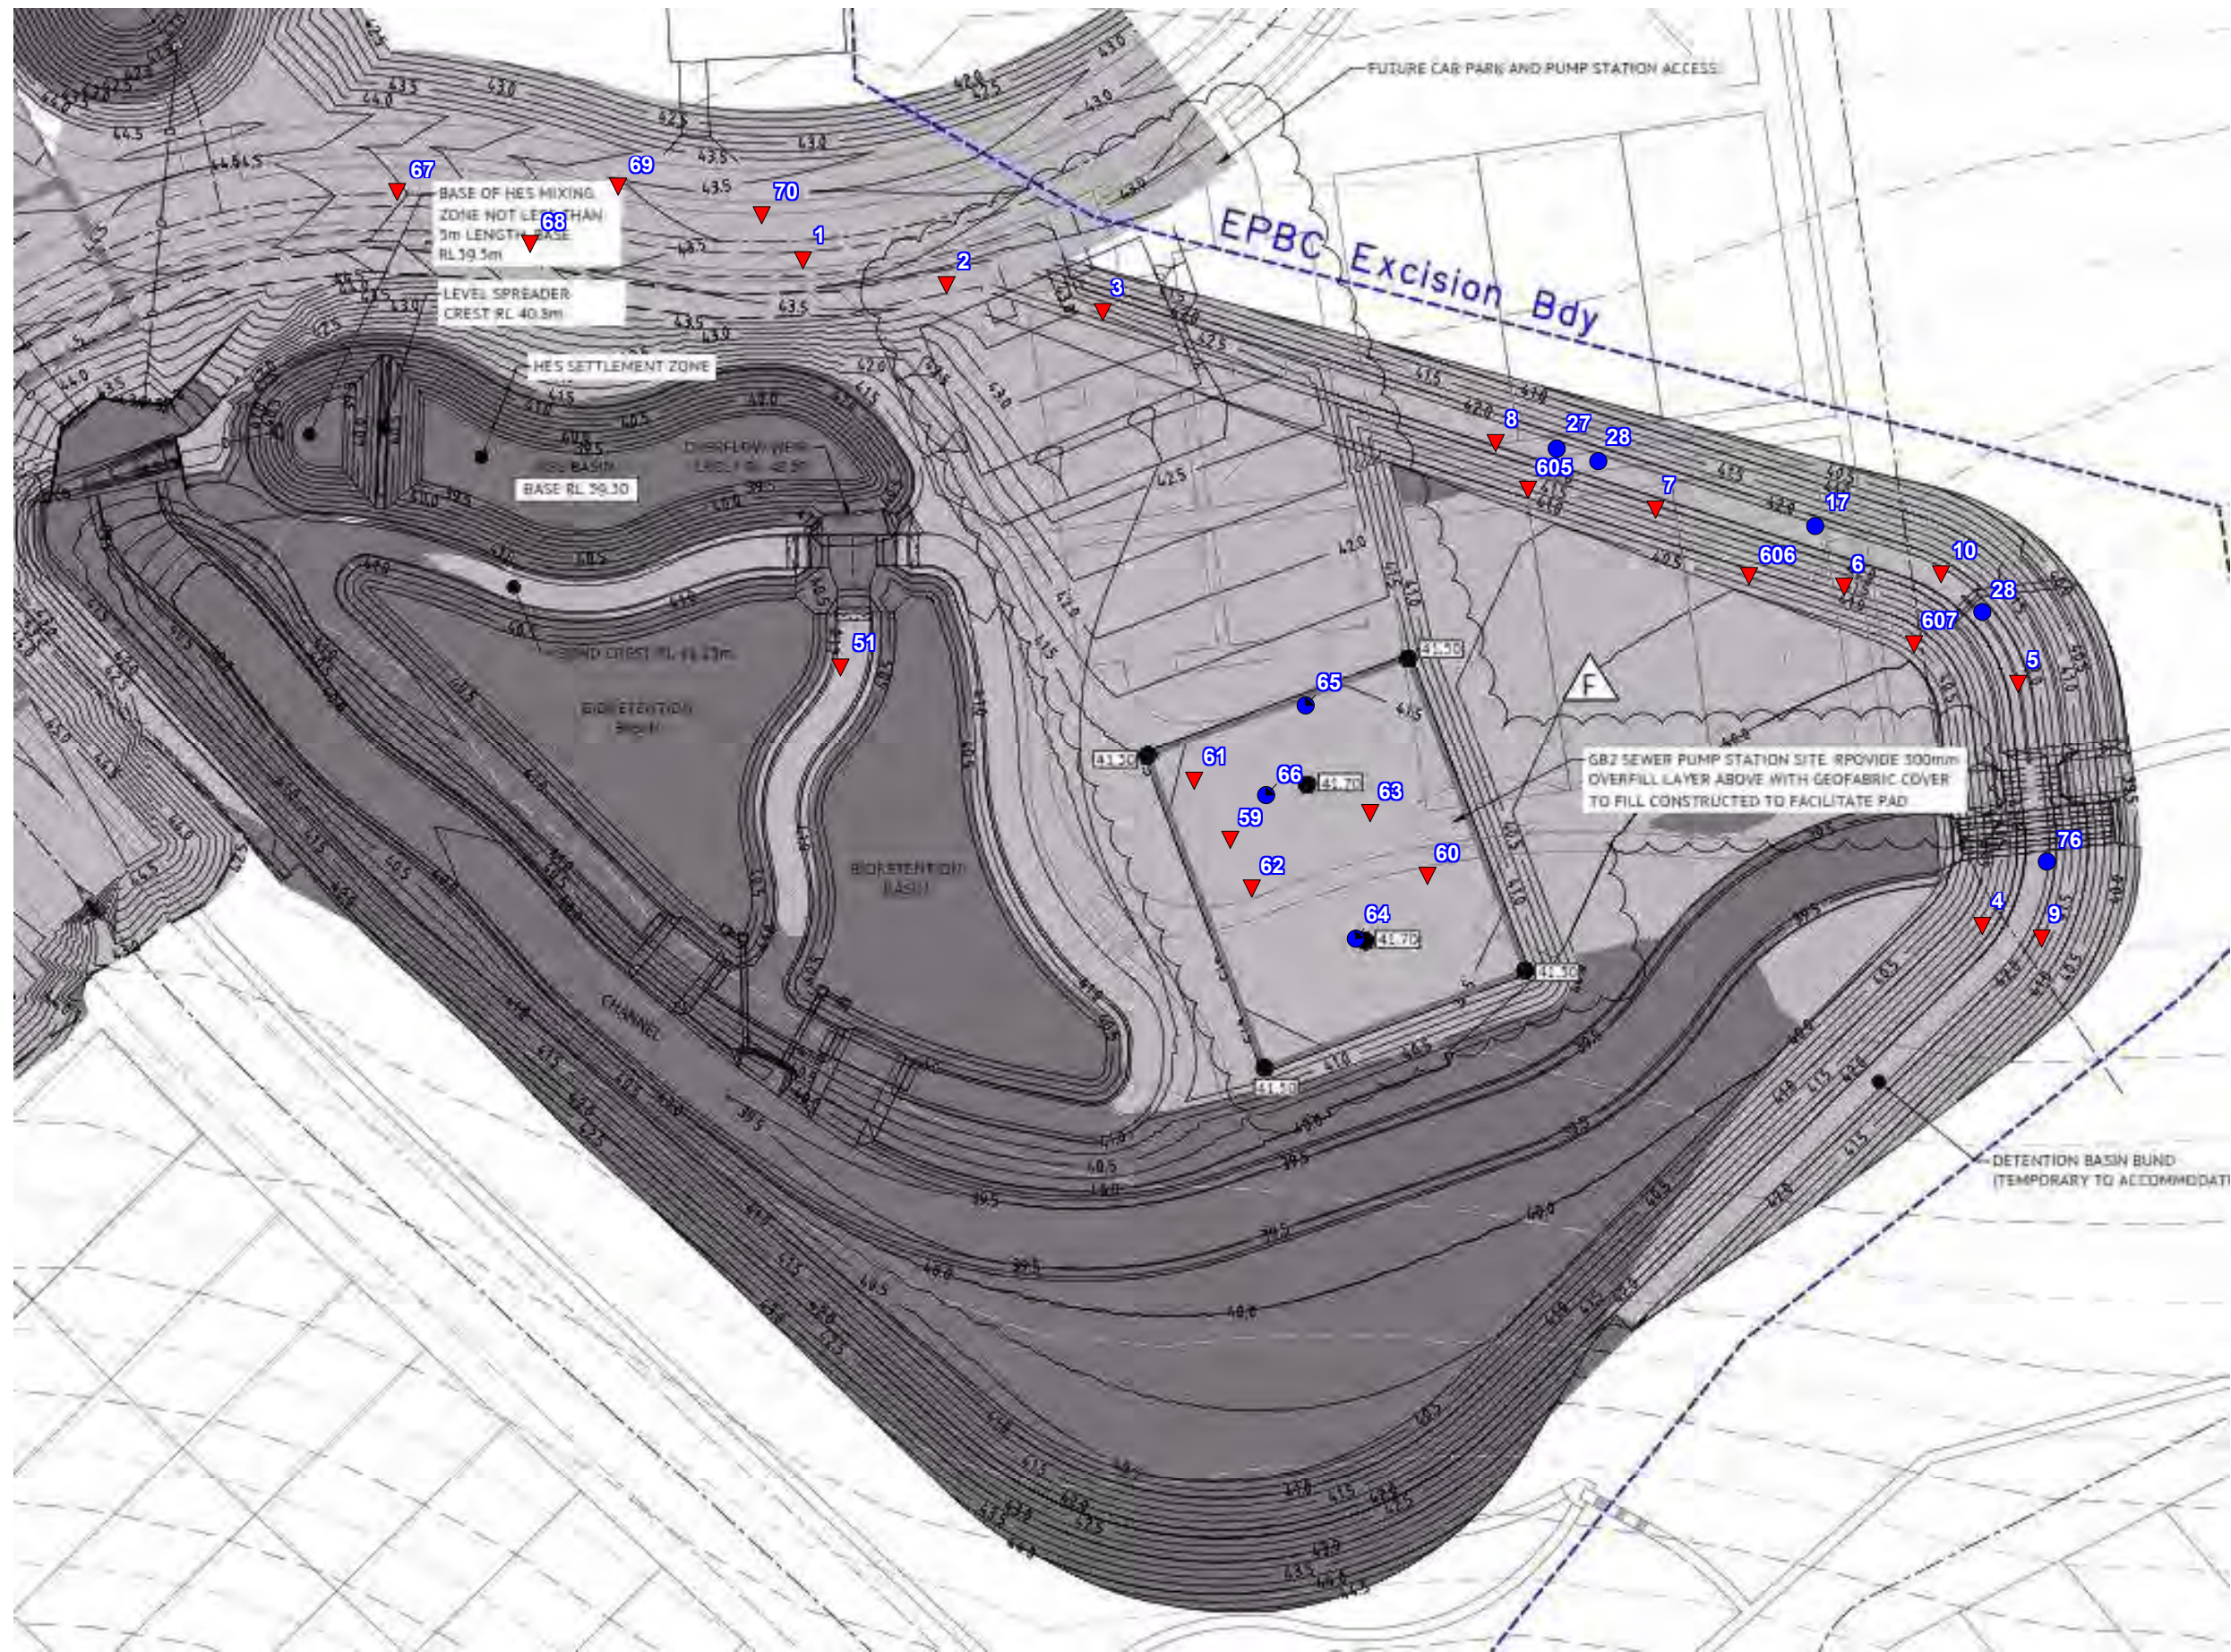

MORRISON GEOTECHNIC PTY LTD

ABN: 51 009 878 899

Unit 1/ 35 Limestone St, Darra 4076 Ph: 3279 0900
 Email: brisbanelab@morrisongeo.com.au Fax: 3279 0955


Engineers: D.Riley, J. Daly
 D.Dragun, & S.Wynne
 Geologists: L.Bexley & R.Howchin
 Laboratory: M.Morrison

LEGEND

▼ RL 40.00 - 44.99

● Final Level

Map Description :	EARTHWORKS FIELD DENSITY TESTING - Level 1 Inspection		
Client :	SHADFORTHS CIVIL PTY LTD		
Project :	EVERLEIGH 1.1		
Project No :	DL18-096	Drawing No :	DL18-096-05
		Scale :	Not to Scale

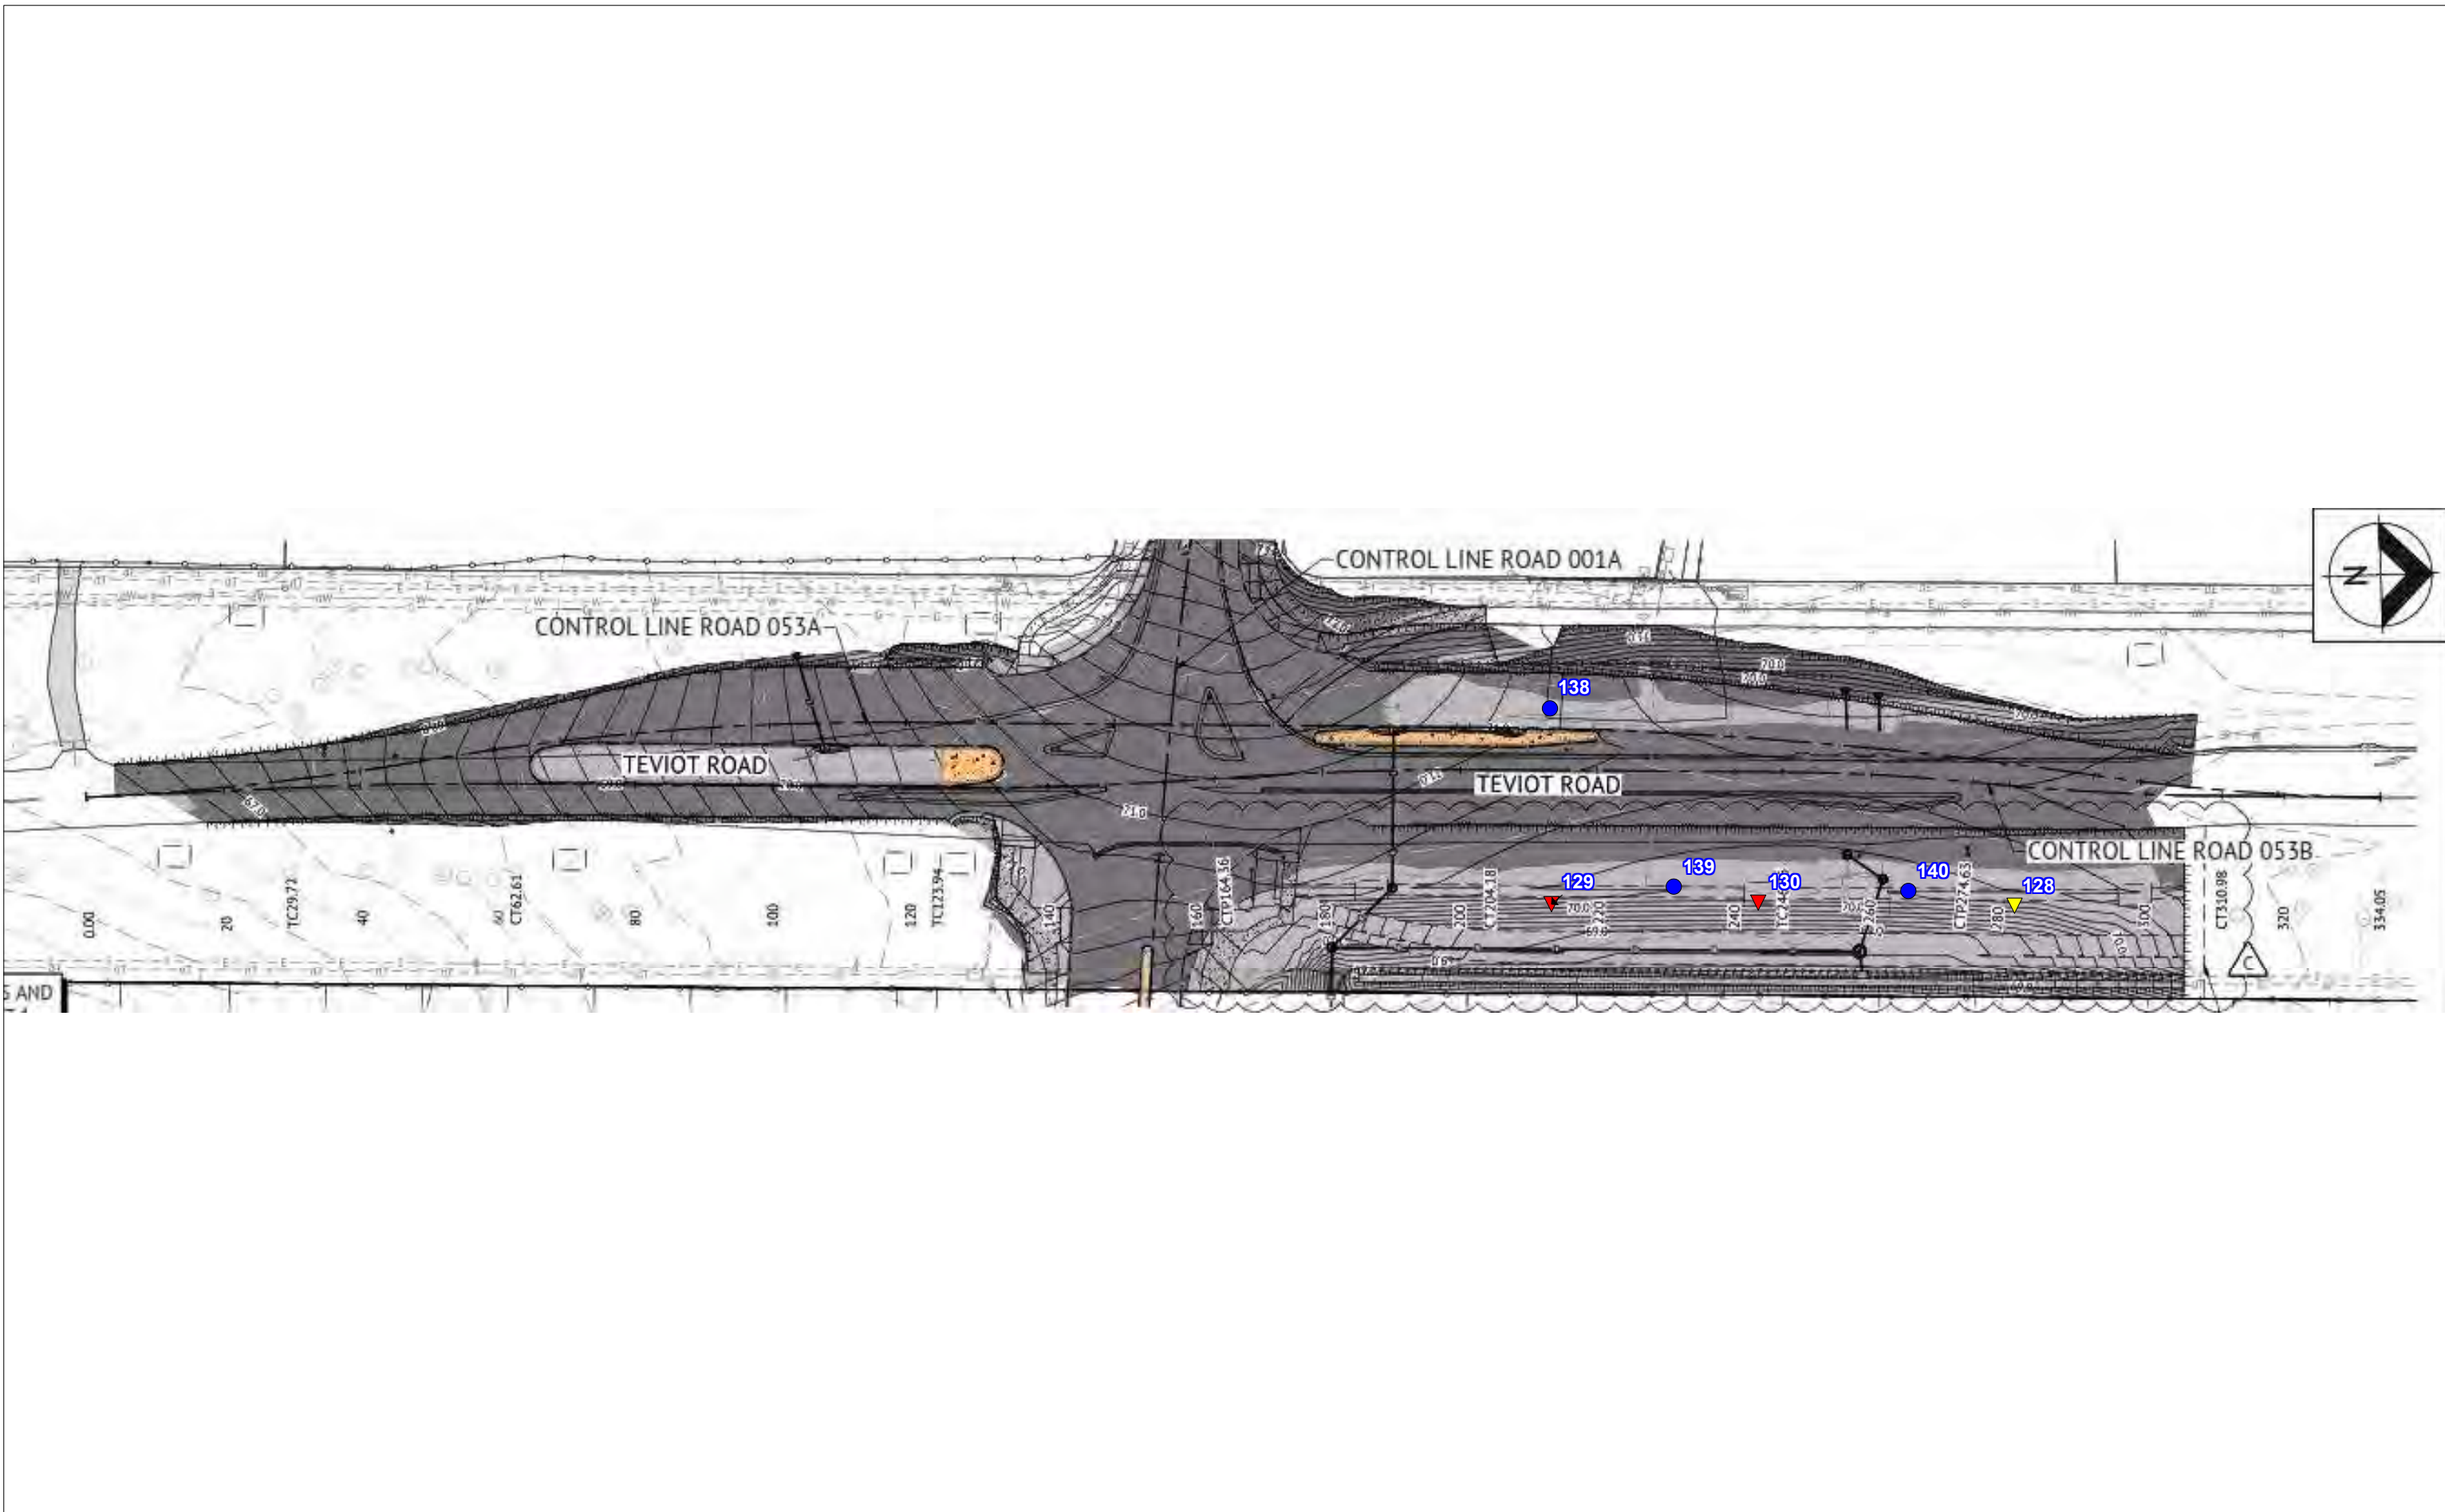

MORRISON GEOTECHNIC PTY LTD
 ABN: 51 009 878 899

Unit 1/ 35 Limestone St, Darra 4076 Ph: 3279 0900
 Email: brisbanelab@morrisongeo.com.au Fax: 3279 0955

Engineers: D.Riley, J. Daly
 D.Dragun, & S.Wynne
 Geologists: L.Bexley & R.Howchin
 Laboratory: M.Morrison

LEGEND

- ▼ RL 65.00 - 69.99
- ▼ RL 70.00 - 74.99
- Final Level

Map Description :	EARTHWORKS FIELD DENSITY TESTING - Level 1 Inspection		
Client :	SHADFORTHS CIVIL PTY LTD		
Project :	EVERLEIGH 1.1		
Project No :	DL18/096	Drawing No :	DL18/096-06
		Scale :	Not to Scale

APPENDIX B

Test Certificates



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 1
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	04/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	244361	244362	244363	
Test Number :	1	2	3	
Sampling Method :	-	-	-	
Date Sampled :	26/04/2018	26/04/2018	26/04/2018	
Date Tested :	26/04/2018	26/04/2018	26/04/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	E 9276 N 31463 RL 41.200	E 9294 N 31460 RL 41.300	E 9311 N 31458 RL 41.350	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	12.2	13.1	12.3	
Hilf MDR Number :	244361	244362	244363	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	91	102	97.5	
Field Wet Density (t/m ³) :	2.089	2.050	2.085	
Optimum Moisture Content (%) :	13.4	12.8	12.6	
Moisture Variation :	1.2	-0.2	0.3	
Peak Converted Wet Density (t/m ³) :	2.099	2.089	2.113	
Hilf Density Ratio (%) :	99.5	98.0	98.5	
Minimum Specification :	98	98	98	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	-	-	-	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 2
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245171	245172	245173	245174
Test Number :	4	5	6	7
Sampling Method :	-	-	-	-
Date Sampled :	12/05/2018	12/05/2018	12/05/2018	12/05/2018
Date Tested :	12/05/2018	12/05/2018	12/05/2018	12/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9416.6 N 31372.3 RL 40.400 1m Below Final Level	E 9422.4 N 31402.9 RL 40.500 1.5m Below Final Level	E 9405.10 N 31416.0 RL 40.700 0.8m Below Final Level	E 9378.9 N 31427.7 RL 41.00 0.7m Below Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.8	12.7	15.5	17.4
Hilf MDR Number :	245171	245172	245173	245174
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99.5	99	103.5	110.5
Field Wet Density (t/m ³) :	2.184	2.147	2.069	2.079
Optimum Moisture Content (%) :	13.9	12.8	15.0	15.8
Moisture Variation :	0.1	0.1	-0.5	-1.6
Peak Converted Wet Density (t/m ³) :	2.132	2.195	2.138	2.140
Hilf Density Ratio (%) :	102.5	98.0	97.0	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169


Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 3
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245175		
Test Number :	8		
Sampling Method :	-		
Date Sampled :	12/05/2018		
Date Tested :	12/05/2018		
Material Type :	General Fill		
Material Source :	On Site		
Lot Number :	-		
Sample Location :	E 9358.9 N 31436.3 RL 41.300 0.7m Below Final Level		
Test Depth (mm) :	150		
Layer Depth (mm) :	-		
Maximum Size (mm) :	19		
Oversize Wet (%) :	-		
Oversize Dry (%) :	-		
Oversize Density (t/m ³) :	-		
Field Moisture Content (%) :	14.3		
Hilf MDR Number :	245175		
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1		
Compactive Effort :	Standard		
Field Density Method :	AS1289.5.8.1 & 5.7.1		
Moisture Method :	AS1289.2.1.1		
Moisture Ratio (%) :	97.5		
Field Wet Density (t/m ³) :	2.097		
Optimum Moisture Content (%) :	14.6		
Moisture Variation :	0.3		
Peak Converted Wet Density (t/m ³) :	2.147		
Hilf Density Ratio (%) :	97.5		
Minimum Specification :	95		
Moisture Specification :	-2% to +3%		
Site Selection :	-		
Soil Description :	-		
Remarks :	-		

 <p>Accredited for compliance with ISO/IEC 17025 - Testing.</p>	<p>APPROVED SIGNATORY</p> <p><i>Liam A Mcdowall</i></p> <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
	<p>Document Code RF89-11</p>



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 4
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245299	245300	
Test Number :	9	10	
Sampling Method :	-	-	
Date Sampled :	14/05/2018	14/05/2018	
Date Tested :	14/05/2018	14/05/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 9422.4 N 31371.7 RL 41.100 1m Below Final Level	E 9413.8 N 31415.7 RL 41.400 0.7m Below Final Level	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	15.1	11.8	
Hilf MDR Number :	245299	245300	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	99	102.5	
Field Wet Density (t/m ³) :	2.066	2.058	
Optimum Moisture Content (%) :	15.3	11.5	
Moisture Variation :	0.2	-0.3	
Peak Converted Wet Density (t/m ³) :	2.138	2.152	
Hilf Density Ratio (%) :	96.5	95.5	
Minimum Specification :	95	95	
Moisture Specification :	-	-	
Site Selection :	-	-	
Soil Description :	-	-	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A McOwll

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 5
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245406	245407	245408	245409
Test Number :	11	12	13	14
Sampling Method :	-	-	-	-
Date Sampled :	15/05/2018	15/05/2018	15/05/2018	15/05/2018
Date Tested :	15/05/2018	15/05/2018	15/05/2018	15/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9130.800 N 31385.700 RL 43.100	E 9112.500 N 31384.200 RL 43.500	E 9095.800 N 31404.800 RL 43.700	E 9080.200 N 31423.700 RL 44.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.2	11.5	6.8	7.2
Hilf MDR Number :	245406	245407	245408	245409
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	83	89	81	81
Field Wet Density (t/m ³) :	1.973	2.029	2.054	2.110
Optimum Moisture Content (%) :	9.9	13.0	8.4	8.9
Moisture Variation :	1.8	1.5	1.7	1.8
Peak Converted Wet Density (t/m ³) :	2.058	2.091	2.082	2.076
Hilf Density Ratio (%) :	96.0	97.0	98.5	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 6
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245410	245411	245412	245413
Test Number :	15	16	17	18
Sampling Method :	-	-	-	-
Date Sampled :	15/05/2018	15/05/2018	15/05/2018	15/05/2018
Date Tested :	15/05/2018	15/05/2018	15/05/2018	15/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9077.500 N 31404.900 RL 44.000	E 9098.900 N 31373.500 RL 43.800	E 9090.000 N 31380.000 RL 43.500	E 9070.000 N 31385.000 RL 43.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.7	11.6	12.9	14.1
Hilf MDR Number :	245410	245411	245412	245413
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99	94	100	100
Field Wet Density (t/m ³) :	2.090	2.029	2.050	2.060
Optimum Moisture Content (%) :	13.8	12.3	12.9	14.1
Moisture Variation :	0.1	0.7	0.0	0.0
Peak Converted Wet Density (t/m ³) :	2.124	2.115	2.146	2.103
Hilf Density Ratio (%) :	98.5	96.0	95.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 7
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245501	245502	245503	245504
Test Number :	19	20	21	22
Sampling Method :	-	-	-	-
Date Sampled :	16/05/2018	16/05/2018	16/05/2018	16/05/2018
Date Tested :	16/05/2018	16/05/2018	16/05/2018	16/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9039.200 N 31363.200 RL 43.800 3m Below Final Level	E 9039.900 N 31373.600 RL 43.600 3.5m Below Final Level	E 9072.900 N 31384.200 RL 43.500 2.6m Below Final Level	E 9087.500 N 31364.400 RL 43.700 3m Below Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.6	10.3	12.5	13.5
Hilf MDR Number :	245501	245502	245503	245504
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99	100	96.5	102
Field Wet Density (t/m ³) :	2.092	2.079	2.109	2.090
Optimum Moisture Content (%) :	10.7	10.3	12.9	13.2
Moisture Variation :	0.1	0.0	0.5	-0.2
Peak Converted Wet Density (t/m ³) :	2.164	2.162	2.096	2.164
Hilf Density Ratio (%) :	96.5	96.0	100.5	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 8
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245505	245506	245507	245508
Test Number :	23	24	25	26
Sampling Method :	-	-	-	-
Date Sampled :	16/05/2018	16/05/2018	16/05/2018	16/05/2018
Date Tested :	16/05/2018	16/05/2018	16/05/2018	16/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9056.600 N 31361.900 RL 44.000 2.4m Below Final Level	E 9070.500 N 31360.700 RL 43.900 2.8m Below Final Level	E 9058.700 N 31378.500 RL 43.700 2.7m Below Final Level	E 9045.900 N 31395.700 RL 43.800 2.9m Below Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.3	11.0	13.4	12.2
Hilf MDR Number :	245505	245506	245507	245508
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85	87	98.5	99.5
Field Wet Density (t/m ³) :	2.085	2.105	2.051	2.078
Optimum Moisture Content (%) :	11.0	12.6	13.6	12.3
Moisture Variation :	1.7	1.7	0.2	0.1
Peak Converted Wet Density (t/m ³) :	2.063	2.070	2.125	2.177
Hilf Density Ratio (%) :	101.0	101.5	96.5	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 9
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245509	245510	
Test Number :	27	28	
Sampling Method :	-	-	
Date Sampled :	16/05/2018	16/05/2018	
Date Tested :	16/05/2018	16/05/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Detention Basin Bund Wall Chainage 60 Centreline of Bund Wall Final Level	Detention Basin Bund Wall Chainage 120 Centreline of Bund Wall Final Level	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	12.1	10.7	
Hilf MDR Number :	245509	245510	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	98	96.5	
Field Wet Density (t/m ³) :	2.079	2.050	
Optimum Moisture Content (%) :	12.4	11.1	
Moisture Variation :	0.2	0.3	
Peak Converted Wet Density (t/m ³) :	2.153	2.148	
Hilf Density Ratio (%) :	96.5	95.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A McOwll

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 16
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245807	245808	245809	245810
Test Number :	48	49	50	51
Sampling Method :	-	-	-	-
Date Sampled :	21/05/2018	21/05/2018	21/05/2018	21/05/2018
Date Tested :	21/05/2018	21/05/2018	21/05/2018	21/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	WSUD Area E 9307.300 N 31374.400 RL 41.100	WSUD Area E 9346.700 N 31399.100 RL 40.200	WSUD Area E 9345.000 N 31415.000 RL 40.500	WSUD Area E 9276.700 N 31412.900 RL 40.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.3	11.7	11.5	13.9
Hilf MDR Number :	245807	245808	245809	245810
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	97.5	96	100
Field Wet Density (t/m ³) :	2.055	2.068	2.058	2.080
Optimum Moisture Content (%) :	13.3	12.0	12.0	13.9
Moisture Variation :	0.0	0.2	0.5	0.0
Peak Converted Wet Density (t/m ³) :	2.143	2.157	2.129	2.146
Hilf Density Ratio (%) :	96.0	96.0	96.5	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 10
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245613	245614	245615	245616
Test Number :	29	30	31	32
Sampling Method :	-	-	-	-
Date Sampled :	17/05/2018	17/05/2018	17/05/2018	17/05/2018
Date Tested :	17/05/2018	17/05/2018	17/05/2018	17/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9058.100 N 31409.200 RL 44.600	E 9074.600 N 31386.300 RL 44.200	E 9088.300 N 31367.800 RL 44.100	E 9071.100 N 31350.300 RL 44.700
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	19.3	12.1	15.2	15.4
Hilf MDR Number :	245613	245614	245615	245616
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	106.5	98	99	98.5
Field Wet Density (t/m ³) :	2.031	2.064	2.054	2.111
Optimum Moisture Content (%) :	18.1	12.3	15.3	15.6
Moisture Variation :	-1.2	0.2	0.1	0.2
Peak Converted Wet Density (t/m ³) :	2.098	2.154	2.148	2.145
Hilf Density Ratio (%) :	97.0	96.0	95.5	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 11
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245617	245618	245619	245620
Test Number :	33	34	35	36
Sampling Method :	-	-	-	-
Date Sampled :	17/05/2018	17/05/2018	17/05/2018	17/05/2018
Date Tested :	17/05/2018	17/05/2018	17/05/2018	17/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9058.000 N 31368.500 RL 44.600	E 9031.300 N 31394.600 RL 44.800	E 9024.800 N 31386.700 RL 44.500	E 9042.300 N 31361.100 RL 44.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.3	12.9	15.3	11.4
Hilf MDR Number :	245617	245618	245619	245620
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	99	99.5	87
Field Wet Density (t/m ³) :	2.084	2.080	2.100	2.063
Optimum Moisture Content (%) :	14.6	13.0	15.4	13.1
Moisture Variation :	0.3	0.1	0.1	1.8
Peak Converted Wet Density (t/m ³) :	2.133	2.131	2.117	2.137
Hilf Density Ratio (%) :	97.5	97.5	99.0	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 12
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245695	245696	245697	245698
Test Number :	37	38	39	40
Sampling Method :	-	-	-	-
Date Sampled :	18/05/2018	18/05/2018	18/05/2018	18/05/2018
Date Tested :	18/05/2018	18/05/2018	18/05/2018	18/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8945.100 N 31344.100 RL 44.900	E 8952.500 N 31334.000 RL 45.000	E 8952.000 N 31353.000 RL 44.800	E 8963.700 N 31339.500 RL 44.700
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.6	12.0	10.3	11.6
Hilf MDR Number :	245695	245696	245697	245698
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	82.5	96	88	97.5
Field Wet Density (t/m ³) :	2.069	2.088	2.109	2.105
Optimum Moisture Content (%) :	11.6	12.5	11.7	11.9
Moisture Variation :	2.0	0.6	1.5	0.3
Peak Converted Wet Density (t/m ³) :	2.088	2.126	2.117	2.133
Hilf Density Ratio (%) :	99.0	98.0	99.5	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY/Clayey SAND	Sandy CLAY/Clayey SAND	Sandy CLAY/Clayey SAND	Sandy CLAY/Clayey SAND
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 13
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245699		
Test Number :	41		
Sampling Method :	-		
Date Sampled :	18/05/2018		
Date Tested :	18/05/2018		
Material Type :	General Fill		
Material Source :	On Site		
Lot Number :	-		
Sample Location :	E 8994.746 N 31339.900 RL 44.800		
Test Depth (mm) :	150		
Layer Depth (mm) :	-		
Maximum Size (mm) :	19		
Oversize Wet (%) :	-		
Oversize Dry (%) :	-		
Oversize Density (t/m ³) :	-		
Field Moisture Content (%) :	10.6		
Hilf MDR Number :	245699		
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1		
Compactive Effort :	Standard		
Field Density Method :	AS1289.5.8.1 & 5.7.1		
Moisture Method :	AS1289.2.1.1		
Moisture Ratio (%) :	90		
Field Wet Density (t/m ³) :	2.108		
Optimum Moisture Content (%) :	11.8		
Moisture Variation :	1.2		
Peak Converted Wet Density (t/m ³) :	2.122		
Hilf Density Ratio (%) :	99.5		
Minimum Specification :	95		
Moisture Specification :	-2% to +3%		
Site Selection :	-		
Soil Description :	Sandy CLAY/Clayey SAND		
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 14
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245801	245802	245803	245804
Test Number :	42	43	44	45
Sampling Method :	-	-	-	-
Date Sampled :	21/05/2018	21/05/2018	21/05/2018	21/05/2018
Date Tested :	21/05/2018	21/05/2018	21/05/2018	21/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8974.200 N 31361.200 RL 44.700	E 8988.900 N 31339.800 RL 45.400	E 9015.200 N 31343.300 RL 45.200	E 9006.100 N 31360.600 RL 44.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.6	12.6	11.6	9.5
Hilf MDR Number :	245801	245802	245803	245804
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	99	96.5	84
Field Wet Density (t/m ³) :	2.087	2.080	2.069	2.075
Optimum Moisture Content (%) :	12.8	12.7	12.0	11.3
Moisture Variation :	0.2	0.1	0.5	1.8
Peak Converted Wet Density (t/m ³) :	2.141	2.159	2.130	2.117
Hilf Density Ratio (%) :	97.5	96.5	97.0	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 15
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/05/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245805	245806	
Test Number :	46	47	
Sampling Method :	-	-	
Date Sampled :	21/05/2018	21/05/2018	
Date Tested :	21/05/2018	21/05/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8982.800 N 31348.900 RL 45.500	E 8980.000 N 31340.000 RL 45.400	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	10.6	11.5	
Hilf MDR Number :	245805	245806	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	85	94.5	
Field Wet Density (t/m ³) :	2.059	2.077	
Optimum Moisture Content (%) :	12.5	12.2	
Moisture Variation :	1.9	0.7	
Peak Converted Wet Density (t/m ³) :	2.132	2.132	
Hilf Density Ratio (%) :	96.5	97.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Clayey SAND/Sandy CLAY	Clayey SAND/Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 17
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245970	245971	245972	245973
Test Number :	52	53	54	55
Sampling Method :	-	-	-	-
Date Sampled :	23/05/2018	23/05/2018	23/05/2018	23/05/2018
Date Tested :	23/05/2018	23/05/2018	23/05/2018	23/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9076.500 N 31383.500 RL 44.700	E 9068.300 N 31397.300 RL 44.800	E 9089.400 N 31413.600 RL 44.600	E 9081.900 N 31425.100 RL 44.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.5	11.4	11.5	12.8
Hilf MDR Number :	245970	245971	245972	245973
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99.5	88.5	88.5	101
Field Wet Density (t/m ³) :	2.059	2.058	2.057	2.125
Optimum Moisture Content (%) :	13.6	12.8	13.0	12.7
Moisture Variation :	0.1	1.5	1.5	-0.1
Peak Converted Wet Density (t/m ³) :	2.116	2.086	2.068	2.140
Hilf Density Ratio (%) :	97.5	98.5	99.5	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND/Sandy CLAY	Gravelly Clayey SAND/Sandy CLAY	Gravelly Clayey SAND/Sandy CLAY	Gravelly Clayey SAND/Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 18
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245974	245975	245976	
Test Number :	56	57	58	
Sampling Method :	-	-	-	
Date Sampled :	23/05/2018	23/05/2018	23/05/2018	
Date Tested :	23/05/2018	23/05/2018	23/05/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	E 8983.100 N 31335.100 RL 46.200	E 8972.800 N 31358.200 RL 45.800	E 8992.100 N 31316.400 RL 46.500	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	12.7	11.3	14.1	
Hilf MDR Number :	245974	245975	245976	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	104	86	103.5	
Field Wet Density (t/m ³) :	2.107	2.078	2.085	
Optimum Moisture Content (%) :	12.2	13.1	13.6	
Moisture Variation :	-0.5	1.9	-0.5	
Peak Converted Wet Density (t/m ³) :	2.182	2.135	2.129	
Hilf Density Ratio (%) :	96.5	97.5	98.0	
Minimum Specification :	95	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	Gravelly Clayey SAND/Sandy CLAY	Gravelly Clayey SAND/Sandy CLAY	Gravelly Clayey SAND/Sandy CLAY	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 19
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	245977	245978	245979	245980
Test Number :	59	60	61	62
Sampling Method :	-	-	-	-
Date Sampled :	23/05/2018	23/05/2018	23/05/2018	23/05/2018
Date Tested :	23/05/2018	23/05/2018	23/05/2018	23/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	WSUD Area E 9302.900 N 31419.600 RL 41.400	WSUD Area E 9310.700 N 31414.200 RL 41.200	WSUD Area E 9319.700 N 31394.800 RL 40.900	WSUD Area E 9325.1 N 31380.5 RL 41.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.8	13.5	12.9	10.7
Hilf MDR Number :	245977	245978	245979	245980
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98.5	99	99	99
Field Wet Density (t/m ³) :	2.109	2.180	2.160	2.139
Optimum Moisture Content (%) :	11.0	13.6	13.0	10.8
Moisture Variation :	0.1	0.1	0.1	0.1
Peak Converted Wet Density (t/m ³) :	2.148	2.183	2.159	2.145
Hilf Density Ratio (%) :	98.0	100.0	100.0	99.5
Minimum Specification :	98	98	98	98
Moisture Specification :	+ or - 2%	+ or - 2%	+ or - 2%	+ or - 2%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey Sand/Sandy CLAY	Gravelly Clayey Sand/Sandy CLAY	Gravelly Clayey Sand/Sandy CLAY	Gravelly Clayey Sand/Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 20
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246087	246088	
Test Number :	63	64	
Sampling Method :	-	-	
Date Sampled :	24/05/2018	24/05/2018	
Date Tested :	24/05/2018	24/05/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Future Pump Station E 9340.700 N 31391.000 RL 41.500	Future Pump Station E 9338.900 N 31375.100 RL 41.300	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	10.5	11.6	
Hilf MDR Number :	246087	246088	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	98	96.5	
Field Wet Density (t/m ³) :	2.119	2.130	
Optimum Moisture Content (%) :	10.7	12.0	
Moisture Variation :	0.2	0.5	
Peak Converted Wet Density (t/m ³) :	2.146	2.130	
Hilf Density Ratio (%) :	98.5	100.0	
Minimum Specification :	98	98	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Gravelly Clayey SAND/Sandy CLAY	Gravelly Clayey SAND/Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 21
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246167	246168	
Test Number :	65	66	
Sampling Method :	-	-	
Date Sampled :	25/05/2018	25/05/2018	
Date Tested :	25/05/2018	25/05/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Proposed Pump Station Pad E 9333.300 N 31405.100 RL 41.300	Proposed Pump Station Pad E 9329.500 N 31393.800 RL 41.500	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	12.2	13.8	
Hilf MDR Number :	246167	246168	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.4	AS1289.2.1.4	
Moisture Ratio (%) :	88	96	
Field Wet Density (t/m ³) :	2.160	2.149	
Optimum Moisture Content (%) :	13.8	14.4	
Moisture Variation :	1.7	0.6	
Peak Converted Wet Density (t/m ³) :	2.158	2.102	
Hilf Density Ratio (%) :	100.0	102.0	
Minimum Specification :	98	98	
Moisture Specification :	+ or - 2%	+ or - 2%	
Site Selection :	-	-	
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 22
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246169	246170	246171	246172
Test Number :	67	68	69	70
Sampling Method :	-	-	-	-
Date Sampled :	25/05/2018	25/05/2018	25/05/2018	25/05/2018
Date Tested :	25/05/2018	25/05/2018	25/05/2018	25/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9226.400 N 31474.000 RL 44.000	E 9239.600 N 31467.100 RL 43.500	E 9252.800 N 31472.600 RL 43.000	E 9270.000 N 31468.900 RL 43.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	16.5	15.1	14.6	15.2
Hilf MDR Number :	246169	246170	246171	246172
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	112	102	103.5	115
Field Wet Density (t/m ³) :	2.047	2.086	2.076	2.046
Optimum Moisture Content (%) :	14.7	14.8	14.1	13.2
Moisture Variation :	-1.7	-0.3	-0.5	-2.0
Peak Converted Wet Density (t/m ³) :	2.136	2.144	2.167	2.142
Hilf Density Ratio (%) :	96.0	97.5	96.0	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 23
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246173	246174	246175	246176
Test Number :	71	72	73	74
Sampling Method :	-	-	-	-
Date Sampled :	25/05/2018	25/05/2018	25/05/2018	25/05/2018
Date Tested :	25/05/2018	25/05/2018	25/05/2018	25/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9091.600 N 31434.900 RL 45.000	E 9093.200 N 31420.600 RL 44.800	E 9095.600 N 31404.600 RL 44.600	E 9097.600 N 31388.500 RL 44.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.3	11.9	14.7	15.3
Hilf MDR Number :	246173	246174	246175	246176
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99	101	101.5	102
Field Wet Density (t/m ³) :	2.060	2.082	2.054	2.071
Optimum Moisture Content (%) :	9.4	11.8	14.4	15.0
Moisture Variation :	0.1	-0.1	-0.2	-0.2
Peak Converted Wet Density (t/m ³) :	2.159	2.180	2.151	2.167
Hilf Density Ratio (%) :	95.5	95.5	95.5	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169


Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 24
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246177		
Test Number :	75		
Sampling Method :	-		
Date Sampled :	25/05/2018		
Date Tested :	25/05/2018		
Material Type :	General Fill		
Material Source :	On Site		
Lot Number :	-		
Sample Location :	E 9098.000 N 31374.700 RL 44.700		
Test Depth (mm) :	150		
Layer Depth (mm) :	-		
Maximum Size (mm) :	19		
Oversize Wet (%) :	-		
Oversize Dry (%) :	-		
Oversize Density (t/m ³) :	-		
Field Moisture Content (%) :	13.6		
Hilf MDR Number :	246177		
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1		
Compactive Effort :	Standard		
Field Density Method :	AS1289.5.8.1 & 5.7.1		
Moisture Method :	AS1289.2.1.1		
Moisture Ratio (%) :	98.5		
Field Wet Density (t/m ³) :	2.050		
Optimum Moisture Content (%) :	13.8		
Moisture Variation :	0.2		
Peak Converted Wet Density (t/m ³) :	2.138		
Hilf Density Ratio (%) :	96.0		
Minimum Specification :	95		
Moisture Specification :	-2% to +3%		
Site Selection :	-		
Soil Description :	Sandy CLAY		
Remarks :	-		

 <p>Accredited for compliance with ISO/IEC 17025 - Testing.</p>	<p>APPROVED SIGNATORY</p> <p><i>Liam A Mcdowall</i></p> <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
	<p>Document Code RF89-11</p>



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 25
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246192	246193	246194	
Test Number :	76	77	78	
Sampling Method :	-	-	-	
Date Sampled :	26/05/2018	26/05/2018	26/05/2018	
Date Tested :	26/05/2018	26/05/2018	26/05/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	Detention Basin Bund Wall Chainage 165 Centreline of Bund Wall Final Level	Detention Basin Bund Wall Chainage 105 Centreline of Bund Wall Final Level	Detention Basin Bund Wall Chainage 61 Centreline of Bund Wall Final Level	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	13.4	10.9	12.1	
Hilf MDR Number :	246192	246193	246194	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	104	88.5	97.5	
Field Wet Density (t/m ³) :	2.189	2.155	2.170	
Optimum Moisture Content (%) :	12.9	12.4	12.4	
Moisture Variation :	-0.5	1.5	0.3	
Peak Converted Wet Density (t/m ³) :	2.155	2.118	2.115	
Hilf Density Ratio (%) :	101.5	102.0	102.5	
Minimum Specification :	98	98	98	
Moisture Specification :	+ or - 2%	+ or - 2%	+ or - 2%	
Site Selection :	-	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 26
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	08/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246225	246226	246227	246228
Test Number :	79	80	81	82
Sampling Method :	-	-	-	-
Date Sampled :	28/05/2018	28/05/2018	28/05/2018	28/05/2018
Date Tested :	28/05/2018	28/05/2018	28/05/2018	28/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9068.600 N 31697.400 RL 46.600	E 9081.400 N 31672.200 RL 46.200	E 9039.700 N 31654.300 RL 47.700	E 9069.400 N 31630.100 RL 47.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	37.5	37.5	19	19
Oversize Wet (%) :	17	30	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.312	2.347	-	-
Field Moisture Content (%) :	13.8	11.8	12.1	13.1
Hilf MDR Number :	246225	246226	246227	246228
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98.5	88	102	102
Field Wet Density (t/m ³) :	2.156	2.165	2.065	2.046
Optimum Moisture Content (%) :	14.0	13.4	11.8	12.9
Moisture Variation :	0.2	1.5	-0.2	-0.2
Peak Converted Wet Density (t/m ³) :	2.182*	2.144*	2.166	2.147
Hilf Density Ratio (%) :	99.0	97.5	95.5	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Lab No. 246226 30.4% retained on 37.5mm sieve. Test performed on portion of sample up to 20% retained on the 37.5mm sieve.			

* - denotes adjusted for oversize

 NATA <small>WORLD RECOGNISED ACCREDITATION</small>	<p>Accredited for compliance with ISO/IEC 17025 - Testing.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 27
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246314	246315	246316	246317
Test Number :	83	84	85	86
Sampling Method :	-	-	-	-
Date Sampled :	29/05/2018	29/05/2018	29/05/2018	29/05/2018
Date Tested :	29/05/2018	29/05/2018	29/05/2018	29/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9069.200 N 31429.400 RL 46.000	E 9076.300 N 31419.100 RL 45.800	E 9082.800 N 31408.500 RL 45.600	E 9094.700 N 31390.300 RL 45.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.5	11.9	11.3	15.0
Hilf MDR Number :	246314	246315	246316	246317
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	101	87	86.5	103
Field Wet Density (t/m ³) :	2.070	2.040	2.001	2.051
Optimum Moisture Content (%) :	12.4	13.7	13.1	14.6
Moisture Variation :	-0.1	1.8	1.8	-0.5
Peak Converted Wet Density (t/m ³) :	2.120	2.062	2.061	2.137
Hilf Density Ratio (%) :	97.5	99.0	97.0	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 28
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246318	246319	246320	246321
Test Number :	87	88	89	90
Sampling Method :	-	-	-	-
Date Sampled :	29/05/2018	29/05/2018	29/05/2018	29/05/2018
Date Tested :	29/05/2018	29/05/2018	29/05/2018	29/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9039.900 N 31415.600 RL 45.600	E 9043.900 N 31399.800 RL 45.900	E 9052.400 N 31384.900 RL 45.900	E 9061.000 N 31369.300 RL 46.000
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	5.4	7.5	6.2	8.5
Hilf MDR Number :	246318	246319	246320	246321
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	101.5	101	98	100
Field Wet Density (t/m ³) :	1.969	1.894	1.796	1.864
Optimum Moisture Content (%) :	5.3	7.4	6.3	8.5
Moisture Variation :	-0.1	-0.1	0.1	0.0
Peak Converted Wet Density (t/m ³) :	2.121	2.111	2.091	2.133
Hilf Density Ratio (%) :	93.0	89.5	86.0	87.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 29
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246360	246361	246362	246363
Test Number :	91	92	93	94
Sampling Method :	-	-	-	-
Date Sampled :	30/05/2018	30/05/2018	30/05/2018	30/05/2018
Date Tested :	30/05/2018	30/05/2018	30/05/2018	30/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9039.900 N 31415.600 RL 45.600 Retest of Field Density No. 87 on the 29/05/18	E 9043.900 N 31399.800 RL 45.900 Retest of Field Density No. 88 on the 29/05/18	E 9052.400 N 31384.900 RL 45.900 Retest of Field Density No. 89 on the 29/05/18	E 9061.000 N 31369.300 RL 46.000 Retest of Field Density No. 90 on the 29/05/18
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.9	12.1	10.3	12.2
Hilf MDR Number :	246360	246361	246362	246363
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86.5	85	84.5	97.5
Field Wet Density (t/m ³) :	2.064	2.056	2.060	2.062
Optimum Moisture Content (%) :	13.8	14.3	12.2	12.5
Moisture Variation :	1.9	2.1	1.9	0.3
Peak Converted Wet Density (t/m ³) :	2.031	2.058	2.050	2.109
Hilf Density Ratio (%) :	101.5	100.0	100.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 30
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246364	246365	246366	246367
Test Number :	95	96	97	98
Sampling Method :	-	-	-	-
Date Sampled :	30/05/2018	30/05/2018	30/05/2018	30/05/2018
Date Tested :	30/05/2018	30/05/2018	30/05/2018	30/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9076.300 N 31351.300 RL 45.900	E 9063.100 N 31369.500 RL 45.800	E 9052.900 N 31383.200 RL 45.800	E 9043.300 N 31396.500 RL 45.800
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.2	12.4	11.9	12.4
Hilf MDR Number :	246364	246365	246366	246367
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	80	102	99	105
Field Wet Density (t/m ³) :	2.068	2.063	2.105	2.125
Optimum Moisture Content (%) :	10.2	12.2	12.0	11.8
Moisture Variation :	2.1	-0.2	0.1	-0.6
Peak Converted Wet Density (t/m ³) :	2.126	2.080	2.188	2.102
Hilf Density Ratio (%) :	97.5	99.0	96.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 31
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246442	246443	246444	246445
Test Number :	99	100	101	102
Sampling Method :	-	-	-	-
Date Sampled :	31/05/2018	31/05/2018	31/05/2018	31/05/2018
Date Tested :	31/05/2018	31/05/2018	31/05/2018	31/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8881.4 N 31406.300 RL 50.000	E 8892.400 N 31415.200 RL 50.200	E 8910.500 N 31429.700 RL 50.500	E 8906.700 N 31460.600 RL 52.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	6.2	5.6	16.9	12.8
Hilf MDR Number :	246442	246443	246444	246445
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84	73.5	97	92
Field Wet Density (t/m ³) :	2.134	2.069	2.100	2.030
Optimum Moisture Content (%) :	7.4	7.6	17.4	13.9
Moisture Variation :	1.2	2.1	0.5	1.1
Peak Converted Wet Density (t/m ³) :	2.145	2.066	2.076	2.073
Hilf Density Ratio (%) :	99.5	100.0	101.0	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 32
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246446	246447	246448	246449
Test Number :	103	104	105	106
Sampling Method :	-	-	-	-
Date Sampled :	31/05/2018	31/05/2018	31/05/2018	31/05/2018
Date Tested :	31/05/2018	31/05/2018	31/05/2018	31/05/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8940.900 N 31420.000 RL 48.700	E 8927.400 N 31410.300 RL 48.900	E 9025.600 N 31376.100 RL 45.700	E 9032.800 N 31361.100 RL 46.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.9	5.4	14.8	9.7
Hilf MDR Number :	246446	246447	246448	246449
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98.5	73	97.5	82.5
Field Wet Density (t/m ³) :	2.060	2.111	2.081	2.104
Optimum Moisture Content (%) :	9.0	7.4	15.2	11.8
Moisture Variation :	0.1	2.1	0.3	2.1
Peak Converted Wet Density (t/m ³) :	2.035	2.107	2.118	2.032
Hilf Density Ratio (%) :	101.0	100.0	98.0	103.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 33
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246450	246451	
Test Number :	107	108	
Sampling Method :	-	-	
Date Sampled :	31/05/2018	31/05/2018	
Date Tested :	31/05/2018	31/05/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 9039.900 N 31347.600 RL 46.500	E 9049.600 N 31329.700 RL 46.600	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	8.0	13.7	
Hilf MDR Number :	246450	246451	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	83	98	
Field Wet Density (t/m ³) :	2.088	2.191	
Optimum Moisture Content (%) :	9.6	14.0	
Moisture Variation :	1.7	0.3	
Peak Converted Wet Density (t/m ³) :	2.081	2.113	
Hilf Density Ratio (%) :	100.5	103.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	-	-	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 34
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246530	246531	246532	246533
Test Number :	109	110	111	112
Sampling Method :	-	-	-	-
Date Sampled :	1/06/2018	1/06/2018	1/06/2018	1/06/2018
Date Tested :	1/06/2018	1/06/2018	1/06/2018	1/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9116.000 N 31390.700 RL 45.600	E 9108.700 N 31379.600 RL 45.900	E 9088.300 N 31367.300 RL 46.200	E 9074.700 N 31356.100 RL 46.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.4	10.9	11.4	11.7
Hilf MDR Number :	246530	246531	246532	246533
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	101.5	86	99.5	102.5
Field Wet Density (t/m ³) :	2.074	2.036	2.075	2.056
Optimum Moisture Content (%) :	12.2	12.6	11.5	11.4
Moisture Variation :	-0.2	1.8	0.1	-0.2
Peak Converted Wet Density (t/m ³) :	2.140	2.092	2.134	2.145
Hilf Density Ratio (%) :	97.0	97.5	97.0	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 35
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	9/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246534	246535	246536	246537
Test Number :	113	114	115	116
Sampling Method :	-	-	-	-
Date Sampled :	1/06/2018	1/06/2018	1/06/2018	1/06/2018
Date Tested :	1/06/2018	1/06/2018	1/06/2018	1/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9057.600 N 31342.300 RL 46.700	E 9015.100 N 31348.600 RL 46.300	E 8996.000 N 31330.000 RL 46.700	E 8977.200 N 31327.800 RL 47.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.2	11.9	14.4	11.0
Hilf MDR Number :	246534	246535	246536	246537
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	97	89.5	99	102
Field Wet Density (t/m ³) :	2.100	2.050	2.068	2.088
Optimum Moisture Content (%) :	11.6	13.3	14.5	10.8
Moisture Variation :	0.3	1.3	0.1	-0.2
Peak Converted Wet Density (t/m ³) :	2.113	2.087	2.136	2.146
Hilf Density Ratio (%) :	99.5	98.0	97.0	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 36
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246636	246637	246638	246639
Test Number :	117	118	119	120
Sampling Method :	-	-	-	-
Date Sampled :	04/06/2018	04/06/2018	04/06/2018	04/06/2018
Date Tested :	04/06/2018	04/06/2018	04/06/2018	04/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9054.200 N 31394.900 RL 46.100	E 9030.400 N 31379.500 RL 46.500	E 9010.800 N 31351.600 RL 46.800	E 8991.700 N 31348.900 RL 46.800
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.4	12.9	8.4	11.5
Hilf MDR Number :	246636	246637	246638	246639
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	103	106	83.5	86.5
Field Wet Density (t/m ³) :	2.090	2.061	2.048	2.050
Optimum Moisture Content (%) :	11.0	12.2	10.1	13.3
Moisture Variation :	-0.3	-0.7	1.7	1.8
Peak Converted Wet Density (t/m ³) :	2.163	2.139	2.142	2.149
Hilf Density Ratio (%) :	96.5	96.5	95.5	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 37
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246640	246641	246642	246643
Test Number :	121	122	123	124
Sampling Method :	-	-	-	-
Date Sampled :	04/06/2018	04/06/2018	04/06/2018	04/06/2018
Date Tested :	04/06/2018	04/06/2018	04/06/2018	04/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8986.500 N 31333.300 RL 47.200	E 8959.700 N 31340.700 RL 47.300	E 8963.000 N 31367.000 RL 46.700	E 8983.100 N 31365.100 RL 46.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.5	12.2	10.0	18.0
Hilf MDR Number :	246640	246641	246642	246643
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	90	102	91.5	101
Field Wet Density (t/m ³) :	2.108	2.088	2.085	2.067
Optimum Moisture Content (%) :	12.8	12.0	10.9	17.8
Moisture Variation :	1.2	-0.2	0.9	-0.2
Peak Converted Wet Density (t/m ³) :	2.179	2.170	2.144	2.096
Hilf Density Ratio (%) :	96.5	96.0	97.0	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 38
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246644	246645	
Test Number :	125	126	
Sampling Method :	-	-	
Date Sampled :	04/06/2018	04/06/2018	
Date Tested :	04/06/2018	04/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 9012.900 N 31386.700 RL 46.300	E 9028.000 N 31430.500 RL 46.500	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	150	150	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	12.1	12.1	
Hilf MDR Number :	246644	246645	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	93.5	100	
Field Wet Density (t/m ³) :	2.113	2.080	
Optimum Moisture Content (%) :	12.9	12.1	
Moisture Variation :	0.8	0.0	
Peak Converted Wet Density (t/m ³) :	2.108	2.150	
Hilf Density Ratio (%) :	100.0	96.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 39
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246646	246647	246648	
Test Number :	127	128	129	
Sampling Method :	-	-	-	
Date Sampled :	04/06/2018	04/06/2018	04/06/2018	
Date Tested :	04/06/2018	04/06/2018	04/06/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	External Works E 8502.200 N 31868.900 RL 70.700	External Works E 8506.619 N 31823.700 RL 68.500	External Works E 8502.100 N 31805.300 RL 68.300	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	150	150	150	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	12.6	13.2	13.5	
Hilf MDR Number :	246646	246647	246648	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	89.5	100.5	100.5	
Field Wet Density (t/m ³) :	2.035	2.082	2.076	
Optimum Moisture Content (%) :	14.1	13.2	13.4	
Moisture Variation :	1.5	0.0	-0.1	
Peak Converted Wet Density (t/m ³) :	2.120	2.157	2.171	
Hilf Density Ratio (%) :	96.0	96.5	95.5	
Minimum Specification :	95	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 40
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246696	246697	246698	246699
Test Number :	130	131	132	133
Sampling Method :	-	-	-	-
Date Sampled :	05/06/2018	05/06/2018	05/06/2018	05/06/2018
Date Tested :	05/06/2018	05/06/2018	05/06/2018	05/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8920.000 N 31322.500 RL 47.900	E 8952.400 N 31346.600 RL 47.400	E 8981.400 N 31366.900 RL 46.800	E 9033.500 N 31368.500 RL 46.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.5	8.9	10.1	8.9
Hilf MDR Number :	246696	246697	246698	246699
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	83	84	98.5	84.5
Field Wet Density (t/m ³) :	2.040	2.080	2.089	2.109
Optimum Moisture Content (%) :	10.2	10.6	10.3	10.5
Moisture Variation :	1.8	1.8	0.2	1.7
Peak Converted Wet Density (t/m ³) :	2.132	2.080	2.092	2.102
Hilf Density Ratio (%) :	95.5	100.0	100.0	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 41
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246700	246701	246702	246703
Test Number :	134	135	136	137
Sampling Method :	-	-	-	-
Date Sampled :	05/06/2018	05/06/2018	05/06/2018	05/06/2018
Date Tested :	05/06/2018	05/06/2018	05/06/2018	05/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8954.400 N 31396.900 RL 47.300	E 8929.400 N 31382.000 RL 47.600	E 9047.800 N 31382.100 Final Level	E 9047.800 N 31382.100 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	13	10	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.530	2.608	-	-
Field Moisture Content (%) :	9.0	8.6	10.7	10.8
Hilf MDR Number :	246700	246701	246702	246703
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84	84	96	97.5
Field Wet Density (t/m ³) :	2.099	2.124	2.190	2.081
Optimum Moisture Content (%) :	10.7	10.2	11.1	11.1
Moisture Variation :	1.8	1.7	0.4	0.3
Peak Converted Wet Density (t/m ³) :	2.159*	2.143*	2.178	2.137
Hilf Density Ratio (%) :	97.0	99.0	100.5	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 42
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246704	246705	246706	246707
Test Number :	138	139	140	141
Sampling Method :	-	-	-	-
Date Sampled :	05/06/2018	05/06/2018	05/06/2018	05/06/2018
Date Tested :	05/06/2018	05/06/2018	05/06/2018	05/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8498.100 N 31803.700 RL 70.350 Final Level	E 8496.800 N 31782.20 RL 70.430 Final Level	E 8496.900 N 31768.180 RL 70.520 Final Level	E 8869.600 N 31539.000 RL 57.500 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.3	13.9	9.0	9.0
Hilf MDR Number :	246704	246705	246706	246707
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	88.5	83.5	83.5
Field Wet Density (t/m ³) :	2.076	2.056	2.092	2.103
Optimum Moisture Content (%) :	13.2	15.7	10.8	10.8
Moisture Variation :	-0.1	1.8	1.8	1.8
Peak Converted Wet Density (t/m ³) :	2.166	2.081	2.101	2.148
Hilf Density Ratio (%) :	96.0	99.0	99.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 43
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246708	246709	
Test Number :	142	143	
Sampling Method :	-	-	
Date Sampled :	05/06/2018	05/06/2018	
Date Tested :	05/06/2018	05/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8865.661 N 31506.900 RL 56.000 Final Level	E 8867.600 N 31478.500 RL 54.500 Final Level	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	150	150	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	10.1	12.4	
Hilf MDR Number :	246708	246709	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	85.5	88	
Field Wet Density (t/m ³) :	2.123	2.078	
Optimum Moisture Content (%) :	11.8	14.1	
Moisture Variation :	1.7	1.7	
Peak Converted Wet Density (t/m ³) :	2.096	2.109	
Hilf Density Ratio (%) :	101.5	98.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 44
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246789	246790	246791	246792
Test Number :	144	145	146	147
Sampling Method :	-	-	-	-
Date Sampled :	06/06/2018	06/06/2018	06/06/2018	06/06/2018
Date Tested :	06/06/2018	06/06/2018	06/06/2018	06/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 9009.400 N 31352.900 RL 47.500 / Final Level	Fill Area 2 E 9003.200 N 31360.000 RL 47.400 / Final Level	Fill Area 2 E 9011.400 N 31372.000 RL 47.100 / Final Level	Fill Area 2 E 9025.000 N 31363.000 RL 47.000 / Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.3	9.5	9.7	7.4
Hilf MDR Number :	246789	246790	246791	246792
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	97	97	84	81
Field Wet Density (t/m ³) :	2.076	2.107	2.080	2.083
Optimum Moisture Content (%) :	8.5	9.8	11.5	9.1
Moisture Variation :	0.2	0.3	1.9	1.8
Peak Converted Wet Density (t/m ³) :	2.110	2.108	2.117	2.126
Hilf Density Ratio (%) :	98.5	100.0	98.0	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 45
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246793	246794	246795	246796
Test Number :	148	149	150	151
Sampling Method :	-	-	-	-
Date Sampled :	06/06/2018	06/06/2018	06/06/2018	06/06/2018
Date Tested :	06/06/2018	06/06/2018	06/06/2018	06/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 9034.3 N 31372.400 RL 47.000 / Final Level	Fill Area 2 E 9026.8 N 31379.2 RL 47.000 / Final Level	Fill Area 2 E 9109.600 N 31327.200 RL 46.500	Fill Area 2 E 9086.500 N 31309.900 RL 47.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.1	10.3	8.6	7.1
Hilf MDR Number :	246793	246794	246795	246796
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	96.5	75.5	71
Field Wet Density (t/m ³) :	2.081	2.068	2.090	2.079
Optimum Moisture Content (%) :	9.3	10.7	11.4	10.0
Moisture Variation :	0.2	0.3	2.8	3.0
Peak Converted Wet Density (t/m ³) :	2.097	2.113	2.093	2.064
Hilf Density Ratio (%) :	99.0	98.0	100.0	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 46
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246797	246798	
Test Number :	152	153	
Sampling Method :	-	-	
Date Sampled :	06/06/2018	06/06/2018	
Date Tested :	06/06/2018	06/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 2 E 9073.300 N 31297.700 RL 48.200	Fill Area 2 E 9014.600 N 31285.400 RL 48.500	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	10.0	9.8	
Hilf MDR Number :	246797	246798	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	80.5	98.5	
Field Wet Density (t/m ³) :	2.105	2.090	
Optimum Moisture Content (%) :	12.4	10.0	
Moisture Variation :	2.4	0.1	
Peak Converted Wet Density (t/m ³) :	2.113	2.108	
Hilf Density Ratio (%) :	99.5	99.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	-	-	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 47
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246799	246800	246801	246802
Test Number :	154	155	156	157
Sampling Method :	-	-	-	-
Date Sampled :	06/06/2018	06/06/2018	06/06/2018	06/06/2018
Date Tested :	06/06/2018	06/06/2018	06/06/2018	06/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8627.900 N 31783.200 RL 59.500	Fill Area 1 E 8616.300 N 31767.300 RL 59.600	Fill Area 1 E 8612.500 N 31790.100 RL 60.300	Fill Area 1 E 8561.400 N 31782.100 RL 63.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.1	8.8	11.1	8.2
Hilf MDR Number :	246799	246800	246801	246802
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	102.5	76.5	102	76
Field Wet Density (t/m ³) :	2.081	2.066	2.093	2.056
Optimum Moisture Content (%) :	8.9	11.5	10.9	10.8
Moisture Variation :	-0.2	2.8	-0.2	2.6
Peak Converted Wet Density (t/m ³) :	2.121	2.078	2.078	2.101
Hilf Density Ratio (%) :	98.0	99.5	100.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 48
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246803	246804	
Test Number :	158	159	
Sampling Method :	-	-	
Date Sampled :	06/06/2018	06/06/2018	
Date Tested :	06/06/2018	06/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 1 E 8553.600 N 31803.500 RL 64.100	Fill Area 1 E 8552.500 N 31783.700 RL 64.100	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	9.0	12.4	
Hilf MDR Number :	246803	246804	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	78	99	
Field Wet Density (t/m ³) :	2.042	2.060	
Optimum Moisture Content (%) :	11.5	12.5	
Moisture Variation :	2.6	0.1	
Peak Converted Wet Density (t/m ³) :	2.074	2.127	
Hilf Density Ratio (%) :	98.5	97.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	-	-	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 49
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246923	246924	246925	246926
Test Number :	160	161	162	163
Sampling Method :	-	-	-	-
Date Sampled :	11/06/2018	11/06/2018	11/06/2018	11/06/2018
Date Tested :	11/06/2018	11/06/2018	11/06/2018	11/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8545.200 N 31776.100 RL 60.900	Fill Area 1 E 8551.300 N 31778.000 RL 64.300	Fill Area 1 E 8540.900 N 31796.500 RL 64.800	Fill Area 1 E 8537.500 N 31815.900 RL 65.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.5	16.5	10.5	10.9
Hilf MDR Number :	246923	246924	246925	246926
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99.5	101	98	97
Field Wet Density (t/m ³) :	2.056	2.121	2.066	2.154
Optimum Moisture Content (%) :	13.6	16.4	10.7	11.3
Moisture Variation :	0.1	-0.1	0.2	0.3
Peak Converted Wet Density (t/m ³) :	2.122	2.074	2.116	2.174
Hilf Density Ratio (%) :	97.0	102.5	97.5	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 50
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246927	246928	246929	246930
Test Number :	164	165	166	167
Sampling Method :	-	-	-	-
Date Sampled :	11/06/2018	11/06/2018	11/06/2018	11/06/2018
Date Tested :	11/06/2018	11/06/2018	11/06/2018	11/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 9060.600 N 31288.500 RL 48.900	Fill Area 2 E 9048.600 N 31298.600 RL 48.900	Fill Area 2 E 9061.500 N 31312.100 RL 48.500	Fill Area 2 E 9101.300 N 31346.000 RL 46.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.1	9.0	9.5	11.1
Hilf MDR Number :	246927	246928	246929	246930
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85.5	83.5	85	86
Field Wet Density (t/m ³) :	2.115	2.077	2.085	2.062
Optimum Moisture Content (%) :	11.8	10.8	11.2	12.9
Moisture Variation :	1.7	1.8	1.7	1.8
Peak Converted Wet Density (t/m ³) :	2.115	2.128	2.098	2.104
Hilf Density Ratio (%) :	100.0	97.5	99.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 51
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246931	246932	
Test Number :	168	169	
Sampling Method :	-	-	
Date Sampled :	11/06/2018	11/06/2018	
Date Tested :	11/06/2018	11/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 2 E 9101.800 N 31320.200 RL 46.800	Fill Area 2 E 9053.800 N 31276.000 RL 49.000	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	150	150	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	12.7	10.4	
Hilf MDR Number :	246931	246932	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	90.5	85.5	
Field Wet Density (t/m ³) :	2.085	2.068	
Optimum Moisture Content (%) :	14.0	12.1	
Moisture Variation :	1.4	1.8	
Peak Converted Wet Density (t/m ³) :	2.071	2.089	
Hilf Density Ratio (%) :	100.5	99.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 52
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	246933	246934	246935	246936
Test Number :	170	171	172	173
Sampling Method :	-	-	-	-
Date Sampled :	11/06/2018	11/06/2018	11/06/2018	11/06/2018
Date Tested :	11/06/2018	11/06/2018	11/06/2018	11/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8580.700 N 31802.400 RL 59.800	Fill Area 1 E 8591.500 N 31783.000 RL 61.800	Fill Area 1 E 8582.000 N 31759.000 RL 59.900	Fill Area 1 E 8582.300 N 31741.900 RL 61.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.4	12.7	9.4	11.4
Hilf MDR Number :	246933	246934	246935	246936
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	90.5	93	96.5	88
Field Wet Density (t/m ³) :	2.052	2.062	1.983	2.075
Optimum Moisture Content (%) :	15.9	13.7	9.8	13.0
Moisture Variation :	1.5	1.0	0.3	1.6
Peak Converted Wet Density (t/m ³) :	2.100	2.075	2.034	2.022
Hilf Density Ratio (%) :	97.5	99.5	97.5	102.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 53
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247010	247011	247012	247013
Test Number :	174	175	176	177
Sampling Method :	-	-	-	-
Date Sampled :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Date Tested :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 8933.200 N 31394.200 RL 48.000	Fill Area 2 E 8943.200 N 31402.200 RL 48.500	Fill Area 2 E 8920.900 N 31390.000 RL 48.600	Fill Area 2 E 8911.600 N 31381.700 RL 48.800
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	12	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.508	-	-	-
Field Moisture Content (%) :	9.5	11.6	9.8	8.5
Hilf MDR Number :	247010	247011	247012	247013
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	83.5	87	86.5	83
Field Wet Density (t/m ³) :	2.085	2.133	2.098	2.120
Optimum Moisture Content (%) :	11.4	13.4	11.3	10.2
Moisture Variation :	1.9	1.8	1.6	1.8
Peak Converted Wet Density (t/m ³) :	2.159*	2.085	2.049	2.084
Hilf Density Ratio (%) :	96.5	102.5	102.5	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 54
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247014	247015	247016	247017
Test Number :	178	179	180	181
Sampling Method :	-	-	-	-
Date Sampled :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Date Tested :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8624.900 N 31731.700 RL 60.400	Fill Area 1 E 8626.100 N 31756.500 RL 59.900	Fill Area 1 E 8616.700 N 31741.500 RL 60.800	Fill Area 1 E 8611.300 N 31756.200 RL 61.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.7	11.6	12.1	11.2
Hilf MDR Number :	247014	247015	247016	247017
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98.5	99.5	96.5	102
Field Wet Density (t/m ³) :	2.104	2.095	2.125	2.079
Optimum Moisture Content (%) :	11.9	11.6	12.5	11.0
Moisture Variation :	0.2	0.0	0.5	-0.2
Peak Converted Wet Density (t/m ³) :	2.131	2.084	2.032	2.126
Hilf Density Ratio (%) :	98.5	100.5	104.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 55
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247018	247019	247020	247021
Test Number :	182	183	184	185
Sampling Method :	-	-	-	-
Date Sampled :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Date Tested :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 8950.400 N 31395.600 Final Level	Fill Area 2 E 8926.300 N 31377.500 Final Level	Fill Area 2 E 8916.500 N 31384.900 Final Level	Fill Area 2 E 8935.000 N 31399.000 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	8	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.520	-	-
Field Moisture Content (%) :	9.8	10.1	10.6	9.6
Hilf MDR Number :	247018	247019	247020	247021
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85	86	86	85
Field Wet Density (t/m ³) :	2.113	2.082	2.104	2.091
Optimum Moisture Content (%) :	11.5	11.7	12.3	11.3
Moisture Variation :	1.8	1.7	1.8	1.7
Peak Converted Wet Density (t/m ³) :	2.051	2.159*	2.103	2.021
Hilf Density Ratio (%) :	103.0	96.5	100.0	103.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam McDowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 56
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	22/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-337250
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247022	247023	247024	247025
Test Number :	186	187	188	189
Sampling Method :	-	-	-	-
Date Sampled :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Date Tested :	12/06/2018	12/06/2018	12/06/2018	12/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8545.426 N 31786.990 RL 64.922	Fill Area 1 E 8552.804 N 31786.512 RL 64.664	Fill Area 1 E 8551.670 N 31757.758 RL 65.231	Fill Area 1 E 8544.199 N 31754.577 RL 65.828
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.1	13.1	14.2	14.4
Hilf MDR Number :	247022	247023	247024	247025
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	97	96	100
Field Wet Density (t/m ³) :	2.060	2.100	2.050	2.045
Optimum Moisture Content (%) :	10.0	13.5	14.8	14.4
Moisture Variation :	-0.1	0.3	0.6	0.0
Peak Converted Wet Density (t/m ³) :	2.033	2.077	1.967	2.029
Hilf Density Ratio (%) :	101.5	101.0	104.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 57
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	26/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247157	247158	247159	247160
Test Number :	190	191	192	193
Sampling Method :	-	-	-	-
Date Sampled :	13/06/2018	13/06/2018	13/06/2018	13/06/2018
Date Tested :	13/06/2018	13/06/2018	13/06/2018	13/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 9099.800 N 31335.300 RL 47.300	Fill Area 2 E 9081.700 N 31319.400 RL 48.200	Fill Area 2 E 9067.000 N 31308.200 RL 48.800	Fill Area 2 E 9048.400 N 31294.800 RL 49.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	10	13	13	12
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.412	2.339	2.340	2.302
Field Moisture Content (%) :	9.8	10.1	11.5	10.2
Hilf MDR Number :	247157	247158	247159	247160
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85	84.5	86.5	90
Field Wet Density (t/m ³) :	2.075	2.120	2.197	2.197
Optimum Moisture Content (%) :	11.6	12.0	13.3	11.3
Moisture Variation :	1.8	1.9	1.8	1.1
Peak Converted Wet Density (t/m ³) :	2.171*	2.173*	2.19*	2.204*
Hilf Density Ratio (%) :	95.5	97.5	100.5	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 58
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	26/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247161	247162	247163	247164
Test Number :	194	195	196	197
Sampling Method :	-	-	-	-
Date Sampled :	13/06/2018	13/06/2018	13/06/2018	13/06/2018
Date Tested :	13/06/2018	13/06/2018	13/06/2018	13/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8602.300 N 31743.000 RL 61.087	Fill Area 1 E 8618.500 N 31747.600 RL 61.000	Fill Area 1 E 8612.700 N 31776.400 RL 61.200	Fill Area 1 E 8584.800 N 31686.224 RL 65.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	10
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	2.331
Field Moisture Content (%) :	19.9	17.5	18.6	12.1
Hilf MDR Number :	247161	247162	247163	247164
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99.5	100	99.5	87
Field Wet Density (t/m ³) :	2.019	2.051	2.056	2.115
Optimum Moisture Content (%) :	20.0	17.5	18.7	13.9
Moisture Variation :	0.1	0.0	0.1	1.8
Peak Converted Wet Density (t/m ³) :	2.061	2.064	2.060	2.136*
Hilf Density Ratio (%) :	98.0	99.5	100.0	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 59
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	26/06/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247165	247166	
Test Number :	198	199	
Sampling Method :	-	-	
Date Sampled :	13/06/2018	13/06/2018	
Date Tested :	13/06/2018	13/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 1 E 8608.300 N 31680.500 RL 63.900	Fill Area 1 E 8627.600 N 31684.900 RL 62.200	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	150	150	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	2.368	-	
Field Moisture Content (%) :	17.7	13.7	
Hilf MDR Number :	247165	247166	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	99	87.5	
Field Wet Density (t/m ³) :	2.050	2.091	
Optimum Moisture Content (%) :	17.9	15.6	
Moisture Variation :	0.2	1.9	
Peak Converted Wet Density (t/m ³) :	2.103	2.075	
Hilf Density Ratio (%) :	97.5	101.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 60
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247218	247219	247220	247221
Test Number :	200	201	202	203
Sampling Method :	-	-	-	-
Date Sampled :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Date Tested :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8611.900 N 31738.500 RL 61.400	Fill Area 1 E 8606.200 N 31727.400 RL 62.000	Fill Area 1 E 8641.900 N 31729.500 RL 57.500	Fill Area 1 E 8621.000 N 31725.300 RL 59.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	20.3	17.3	19.2	12.6
Hilf MDR Number :	247218	247219	247220	247221
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	106	106	105	90
Field Wet Density (t/m ³) :	1.949	2.036	2.013	2.062
Optimum Moisture Content (%) :	19.1	16.3	18.3	14.0
Moisture Variation :	-1.2	-0.9	-0.8	1.5
Peak Converted Wet Density (t/m ³) :	1.984	2.066	1.997	2.094
Hilf Density Ratio (%) :	98.0	98.5	101.0	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 61
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247222	247223	247224	247225
Test Number :	204	205	206	207
Sampling Method :	-	-	-	-
Date Sampled :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Date Tested :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 9076.900 N 31320.900 RL 48.400 (Final Level)	Fill Area 2 E 9064.300 N 31294.000 RL 49.400 (Final Level)	Fill Area 2 E 9115.300 N 31345.700 Final Level	Fill Area 2 E 9134.900 N 31369.000 RL 47.500 (Final Level)
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	150	150	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	7	5	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.489	2.465	-
Field Moisture Content (%) :	11.2	8.6	10.3	12.2
Hilf MDR Number :	247222	247223	247224	247225
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	83.5	99	99	85.5
Field Wet Density (t/m ³) :	2.107	2.159	2.159	2.076
Optimum Moisture Content (%) :	13.4	8.7	10.4	14.3
Moisture Variation :	2.2	0.1	0.1	2.1
Peak Converted Wet Density (t/m ³) :	2.099	2.151*	2.138*	2.090
Hilf Density Ratio (%) :	100.5	100.5	101.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 62
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247226	247227	247228	247229
Test Number :	208	209	210	211
Sampling Method :	-	-	-	-
Date Sampled :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Date Tested :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8603.500 N 31713.400 RL 57.700	Fill Area 1 E 8684.600 N 31722.300 RL 57.700	Fill Area 1 E 8666.600 N 31726.400 RL 58.500	Fill Area 1 E 8669.100 N 31713.400 RL 58.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	5	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.125	-	-	-
Field Moisture Content (%) :	15.8	14.9	12.5	14.0
Hilf MDR Number :	247226	247227	247228	247229
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	93.5	90.5	85	97
Field Wet Density (t/m ³) :	2.177	2.060	2.049	2.061
Optimum Moisture Content (%) :	16.9	16.5	14.7	14.4
Moisture Variation :	1.1	1.6	2.2	0.5
Peak Converted Wet Density (t/m ³) :	2.064*	2.054	2.061	2.059
Hilf Density Ratio (%) :	105.5	100.5	99.5	100.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 63
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247230	247231	247232	247233
Test Number :	212	213	214	215
Sampling Method :	-	-	-	-
Date Sampled :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Date Tested :	14/06/2018	14/06/2018	14/06/2018	14/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 8969.200 N 31390.600 Final Level	Fill Area 2 E 8954.600 N 31381.000 RL 47.500	Fill Area 2 E 8954.300 N 31354.300 Final Level	Fill Area 2 E 8964.900 N 31344.000 RL 48.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	5	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	1.999	-	-	-
Field Moisture Content (%) :	11.6	11.7	11.6	8.7
Hilf MDR Number :	247230	247231	247232	247233
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	91.5	99	91.5	85.5
Field Wet Density (t/m ³) :	2.168	2.085	2.106	2.093
Optimum Moisture Content (%) :	12.7	11.8	12.7	10.2
Moisture Variation :	1.1	0.1	1.1	1.5
Peak Converted Wet Density (t/m ³) :	2.113*	2.140	2.111	2.112
Hilf Density Ratio (%) :	102.5	97.5	100.0	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC


Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 64
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247234	247235	
Test Number :	216	217	
Sampling Method :	-	-	
Date Sampled :	14/06/2018	14/06/2018	
Date Tested :	14/06/2018	14/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 2 E 8975.200 N 31335.500 Final Level	Fill Area 2 E 8985.400 N 31325.500 RL 48.000	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	150	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	5	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	2.094	-	
Field Moisture Content (%) :	9.3	9.4	
Hilf MDR Number :	247234	247235	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	87.5	98	
Field Wet Density (t/m ³) :	2.119	2.087	
Optimum Moisture Content (%) :	10.6	9.6	
Moisture Variation :	1.4	0.2	
Peak Converted Wet Density (t/m ³) :	2.052*	2.092	
Hilf Density Ratio (%) :	103.0	100.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.		

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025 - Testing.</p>	<p>APPROVED SIGNATORY</p> <p><i>Liam A Mcdowall</i></p> <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
	<p>Document Code RF89-11</p>



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 65
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247264	247265	247266	247267
Test Number :	218	219	220	221
Sampling Method :	-	-	-	-
Date Sampled :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Date Tested :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 8978.100 N 31364.700 RL 48.600	Fill Area 2 E 8984.700 N 31376.600 RL 48.500	Fill Area 2 E 9007.3 N 31398.2 RL 48.300	Fill Area 2 E 8995.900 N 31386.000 RL 48.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	6.4	10.4	8.7	10.4
Hilf MDR Number :	247264	247265	247266	247267
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	104	103.5	100.5	102.5
Field Wet Density (t/m ³) :	2.104	2.129	2.105	2.089
Optimum Moisture Content (%) :	6.1	10.0	8.7	10.1
Moisture Variation :	-0.2	-0.3	0.0	-0.2
Peak Converted Wet Density (t/m ³) :	2.146	2.164	2.137	2.154
Hilf Density Ratio (%) :	98.0	98.5	98.5	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 66
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247268	247269	247270	247271
Test Number :	222	223	224	225
Sampling Method :	-	-	-	-
Date Sampled :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Date Tested :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8650.000 N 31730.000 RL 59.600	Fill Area 1 E 8668.000 N 31729.000 RL 58.600	Fill Area 1 E 8681.000 N 31727.000 RL 58.200	Fill Area 1 E 8695.000 N 31726.000 RL 57.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	17.4	15.4	17.5	18.1
Hilf MDR Number :	247268	247269	247270	247271
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	98.5	100.5	100.5
Field Wet Density (t/m ³) :	2.016	2.046	2.069	2.047
Optimum Moisture Content (%) :	17.3	15.6	17.4	18.0
Moisture Variation :	-0.1	0.2	-0.1	-0.1
Peak Converted Wet Density (t/m ³) :	2.058	2.049	2.071	2.058
Hilf Density Ratio (%) :	98.0	100.0	100.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 67
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247272	247273	247274	247275
Test Number :	226	227	228	229
Sampling Method :	-	-	-	-
Date Sampled :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Date Tested :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8705.000 N 31725.000 RL 57.300	Fill Area 1 E 8717.000 N 31724.000 RL 56.900	Fill Area 1 E 8726.000 N 31723.000 RL 56.600	Fill Area 1 E 8736.200 N 31723.000 RL 56.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	15.0	15.8	14.7	13.1
Hilf MDR Number :	247272	247273	247274	247275
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	91.5	101	97
Field Wet Density (t/m ³) :	2.094	2.012	2.096	2.100
Optimum Moisture Content (%) :	14.9	17.3	14.6	13.5
Moisture Variation :	-0.1	1.5	-0.1	0.3
Peak Converted Wet Density (t/m ³) :	2.114	2.084	2.110	2.076
Hilf Density Ratio (%) :	99.0	96.5	99.5	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 68
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247276	247277	247278	247279
Test Number :	230	231	232	233
Sampling Method :	-	-	-	-
Date Sampled :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Date Tested :	15/06/2018	15/06/2018	15/06/2018	15/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8600.700 N 31685.000 RL 64.500	Fill Area 1 E 8588.600 N 31692.000 RL 65.200	Fill Area 1 E 8603.300 N 31697.000 RL 63.900	Fill Area 1 E 8629.800 N 31697.100 RL 61.800
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.1	12.2	9.6	13.6
Hilf MDR Number :	247276	247277	247278	247279
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	96.5	92	100.5
Field Wet Density (t/m ³) :	2.101	2.080	2.061	2.059
Optimum Moisture Content (%) :	14.4	12.6	10.4	13.5
Moisture Variation :	0.3	0.5	0.9	-0.1
Peak Converted Wet Density (t/m ³) :	2.137	2.125	2.141	2.128
Hilf Density Ratio (%) :	98.5	98.0	96.5	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 69
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247301	247302	247303	247304
Test Number :	234	235	236	237
Sampling Method :	-	-	-	-
Date Sampled :	16/06/2018	16/06/2018	16/06/2018	16/06/2018
Date Tested :	16/06/2018	16/06/2018	16/06/2018	16/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8639.000 N 31693.000 RL 61.300	Fill Area 1 E 8625.000 N 31694.000 RL 62.100	Fill Area 1 E 8612.200 N 31695.000 RL 63.300	Fill Area 1 E 8639.000 N 31703.600 RL 60.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	31.2	17.6	13.2	13.6
Hilf MDR Number :	247301	247302	247303	247304
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	102.5	101.5	97.5	103
Field Wet Density (t/m ³) :	2.143	2.080	2.095	2.100
Optimum Moisture Content (%) :	30.5	17.4	13.6	13.2
Moisture Variation :	-0.6	-0.2	0.3	-0.5
Peak Converted Wet Density (t/m ³) :	2.086	2.060	2.027	2.045
Hilf Density Ratio (%) :	102.5	101.0	103.5	102.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 70
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247305	247306	
Test Number :	238	239	
Sampling Method :	-	-	
Date Sampled :	16/06/2018	16/06/2018	
Date Tested :	16/06/2018	16/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 1 E 8620.000 N 31704.000 RL 62.000	Fill Area 1 E 8603.000 N 31704.000 RL 63.200	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	150	150	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	17.7	28.1	
Hilf MDR Number :	247305	247306	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	105	101.5	
Field Wet Density (t/m ³) :	2.062	2.100	
Optimum Moisture Content (%) :	16.9	27.6	
Moisture Variation :	-0.8	-0.5	
Peak Converted Wet Density (t/m ³) :	2.072	2.090	
Hilf Density Ratio (%) :	99.5	100.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 71
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247349	247350	247351	247352
Test Number :	240	241	242	243
Sampling Method :	-	-	-	-
Date Sampled :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Date Tested :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8629.000 N 31699.000 RL 61.800	Fill Area 1 E 8644.000 N 31699.000 RL 60.800	Fill Area 1 E 8660.900 N 31700.000 RL 60.000	Fill Area 1 E 8671.000 N 31701.000 RL 59.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	10
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	2.119
Field Moisture Content (%) :	11.2	12.0	12.8	12.8
Hilf MDR Number :	247349	247350	247351	247352
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	88	88.5	99.5	99.5
Field Wet Density (t/m ³) :	2.094	2.051	2.138	2.170
Optimum Moisture Content (%) :	12.8	13.5	12.9	12.9
Moisture Variation :	1.6	1.6	0.1	0.1
Peak Converted Wet Density (t/m ³) :	2.116	2.102	2.136	2.141*
Hilf Density Ratio (%) :	99.0	97.5	100.0	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 72
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247353	247354	247355	247356
Test Number :	244	245	246	247
Sampling Method :	-	-	-	-
Date Sampled :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Date Tested :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8684.000 N 31701.000 RL 58.900	Fill Area 1 E 8867.200 N 31652.000 RL 53.000	Fill Area 1 E 8853.000 N 31677.000 RL 52.600	Fill Area 1 E 8876.000 N 31670.000 RL 52.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	10	9
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	2.035	2.096
Field Moisture Content (%) :	12.1	10.3	9.3	10.4
Hilf MDR Number :	247353	247354	247355	247356
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	86.5	88	86.5
Field Wet Density (t/m ³) :	2.060	2.070	2.156	2.146
Optimum Moisture Content (%) :	12.3	11.9	10.6	12.0
Moisture Variation :	0.2	1.7	1.3	1.7
Peak Converted Wet Density (t/m ³) :	2.108	2.095	2.133*	2.132*
Hilf Density Ratio (%) :	97.5	99.0	101.0	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 73
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247357	247358	247359	247360
Test Number :	248	249	250	251
Sampling Method :	-	-	-	-
Date Sampled :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Date Tested :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 9066.940 N 31451.180 RL 47.310	E 9056.940 N 31457.700 RL 47.450	E 8649.000 N 31720.000 RL 59.800	E 8659.000 N 31720.000 RL 59.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.2	13.5	13.0	12.7
Hilf MDR Number :	247357	247358	247359	247360
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	94.5	96	99	90.5
Field Wet Density (t/m ³) :	2.051	2.065	2.078	2.120
Optimum Moisture Content (%) :	11.8	14.0	13.2	14.0
Moisture Variation :	0.7	0.6	0.1	1.3
Peak Converted Wet Density (t/m ³) :	2.097	2.157	2.146	2.101
Hilf Density Ratio (%) :	98.0	95.5	97.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 74
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247361	247362	247363	247364
Test Number :	252	253	254	255
Sampling Method :	-	-	-	-
Date Sampled :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Date Tested :	18/06/2018	18/06/2018	18/06/2018	18/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8669.000 N 31721.000 RL 58.800	E 8678.600 N 31721.000 RL 58.500	E 8694.000 N 31722.000 RL 57.900	E 8837.400 N 31667.000 RL 54.000
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.4	11.3	11.0	9.9
Hilf MDR Number :	247361	247362	247363	247364
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	88	85	85.5
Field Wet Density (t/m ³) :	2.077	2.132	2.121	2.121
Optimum Moisture Content (%) :	11.4	12.8	12.9	11.6
Moisture Variation :	0.0	1.6	1.9	1.7
Peak Converted Wet Density (t/m ³) :	2.087	2.119	2.138	2.128
Hilf Density Ratio (%) :	99.5	100.5	99.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 75
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247365	247366	
Test Number :	256	257	
Sampling Method :	-	-	
Date Sampled :	18/06/2018	18/06/2018	
Date Tested :	18/06/2018	18/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8856.000 N 31664.300 RL 53.200	E 8879.100 N 31655.600 RL 53.200	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	11.9	8.8	
Hilf MDR Number :	247365	247366	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	99	83.5	
Field Wet Density (t/m ³) :	2.085	2.099	
Optimum Moisture Content (%) :	12.0	10.6	
Moisture Variation :	0.1	1.8	
Peak Converted Wet Density (t/m ³) :	2.175	2.055	
Hilf Density Ratio (%) :	96.0	102.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 76
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247465	247466	247467	247468
Test Number :	258	259	260	261
Sampling Method :	-	-	-	-
Date Sampled :	19/06/2018	19/06/2018	19/06/2018	19/06/2018
Date Tested :	19/06/2018	19/06/2018	19/06/2018	19/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8589.000 N 31763.000 RL 65.600	Fill Area 1 E 8594.000 N 31672.000 RL 65.300	Fill Area 1 E 8603.300 N 31671.200 RL 65.000	Fill Area 1 E 8609.900 N 31670.600 RL 64.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	15.0	13.9	13.7	15.4
Hilf MDR Number :	247465	247466	247467	247468
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	99.5	97.5	102.5
Field Wet Density (t/m ³) :	2.092	2.112	2.093	2.125
Optimum Moisture Content (%) :	15.3	13.9	14.1	15.0
Moisture Variation :	0.3	0.0	0.3	-0.3
Peak Converted Wet Density (t/m ³) :	2.133	2.136	2.112	2.160
Hilf Density Ratio (%) :	98.0	99.0	99.0	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 77
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247469	247470	247471	247472
Test Number :	262	263	264	265
Sampling Method :	-	-	-	-
Date Sampled :	19/06/2018	19/06/2018	19/06/2018	19/06/2018
Date Tested :	19/06/2018	19/06/2018	19/06/2018	19/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8619.800 N 31669.000 RL 64.000	Fill Area 1 E 8841.000 N 31683.000 RL 54.000	Fill Area 1 E 8858.000 N 31677.300 RL 53.700	Fill Area 1 E 8872.500 N 31670.900 RL 53.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.3	10.0	9.9	9.9
Hilf MDR Number :	247469	247470	247471	247472
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	81	84	84
Field Wet Density (t/m ³) :	2.064	2.113	2.133	2.182
Optimum Moisture Content (%) :	14.3	12.4	11.8	11.8
Moisture Variation :	0.0	2.3	1.9	1.9
Peak Converted Wet Density (t/m ³) :	2.140	2.118	2.103	2.111
Hilf Density Ratio (%) :	96.5	100.0	101.5	103.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 78
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	02/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247473	247474	247475	
Test Number :	266	267	268	
Sampling Method :	-	-	-	
Date Sampled :	19/06/2018	19/06/2018	19/06/2018	
Date Tested :	19/06/2018	19/06/2018	19/06/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	E 8636.000 N 31704.000 RL 61.900	E 8629.600 N 31704.700 RL 62.300	E 8616.000 N 31704.400 RL 63.000	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	150	150	150	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	11.4	10.2	10.4	
Hilf MDR Number :	247473	247474	247475	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	85.5	85	84.5	
Field Wet Density (t/m ³) :	2.108	2.214	2.099	
Optimum Moisture Content (%) :	13.3	12.0	12.3	
Moisture Variation :	1.9	1.9	1.9	
Peak Converted Wet Density (t/m ³) :	2.122	2.121	2.103	
Hilf Density Ratio (%) :	99.5	104.5	100.0	
Minimum Specification :	95	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 79
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	6/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247585	247586	247587	247588
Test Number :	269	270	271	272
Sampling Method :	-	-	-	-
Date Sampled :	20/06/2018	20/06/2018	20/06/2018	20/06/2018
Date Tested :	20/06/2018	20/06/2018	20/06/2018	20/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 8874.500 N 31556.900 RL 58.200 / Final Level	Fill Area 2 E 8911.000 N 31358.000 Final Level	Fill Area 2 E 8952.800 N 31497.000 Final Level	Fill Area 2 E 8974.000 N 31473.000 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.0	7.1	10.1	12.2
Hilf MDR Number :	247585	247586	247587	247588
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	80.5	82.5	82	87.5
Field Wet Density (t/m ³) :	2.141	2.120	2.082	2.056
Optimum Moisture Content (%) :	11.2	8.6	12.3	13.9
Moisture Variation :	2.2	1.6	2.2	1.7
Peak Converted Wet Density (t/m ³) :	2.150	2.083	2.153	2.071
Hilf Density Ratio (%) :	99.5	102.0	96.5	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Gravelly CLAY, brown	Sandy Gravelly CLAY, brown	Sandy Gravelly CLAY, brown	Sandy Gravelly CLAY, brown
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 80
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	6/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247748	247749	247750	247751
Test Number :	273	274	275	276
Sampling Method :	-	-	-	-
Date Sampled :	23/06/2018	23/06/2018	23/06/2018	23/06/2018
Date Tested :	23/06/2018	23/06/2018	23/06/2018	23/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8623.000 N 31673.000 RL 63.700	E 8614.500 N 31674.400 RL 64.300	E 8668.000 N 31672.000 RL 61.800	E 8659.500 N 31671.900 RL 62.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.0	13.0	11.6	11.2
Hilf MDR Number :	247748	247749	247750	247751
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	97.5	80.5	86
Field Wet Density (t/m ³) :	2.118	2.090	2.102	2.088
Optimum Moisture Content (%) :	13.2	13.4	14.4	13.1
Moisture Variation :	0.2	0.3	2.7	1.9
Peak Converted Wet Density (t/m ³) :	2.117	2.061	2.112	2.116
Hilf Density Ratio (%) :	100.0	101.5	99.5	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 81
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	6/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247752	247753	
Test Number :	277	278	
Sampling Method :	-	-	
Date Sampled :	23/06/2018	23/06/2018	
Date Tested :	23/06/2018	23/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8652.000 N 31672.000 RL 62.500	E 8642.200 N 31672.000 RL 63.000	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	10.3	11.0	
Hilf MDR Number :	247752	247753	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	86	88.5	
Field Wet Density (t/m ³) :	2.074	2.151	
Optimum Moisture Content (%) :	12.0	12.4	
Moisture Variation :	1.7	1.4	
Peak Converted Wet Density (t/m ³) :	2.146	2.132	
Hilf Density Ratio (%) :	96.5	101.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 82
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	6/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247831	247832	247833	247834
Test Number :	279	280	281	282
Sampling Method :	-	-	-	-
Date Sampled :	25/06/2018	25/06/2018	25/06/2018	25/06/2018
Date Tested :	25/06/2018	25/06/2018	25/06/2018	25/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8657.900 N 31692.000 RL 61.600	E 8667.000 N 31691.000 RL 61.100	E 8678.000 N 31691.000 RL 60.900	E 8695.200 N 31690.000 RL 60.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.0	11.4	10.9	11.3
Hilf MDR Number :	247831	247832	247833	247834
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84	88	87.5	88
Field Wet Density (t/m ³) :	2.068	2.057	2.076	2.062
Optimum Moisture Content (%) :	13.1	13.0	12.5	12.8
Moisture Variation :	2.1	1.6	1.6	1.6
Peak Converted Wet Density (t/m ³) :	2.124	2.112	2.107	2.095
Hilf Density Ratio (%) :	97.5	97.5	98.5	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 83
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	6/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247835	247836	247837	247838
Test Number :	283	284	285	286
Sampling Method :	-	-	-	-
Date Sampled :	25/06/2018	25/06/2018	25/06/2018	25/06/2018
Date Tested :	25/06/2018	25/06/2018	25/06/2018	25/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8704.900 N 31690.000 RL 60.100	E 8701.500 N 31701.200 RL 59.500	E 8711.900 N 31701.000 RL 58.900	E 8683.400 N 31702.000 RL 60.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	8	-	10	9
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.382		2.174	2.270
Field Moisture Content (%) :	10.3	9.3	9.7	11.2
Hilf MDR Number :	247835	247836	247837	247838
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	87	81.5	84	85
Field Wet Density (t/m ³) :	2.107	2.062	2.131	2.160
Optimum Moisture Content (%) :	11.8	11.4	11.6	13.2
Moisture Variation :	1.6	2.1	1.9	2.0
Peak Converted Wet Density (t/m ³) :	2.136*	2.033	2.12*	2.13*
Hilf Density Ratio (%) :	98.5	101.5	100.5	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  Liam McDowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 84
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	6/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247839	247840	
Test Number :	287	288	
Sampling Method :	-	-	
Date Sampled :	25/06/2018	25/06/2018	
Date Tested :	25/06/2018	25/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8690.500 N 31701.000 RL 59.800	E 8722.000 N 31701.400 RL 58.600	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	9.3	9.5	
Hilf MDR Number :	247839	247840	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	78.5	85	
Field Wet Density (t/m ³) :	2.082	2.072	
Optimum Moisture Content (%) :	11.8	11.2	
Moisture Variation :	2.6	1.7	
Peak Converted Wet Density (t/m ³) :	2.072	2.064	
Hilf Density Ratio (%) :	100.5	100.5	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	-	-	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A McDowall

Liam McDowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 85
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247961	247962	247963	247964
Test Number :	289	290	291	292
Sampling Method :	-	-	-	-
Date Sampled :	26/06/2018	26/06/2018	26/06/2018	26/06/2018
Date Tested :	26/06/2018	26/06/2018	26/06/2018	26/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8613.000 N 31672.000 RL 64.800	E 8625.000 N 31693.000 RL 64.100	E 8597.100 N 31676.000 RL 65.200	E 8604.000 N 31692.000 RL 64.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	6	6	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.342	2.321	-	-
Field Moisture Content (%) :	13.3	10.1	10.2	7.9
Hilf MDR Number :	247961	247962	247963	247964
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	118	102	102.5	74
Field Wet Density (t/m ³) :	2.177	2.133	2.074	2.131
Optimum Moisture Content (%) :	11.3	9.9	10.0	10.6
Moisture Variation :	-2.1	-0.2	-0.2	2.8
Peak Converted Wet Density (t/m ³) :	2.161*	2.161*	2.143	2.082
Hilf Density Ratio (%) :	100.5	98.5	97.0	102.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 86
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247965	247966	247967	247968
Test Number :	293	294	295	296
Sampling Method :	-	-	-	-
Date Sampled :	26/06/2018	26/06/2018	26/06/2018	26/06/2018
Date Tested :	26/06/2018	26/06/2018	26/06/2018	26/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8682.000 N 31672.000 RL 61.900	E 8693.200 N 31672.000 RL 61.600	E 8657.900 N 31692.600 RL 61.600	E 8689.300 N 31681.000 RL 61.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.4	13.4	12.8	8.6
Hilf MDR Number :	247965	247966	247967	247968
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	104	103.5	106.5	108
Field Wet Density (t/m ³) :	2.102	2.122	2.117	2.084
Optimum Moisture Content (%) :	10.0	12.9	12.0	8.0
Moisture Variation :	-0.5	-0.5	-0.8	-0.7
Peak Converted Wet Density (t/m ³) :	2.156	2.157	2.151	2.150
Hilf Density Ratio (%) :	97.5	98.5	98.5	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 87
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	247969		
Test Number :	297		
Sampling Method :	-		
Date Sampled :	26/06/2018		
Date Tested :	26/06/2018		
Material Type :	General Fill		
Material Source :	On Site		
Lot Number :	-		
Sample Location :	E 8675.000 N 31672.700 RL 62.100		
Test Depth (mm) :	150		
Layer Depth (mm) :	-		
Maximum Size (mm) :	19		
Oversize Wet (%) :	-		
Oversize Dry (%) :	-		
Oversize Density (t/m ³) :	-		
Field Moisture Content (%) :	8.2		
Hilf MDR Number :	247969		
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1		
Compactive Effort :	Standard		
Field Density Method :	AS1289.5.8.1 & 5.7.1		
Moisture Method :	AS1289.2.1.1		
Moisture Ratio (%) :	80		
Field Wet Density (t/m ³) :	2.102		
Optimum Moisture Content (%) :	10.3		
Moisture Variation :	2.1		
Peak Converted Wet Density (t/m ³) :	2.125		
Hilf Density Ratio (%) :	99.0		
Minimum Specification :	95		
Moisture Specification :	-2% to +3%		
Site Selection :	-		
Soil Description :	Sandy CLAY		
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 88
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248040	248041	248042	248043
Test Number :	298	299	300	301
Sampling Method :	-	-	-	-
Date Sampled :	27/06/2018	27/06/2018	27/06/2018	27/06/2018
Date Tested :	27/06/2018	27/06/2018	27/06/2018	27/06/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 8627.000 N 31684.000 RL 64.000	Fill Area 2 E 8644.000 N 31681.500 RL 63.000	Fill Area 2 E 8643.100 N 31691.500 RL 63.200	Fill Area 2 E 8614.700 N 31692.800 RL 64.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.4	12.8	16.0	15.8
Hilf MDR Number :	248040	248041	248042	248043
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	104.5	87.5	105	106
Field Wet Density (t/m ³) :	2.122	2.106	2.066	2.148
Optimum Moisture Content (%) :	13.8	14.6	15.2	14.9
Moisture Variation :	-0.6	1.8	-0.8	-0.9
Peak Converted Wet Density (t/m ³) :	2.127	2.088	2.140	2.134
Hilf Density Ratio (%) :	100.0	101.0	96.5	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 89
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248044	248045	248046	
Test Number :	302	303	304	
Sampling Method :	-	-	-	
Date Sampled :	27/06/2018	27/06/2018	27/06/2018	
Date Tested :	27/06/2018	27/06/2018	27/06/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	Fill Area 2 E 9144.900 N 31397.000 RL 43.700	Fill Area 2 E 9178.000 N 31410.100 RL 43.300	Fill Area 2 E 9170.000 N 31424.000 RL 43.400	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	11.8	11.3	8.6	
Hilf MDR Number :	248044	248045	248046	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	87.5	86.5	79.5	
Field Wet Density (t/m ³) :	2.053	2.085	2.059	
Optimum Moisture Content (%) :	13.5	13.1	10.8	
Moisture Variation :	1.7	1.8	2.3	
Peak Converted Wet Density (t/m ³) :	2.123	2.155	2.081	
Hilf Density Ratio (%) :	96.5	97.0	99.0	
Minimum Specification :	95	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 90
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248047		
Test Number :	305		
Sampling Method :	-		
Date Sampled :	27/06/2018		
Date Tested :	27/06/2018		
Material Type :	General Fill		
Material Source :	On Site		
Lot Number :	-		
Sample Location :	Fill Area (Park) E 9071.000 N 31712.000 RL 47.600		
Test Depth (mm) :	150		
Layer Depth (mm) :	-		
Maximum Size (mm) :	19		
Oversize Wet (%) :	-		
Oversize Dry (%) :	-		
Oversize Density (t/m ³) :	-		
Field Moisture Content (%) :	9.4		
Hilf MDR Number :	248047		
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1		
Compactive Effort :	Standard		
Field Density Method :	AS1289.5.8.1 & 5.7.1		
Moisture Method :	AS1289.2.1.1		
Moisture Ratio (%) :	86		
Field Wet Density (t/m ³) :	2.127		
Optimum Moisture Content (%) :	11.0		
Moisture Variation :	1.5		
Peak Converted Wet Density (t/m ³) :	2.166		
Hilf Density Ratio (%) :	98.0		
Minimum Specification :	95		
Moisture Specification :	-2% to +3%		
Site Selection :	-		
Soil Description :	Sandy CLAY		
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A McDowall

Liam McDowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 91
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	12/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248048	248049	
Test Number :	306	307	
Sampling Method :	-	-	
Date Sampled :	27/06/2018	27/06/2018	
Date Tested :	27/06/2018	27/06/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 1 E 9047.000 N 31715.000 RL 47.900	Fill Area 1 E 9018.000 N 31716.000 RL 48.000	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	9.9	9.5	
Hilf MDR Number :	248048	248049	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	86.5	85	
Field Wet Density (t/m ³) :	2.113	2.177	
Optimum Moisture Content (%) :	11.4	11.2	
Moisture Variation :	1.5	1.8	
Peak Converted Wet Density (t/m ³) :	2.158	2.173	
Hilf Density Ratio (%) :	98.0	100.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 92
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248321	248322	248323	248324
Test Number :	308	309	310	311
Sampling Method :	-	-	-	-
Date Sampled :	2/07/2018	2/07/2018	2/07/2018	2/07/2018
Date Tested :	2/07/2018	2/07/2018	2/07/2018	2/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8619.000 N 31755.000 RL 60.658	E 8639.000 N 31757.000 RL 59.395	E 8656.000 N 31758.000 RL 58.335	E 8596.000 N 31692.000 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.7	19.0	11.3	12.2
Hilf MDR Number :	248321	248322	248323	248324
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	102.5	101.5	92	99
Field Wet Density (t/m ³) :	2.096	2.026	2.088	1.978
Optimum Moisture Content (%) :	12.4	18.7	12.3	12.3
Moisture Variation :	-0.3	-0.2	1.0	0.1
Peak Converted Wet Density (t/m ³) :	2.114	2.046	2.127	2.059
Hilf Density Ratio (%) :	99.0	99.0	98.0	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 93
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248325	248326	248327	248328
Test Number :	312	313	314	315
Sampling Method :	-	-	-	-
Date Sampled :	2/07/2018	2/07/2018	2/07/2018	2/07/2018
Date Tested :	2/07/2018	2/07/2018	2/07/2018	2/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8579.000 N 31690.000 Final Level	E 8669.000 N 31790.000 RL 57.182	E 8693.000 N 31795.000 RL 55.825	E 8720.000 N 31797.000 RL 54.037
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.8	9.7	10.4	10.1
Hilf MDR Number :	248325	248326	248327	248328
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	97	85	88.5	83.5
Field Wet Density (t/m ³) :	1.985	2.106	2.097	2.195
Optimum Moisture Content (%) :	12.2	11.4	11.7	12.1
Moisture Variation :	0.3	1.8	1.3	2.0
Peak Converted Wet Density (t/m ³) :	2.072	2.152	2.151	2.183
Hilf Density Ratio (%) :	96.0	98.0	97.5	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 94
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248329	248330	248331	
Test Number :	316	317	318	
Sampling Method :	-	-	-	
Date Sampled :	2/07/2018	2/07/2018	2/07/2018	
Date Tested :	2/07/2018	2/07/2018	2/07/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	E 8650.000 N 31772.000 RL 58.617	E 8678.000 N 31776.000 RL 57.444	E 8698.000 N 31779.000 RL 56.241	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	12.0	10.3	10.4	
Hilf MDR Number :	248329	248330	248331	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	101	98.5	102.5	
Field Wet Density (t/m ³) :	2.058	2.166	2.088	
Optimum Moisture Content (%) :	11.9	10.4	10.2	
Moisture Variation :	-0.1	0.1	-0.2	
Peak Converted Wet Density (t/m ³) :	2.129	2.189	2.156	
Hilf Density Ratio (%) :	96.5	99.0	97.0	
Minimum Specification :	95	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 95
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248415	248416	248417	248418
Test Number :	319	320	321	322
Sampling Method :	-	-	-	-
Date Sampled :	3/07/2018	3/07/2018	3/07/2018	3/07/2018
Date Tested :	3/07/2018	3/07/2018	3/07/2018	3/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8700.000 N 31763.000 RL 56.538	Fill Area 1 E 8717.300 N 31765.000 RL 55.474	Fill Area 1 E 8735.000 N 31767.000 RL 54.324	Fill Area 1 E 8613.000 N 31689.000 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.9	9.9	9.8	12.2
Hilf MDR Number :	248415	248416	248417	248418
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	82.5	90.5	82	94
Field Wet Density (t/m ³) :	2.086	2.097	2.081	2.109
Optimum Moisture Content (%) :	12.0	10.9	11.9	13.0
Moisture Variation :	2.1	1.0	2.1	0.8
Peak Converted Wet Density (t/m ³) :	2.149	2.158	2.118	2.184
Hilf Density Ratio (%) :	97.0	97.0	98.0	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 96
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248419	248420	248421	248422
Test Number :	323	324	325	326
Sampling Method :	-	-	-	-
Date Sampled :	3/07/2018	3/07/2018	3/07/2018	3/07/2018
Date Tested :	3/07/2018	3/07/2018	3/07/2018	3/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8627.000 N 31629.000 Final Level	E 8639.000 N 31690.000 Final Level	E 8661.000 N 31768.000 RL 58.027	E 8675.000 N 31770.000 RL 57.378
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.5	9.5	10.7	11.7
Hilf MDR Number :	248419	248420	248421	248422
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84	83	81	84.5
Field Wet Density (t/m ³) :	2.075	2.110	2.072	2.078
Optimum Moisture Content (%) :	12.5	11.5	13.2	13.9
Moisture Variation :	2.0	2.0	2.5	2.1
Peak Converted Wet Density (t/m ³) :	2.127	2.146	2.028	2.077
Hilf Density Ratio (%) :	97.5	98.5	102.0	100.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 97
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248423	248424	
Test Number :	327	328	
Sampling Method :	-	-	
Date Sampled :	3/07/2018	3/07/2018	
Date Tested :	3/07/2018	3/07/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8699.000 N 31775.000 RL 56.145	E 8720.000 N 31777.000 RL 54.461	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	11.5	12.2	
Hilf MDR Number :	248423	248424	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	84	93.5	
Field Wet Density (t/m ³) :	2.185	2.192	
Optimum Moisture Content (%) :	13.7	13.0	
Moisture Variation :	2.2	0.8	
Peak Converted Wet Density (t/m ³) :	2.121	2.130	
Hilf Density Ratio (%) :	103.0	103.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 98
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248589	248590	248591	248592
Test Number :	329	330	331	332
Sampling Method :	-	-	-	-
Date Sampled :	4/07/2018	4/07/2018	4/07/2018	4/07/2018
Date Tested :	4/07/2018	4/07/2018	4/07/2018	4/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8704.910 N 31759.740 RL 57.12	Fill Area 1 E 8690.750 N 31760.750 RL 57.78	Fill Area 1 E 8707.080 N 31796.110 RL 55.870	Fill Area 1 E 8693.860 N 31794.000 RL 56.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.3	13.5	13.4	14.2
Hilf MDR Number :	248589	248590	248591	248592
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	96.5	98	96	88.5
Field Wet Density (t/m ³) :	2.024	2.082	2.095	2.065
Optimum Moisture Content (%) :	14.8	13.8	13.9	16.0
Moisture Variation :	0.5	0.3	0.6	1.8
Peak Converted Wet Density (t/m ³) :	2.080	2.087	2.141	2.029
Hilf Density Ratio (%) :	97.5	100.0	98.0	102.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 99
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	23/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248593	248594	248595	248596
Test Number :	333	334	335	336
Sampling Method :	-	-	-	-
Date Sampled :	4/07/2018	4/07/2018	4/07/2018	4/07/2018
Date Tested :	4/07/2018	4/07/2018	4/07/2018	4/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8683.580 N 31793.000 RL 56.980	E 8613.000 N 31761.000 RL 61.360	E 8626.510 N 31762.000 RL 60.830	E 8640.000 N 31762.000 RL 60.120
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	16.8	14.9	12.8	13.4
Hilf MDR Number :	248593	248594	248595	248596
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99.5	98	90	88.5
Field Wet Density (t/m ³) :	2.053	2.044	2.000	1.973
Optimum Moisture Content (%) :	16.9	15.2	14.2	15.1
Moisture Variation :	0.1	0.3	1.5	1.7
Peak Converted Wet Density (t/m ³) :	2.080	2.046	1.994	1.985
Hilf Density Ratio (%) :	98.5	100.0	100.5	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11





Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 100
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248830	248831	248832	248833
Test Number :	337	338	339	340
Sampling Method :	-	-	-	-
Date Sampled :	9/07/2018	9/07/2018	9/07/2018	9/07/2018
Date Tested :	9/07/2018	9/07/2018	9/07/2018	9/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8693.730 N 31786.170 RL 57.26	Fill Area 1 E 8674.500 N 31783.380 RL 58.31	Fill Area 1 E 8652.560 N 31782.700 RL 59.33	Fill Area 1 E 8629.910 N 31781.820 RL 60.410
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	9	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.522	-	-
Field Moisture Content (%) :	11.3	11.2	13.1	11.9
Hilf MDR Number :	248830	248831	248832	248833
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	72	84.5	100.5	99
Field Wet Density (t/m ³) :	2.114	2.139	2.099	2.130
Optimum Moisture Content (%) :	15.7	13.2	13.0	12.0
Moisture Variation :	4.3	2.0	-0.1	0.1
Peak Converted Wet Density (t/m ³) :	2.090	2.126*	2.116	2.094
Hilf Density Ratio (%) :	101.0	100.5	99.0	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 101
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248834	248835	248836	248837
Test Number :	341	342	343	344
Sampling Method :	-	-	-	-
Date Sampled :	9/07/2018	9/07/2018	9/07/2018	9/07/2018
Date Tested :	9/07/2018	9/07/2018	9/07/2018	9/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8655.350 N 31773.510 RL 59.390	Fill Area 1 E 8645.100 N 31773.050 RL 60.000	Fill Area 1 E 8637.530 N 31773.530 RL 60.510	Fill Area 1 E 8627.840 N 31773.900 RL 60.910
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	11	14	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.512	2.524	-
Field Moisture Content (%) :	11.0	9.7	9.9	12.9
Hilf MDR Number :	248834	248835	248836	248837
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	80	82.5	96	84
Field Wet Density (t/m ³) :	2.103	2.123	2.112	2.094
Optimum Moisture Content (%) :	13.7	11.7	10.3	15.3
Moisture Variation :	2.6	2.1	0.4	2.3
Peak Converted Wet Density (t/m ³) :	2.098	2.177*	2.205*	2.142
Hilf Density Ratio (%) :	100.0	97.5	96.0	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 102
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248838	248839	248840	248841
Test Number :	345	346	347	348
Sampling Method :	-	-	-	-
Date Sampled :	9/07/2018	9/07/2018	9/07/2018	9/07/2018
Date Tested :	9/07/2018	9/07/2018	9/07/2018	9/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 2 E 9145.000 N 31422.000 RL 44.600	Fill Area 2 E 9162.000 N 31406.000 RL 44.300	Fill Area 2 E 9127.000 N 31407.000 RL 45.400	Fill Area 2 E 9143.800 N 31393.500 RL 45.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.3	11.6	11.9	11.8
Hilf MDR Number :	248838	248839	248840	248841
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	80.5	91	85	85.5
Field Wet Density (t/m ³) :	2.093	2.103	2.086	2.106
Optimum Moisture Content (%) :	12.8	12.7	14.0	13.8
Moisture Variation :	2.6	1.1	2.1	2.0
Peak Converted Wet Density (t/m ³) :	2.021	2.113	2.092	2.093
Hilf Density Ratio (%) :	103.5	99.5	99.5	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 103
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248842		
Test Number :	349		
Sampling Method :	-		
Date Sampled :	9/07/2018		
Date Tested :	9/07/2018		
Material Type :	General Fill		
Material Source :	On Site		
Lot Number :	-		
Sample Location :	Fill Area 2 E 9153.000 N 31403.000 RL 45.300		
Test Depth (mm) :	150		
Layer Depth (mm) :	-		
Maximum Size (mm) :	19		
Oversize Wet (%) :	-		
Oversize Dry (%) :	-		
Oversize Density (t/m ³) :	-		
Field Moisture Content (%) :	11.9		
Hilf MDR Number :	248842		
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1		
Compactive Effort :	Standard		
Field Density Method :	AS1289.5.8.1 & 5.7.1		
Moisture Method :	AS1289.2.1.1		
Moisture Ratio (%) :	73		
Field Wet Density (t/m ³) :	2.091		
Optimum Moisture Content (%) :	16.3		
Moisture Variation :	4.3		
Peak Converted Wet Density (t/m ³) :	2.049		
Hilf Density Ratio (%) :	102.0		
Minimum Specification :	95		
Moisture Specification :	-2% to +3%		
Site Selection :	-		
Soil Description :	Gravelly Clayey SAND		
Remarks :	Reported moisture variation does not accurately reflect placement moisture.		



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A McDowall

Liam McDowall (Brisbane) - Branch Manager

NATA Accreditation Number

1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 104
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248899	248900	248901	248902
Test Number :	350	351	352	353
Sampling Method :	-	-	-	-
Date Sampled :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Date Tested :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8598.900 N 31772.200 RL 62.780	Fill Area 1 E 8587.840 N 31772.870 RL 63.240	Fill Area 1 E 8588.920 N 31773.530 RL 63.470	Fill Area 1 E 8571.310 N 31773.630 RL 64.230
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.3	12.8	13.1	12.4
Hilf MDR Number :	248899	248900	248901	248902
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86.5	73.5	85.5	86
Field Wet Density (t/m ³) :	2.060	2.178	2.157	2.077
Optimum Moisture Content (%) :	14.2	17.4	15.3	14.4
Moisture Variation :	1.9	4.4	2.1	2.0
Peak Converted Wet Density (t/m ³) :	2.055	2.170	2.136	2.133
Hilf Density Ratio (%) :	100.0	100.5	101.0	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 105
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248903	248904	248905	248906
Test Number :	354	355	356	357
Sampling Method :	-	-	-	-
Date Sampled :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Date Tested :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8935.000 N 31647.000 RL 52.100 (Final Level)	Fill Area 1 (BPH) E 8938.600 N 31649.000 RL 52.100 (Final Level)	Fill Area 1 (BPH) E 9158.600 N 31391.000 RL 45.400 (Final Level)	Fill Area 1 (BPH) E 9146.000 N 31397.500 RL 45.900 (Final Level)
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.3	9.4	12.5	10.8
Hilf MDR Number :	248903	248904	248905	248906
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	80	81	88	82.5
Field Wet Density (t/m ³) :	2.122	2.101	2.097	2.109
Optimum Moisture Content (%) :	11.6	11.6	14.2	13.1
Moisture Variation :	2.4	2.2	1.7	2.4
Peak Converted Wet Density (t/m ³) :	2.035	2.151	2.093	2.027
Hilf Density Ratio (%) :	104.5	97.5	100.0	104.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 106
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248907	248908	248909	248910
Test Number :	358	359	360	361
Sampling Method :	-	-	-	-
Date Sampled :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Date Tested :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 E 8608.000 N 31782.000 RL 62.300	Fill Area 1 E 8600.000 N 31782.000 RL 62.670	Fill Area 1 E 8591.000 N 31782.000 RL 62.900	Fill Area 1 E 8576.000 N 31782.000 RL 63.930
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	20.0	15.5	12.8	22.8
Hilf MDR Number :	248907	248908	248909	248910
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	92.5	89.5	90.5	98.5
Field Wet Density (t/m ³) :	1.976	2.067	2.055	1.991
Optimum Moisture Content (%) :	21.6	17.3	14.2	23.1
Moisture Variation :	1.5	1.8	1.3	0.4
Peak Converted Wet Density (t/m ³) :	1.968	2.039	2.091	1.952
Hilf Density Ratio (%) :	100.5	101.5	98.5	102.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 107
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	27/07/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248911	248912	248913	248914
Test Number :	362	363	364	365
Sampling Method :	-	-	-	-
Date Sampled :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Date Tested :	10/07/2018	10/07/2018	10/07/2018	10/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 9063.000 N 31721.000 RL 48.000	Fill Area 1 (BPH) E 9039.000 N 31721.000 RL 49.000	Fill Area 1 (BPH) E 8998.000 N 31723.000 RL 49.500	Fill Area 1 (BPH) E 8962.000 N 31731.000 RL 49.000
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.6	11.5	11.3	10.8
Hilf MDR Number :	248911	248912	248913	248914
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84	100.5	92	84.5
Field Wet Density (t/m ³) :	2.131	2.085	2.125	2.080
Optimum Moisture Content (%) :	11.4	11.5	12.3	12.8
Moisture Variation :	1.8	0.0	1.0	2.0
Peak Converted Wet Density (t/m ³) :	2.101	2.164	2.170	2.040
Hilf Density Ratio (%) :	101.5	96.5	98.0	102.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 108
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248987	248988	248989	248990
Test Number :	366	367	368	369
Sampling Method :	-	-	-	-
Date Sampled :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Date Tested :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8630.000 N 31788.530 RL 60.680	Fill Area 1 (Salmons) E 8618.650 N 31788.000 RL 61.700	Fill Area 1 (Salmons) E 8606.000 N 31788.000 RL 62.160	Fill Area 1 (Salmons) E 8595.000 N 31788.000 RL 62.930
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.5	10.3	15.8	10.5
Hilf MDR Number :	248987	248988	248989	248990
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	87	90.5	88.5	84.5
Field Wet Density (t/m ³) :	2.021	2.024	2.056	2.066
Optimum Moisture Content (%) :	13.2	11.4	17.9	12.5
Moisture Variation :	1.7	1.1	2.0	2.0
Peak Converted Wet Density (t/m ³) :	2.110	2.095	2.005	2.048
Hilf Density Ratio (%) :	96.0	96.5	102.5	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 109
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248991	248992	248993	248994
Test Number :	370	371	372	373
Sampling Method :	-	-	-	-
Date Sampled :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Date Tested :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8936.000 N 31723.000 RL 49.400	Fill Area 1 (BPH) E 8920.000 N 31726.000 RL 49.300	Fill Area 1 (BPH) E 8898.000 N 31728.000 RL 49.700	Fill Area 1 (BPH) E 8860.000 N 31729.000 RL 50.000
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	12	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.480	-	-
Field Moisture Content (%) :	14.4	14.3	11.8	12.6
Hilf MDR Number :	248991	248992	248993	248994
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	105	119	88	102.5
Field Wet Density (t/m ³) :	2.109	2.218	2.062	2.158
Optimum Moisture Content (%) :	13.7	12.0	13.4	12.3
Moisture Variation :	-0.7	-2.3	1.7	-0.3
Peak Converted Wet Density (t/m ³) :	2.203	2.249*	2.099	2.170
Hilf Density Ratio (%) :	95.5	98.5	98.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 110
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248995	248996	248997	248998
Test Number :	374	375	376	377
Sampling Method :	-	-	-	-
Date Sampled :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Date Tested :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8627.000 N 31767.000 RL 61.190	Fill Area 1 (Salmons) E 8617.000 N 31768.000 RL 61.820	Fill Area 1 (Salmons) E 8607.000 N 31769.000 RL 62.520	Fill Area 1 (Salmons) E 8600.000 N 31769.000 RL 63.030
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.0	10.7	10.1	10.5
Hilf MDR Number :	248995	248996	248997	248998
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	81.5	100	88
Field Wet Density (t/m ³) :	2.040	2.088	2.108	2.062
Optimum Moisture Content (%) :	13.0	13.1	10.1	11.9
Moisture Variation :	0.0	2.4	0.0	1.5
Peak Converted Wet Density (t/m ³) :	2.040	2.067	2.100	2.097
Hilf Density Ratio (%) :	100.0	101.0	100.5	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 111
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	248999	249000	249001	249002
Test Number :	378	379	380	381
Sampling Method :	-	-	-	-
Date Sampled :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Date Tested :	11/07/2018	11/07/2018	11/07/2018	11/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8918.000 N 31727.000 RL 49.500	Fill Area 1 (BPH) E 8897.000 N 31726.000 RL 49.900	Fill Area 1 (BPH) E 8887.000 N 31728.000 RL 49.900	Fill Area 1 (BPH) E 8882.000 N 31727.000 RL 50.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.6	10.2	11.8	12.1
Hilf MDR Number :	248999	249000	249001	249002
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	83.5	83.5	98	98
Field Wet Density (t/m ³) :	2.054	2.076	2.065	2.118
Optimum Moisture Content (%) :	12.7	12.2	12.0	12.3
Moisture Variation :	2.1	2.0	0.2	0.2
Peak Converted Wet Density (t/m ³) :	2.066	2.022	2.065	2.105
Hilf Density Ratio (%) :	99.5	102.5	100.0	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY	Gravelly Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 112
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249158	249159	249160	249161
Test Number :	382	383	384	385
Sampling Method :	-	-	-	-
Date Sampled :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Date Tested :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8656.000 N 31788.000 RL 59.30	Fill Area 1 (Salmons) E 8647.000 N 31787.000 RL 59.68	Fill Area 1 (Salmons) E 8637.800 N 31787.000 RL 60.26	Fill Area 1 (Salmons) E 8627.000 N 31787.000 RL 60.88
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	13	12	8
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.292	2.517	2.444	2.494
Field Moisture Content (%) :	10.2	14.2	12.4	14.1
Hilf MDR Number :	249158	249159	249160	249161
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86.5	100	97	96
Field Wet Density (t/m ³) :	2.092	2.089	2.107	2.086
Optimum Moisture Content (%) :	11.8	14.2	12.8	14.7
Moisture Variation :	1.7	0.0	0.3	0.6
Peak Converted Wet Density (t/m ³) :	2.16*	2.202*	2.192*	2.151*
Hilf Density Ratio (%) :	97.0	95.0	96.0	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 113
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249162	249163	249164	249165
Test Number :	386	387	388	389
Sampling Method :	-	-	-	-
Date Sampled :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Date Tested :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8912.000 N 31759.000 RL 50.000	Fill Area 1 (BPH) E 8909.000 N 31744.000 RL 50.200	Fill Area 1 (BPH) E 8897.000 N 31745.000 RL 50.400	Fill Area 1 (BPH) E 8879.000 N 31750.000 RL 50.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	9	-	11	8
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.196		2.202	2.154
Field Moisture Content (%) :	11.9	13.7	10.7	10.1
Hilf MDR Number :	249162	249163	249164	249165
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	94	103.5	90	97
Field Wet Density (t/m ³) :	2.089	2.062	2.099	2.110
Optimum Moisture Content (%) :	12.7	13.2	11.9	10.4
Moisture Variation :	0.8	-0.5	1.2	0.3
Peak Converted Wet Density (t/m ³) :	2.133*	2.166	2.151*	2.088*
Hilf Density Ratio (%) :	98.0	95.0	97.5	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 114
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249166	249167	249168	249169
Test Number :	390	391	392	393
Sampling Method :	-	-	-	-
Date Sampled :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Date Tested :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8599.000 N 31766.000 RL 63.03	Fill Area 1 (Salmons) E 8591.000 N 31766.000 RL 63.50	Fill Area 1 (Salmons) E 8584.000 N 31766.000 RL 63.99	Fill Area 1 (Salmons) E 8575.000 N 31766.000 RL 64.40
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.4	12.5	13.6	13.4
Hilf MDR Number :	249166	249167	249168	249169
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98.5	96.5	98.5	98
Field Wet Density (t/m ³) :	2.088	2.081	2.073	2.069
Optimum Moisture Content (%) :	13.6	12.9	13.8	13.6
Moisture Variation :	0.2	0.5	0.2	0.2
Peak Converted Wet Density (t/m ³) :	2.117	2.094	2.098	2.101
Hilf Density Ratio (%) :	98.5	99.5	99.0	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 115
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249170	249171	249172	249173
Test Number :	394	395	396	397
Sampling Method :	-	-	-	-
Date Sampled :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Date Tested :	13/07/2018	13/07/2018	13/07/2018	13/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8916.000 N 31731.000 RL 50.200	Fill Area 1 (BPH) E 8934.000 N 31733.000 RL 50.300	Fill Area 1 (BPH) E 8948.000 N 31747.000 RL 49.900	Fill Area 1 (BPH) E 8950.000 N 31760.000 RL 50.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	12	-	10	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.197	-	2.160	-
Field Moisture Content (%) :	8.5	10.7	8.7	11.1
Hilf MDR Number :	249170	249171	249172	249173
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	78.5	85	77	96.5
Field Wet Density (t/m ³) :	2.107	2.073	2.097	2.081
Optimum Moisture Content (%) :	10.9	12.6	11.3	11.5
Moisture Variation :	2.4	1.9	2.7	0.5
Peak Converted Wet Density (t/m ³) :	2.102*	2.140	2.068*	2.134
Hilf Density Ratio (%) :	100.5	97.0	101.5	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	-	-	-	-
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 116
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249192	249193	249194	249195
Test Number :	398	399	400	401
Sampling Method :	-	-	-	-
Date Sampled :	14/07/2018	14/07/2018	14/07/2018	14/07/2018
Date Tested :	14/07/2018	14/07/2018	14/07/2018	14/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8727.000 N 31801.000 RL 54.90	Fill Area 1 (Salmons) E 8719.000 N 31801.000 RL 55.49	Fill Area 1 (Salmons) E 8708.000 N 31799.000 RL 56.13	Fill Area 1 (Salmons) E 8697.000 N 31796.000 RL 56.86
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	12	-	15
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.605	-	2.322
Field Moisture Content (%) :	11.1	11.4	9.8	11.2
Hilf MDR Number :	249192	249193	249194	249195
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	96.5	96	82.5	96
Field Wet Density (t/m ³) :	2.174	2.091	2.175	2.191
Optimum Moisture Content (%) :	11.5	11.9	11.9	11.6
Moisture Variation :	0.4	0.4	2.1	0.4
Peak Converted Wet Density (t/m ³) :	2.146	2.193*	2.141	2.179*
Hilf Density Ratio (%) :	101.5	95.5	101.5	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--





Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 117
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249292	249293	249294	249295
Test Number :	402	403	404	405
Sampling Method :	-	-	-	-
Date Sampled :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Date Tested :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	E 8744.81 N 31786.93 RL 54.26	E 8733.02 N 31786.49 RL 55.25	E 8722.91 N 31786.59 RL 55.88	E 8706.84 N 31787.64 RL 57.04
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	14	14	15
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.336	2.336	2.245
Field Moisture Content (%) :	10.3	10.7	7.9	9.7
Hilf MDR Number :	249292	249293	249294	249295
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	96	85.5	72.5	82.5
Field Wet Density (t/m ³) :	2.158	2.147	2.161	2.167
Optimum Moisture Content (%) :	10.7	12.6	10.9	11.8
Moisture Variation :	0.5	1.9	3.0	2.1
Peak Converted Wet Density (t/m ³) :	2.140	2.167*	2.14*	2.137*
Hilf Density Ratio (%) :	101.0	99.0	101.0	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 118
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249296	249297	249298	249299
Test Number :	406	407	408	409
Sampling Method :	-	-	-	-
Date Sampled :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Date Tested :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	E 8745.000 N 31770.000 RL 54.000	E 8733.000 N 31771.000 RL 54.900	E 8721.000 N 31772.000 RL 55.300	E 8705.000 N 31772.000 RL 56.700
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	13	13	15	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.298	2.293	2.347	
Field Moisture Content (%) :	12.2	9.6	10.2	10.6
Hilf MDR Number :	249296	249297	249298	249299
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	87.5	80	80.5	84.5
Field Wet Density (t/m ³) :	2.193	2.201	2.151	2.159
Optimum Moisture Content (%) :	13.9	12.0	12.6	12.6
Moisture Variation :	1.6	2.4	2.4	2.0
Peak Converted Wet Density (t/m ³) :	2.204*	2.165*	2.176*	2.147
Hilf Density Ratio (%) :	99.5	101.5	99.0	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--





Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 119
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249300	249301	249302	249303
Test Number :	410	411	412	413
Sampling Method :	-	-	-	-
Date Sampled :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Date Tested :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	E 8925.441 N 31744.655 RL 51.00	E 8928.671 N 31755.421 RL 51.244	E 8929.934 N 31770.573 RL 51.555	E 8934.547 N 31779.641 RL 51.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	15	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	1.934	-	-
Field Moisture Content (%) :	9.7	9.5	12.4	13.1
Hilf MDR Number :	249300	249301	249302	249303
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	77.5	82.5	87.5	97.5
Field Wet Density (t/m ³) :	2.072	2.035	2.057	2.060
Optimum Moisture Content (%) :	12.6	11.5	14.2	13.4
Moisture Variation :	2.9	2.0	1.8	0.3
Peak Converted Wet Density (t/m ³) :	2.120	2.093*	2.131	2.146
Hilf Density Ratio (%) :	97.5	97.0	96.5	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 120
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249304	249305	249306	249307
Test Number :	414	415	416	417
Sampling Method :	-	-	-	-
Date Sampled :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Date Tested :	16/07/2018	16/07/2018	16/07/2018	16/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	E 8907.000 N 31745.000 RL 50.600	E 8909.000 N 31757.000 RL 50.900	E 8912.000 N 31771.000 RL 51.200	E 8911.000 N 31781.000 RL 51.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	12	16	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	1.904	2.024	-
Field Moisture Content (%) :	10.9	10.1	10.4	10.1
Hilf MDR Number :	249304	249305	249306	249307
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	94	79	88	87.5
Field Wet Density (t/m ³) :	2.043	2.082	2.121	2.046
Optimum Moisture Content (%) :	11.6	12.8	11.8	11.5
Moisture Variation :	0.7	2.8	1.4	1.5
Peak Converted Wet Density (t/m ³) :	2.123	2.05*	2.113*	2.115
Hilf Density Ratio (%) :	96.0	101.5	100.5	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam McDowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 121
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249400	249401	249402	249403
Test Number :	418	419	420	421
Sampling Method :	-	-	-	-
Date Sampled :	17/07/2018	17/07/2018	17/07/2018	17/07/2018
Date Tested :	17/07/2018	17/07/2018	17/07/2018	17/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8636.000 N 31783.000 RL 60.83	Fill Area 1 (BPH) E 8625.000 N 31783.000 RL 61.65	Fill Area 1 (BPH) E 8616.000 N 31783.000 RL 62.18	Fill Area 1 (BPH) E 8607.000 N 31784.000 RL 62.50
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.0	11.0	11.2	9.8
Hilf MDR Number :	249400	249401	249402	249403
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85	86	85	84
Field Wet Density (t/m ³) :	2.213	2.139	2.126	2.121
Optimum Moisture Content (%) :	11.8	12.8	13.2	11.7
Moisture Variation :	1.8	1.8	2.0	1.9
Peak Converted Wet Density (t/m ³) :	2.142	2.133	2.143	2.119
Hilf Density Ratio (%) :	103.5	100.5	99.0	100.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 122
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249404	249405	249406	249407
Test Number :	422	423	424	425
Sampling Method :	-	-	-	-
Date Sampled :	17/07/2018	17/07/2018	17/07/2018	17/07/2018
Date Tested :	17/07/2018	17/07/2018	17/07/2018	17/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8920.000 N 31740.000 RL 51.300	Fill Area 1 (Salmons) E 8898.000 N 31723.000 RL 50.900	Fill Area 1 (Salmons) E 8858.000 N 31720.000 RL 51.300	Fill Area 1 (Salmons) E 8864.000 N 31740.000 RL 51.400
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.4	14.3	11.9	11.6
Hilf MDR Number :	249404	249405	249406	249407
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	101	98	88.5	86
Field Wet Density (t/m ³) :	2.111	2.131	2.086	2.109
Optimum Moisture Content (%) :	13.3	14.6	13.4	13.5
Moisture Variation :	-0.1	0.2	1.6	1.9
Peak Converted Wet Density (t/m ³) :	2.146	2.151	2.093	2.118
Hilf Density Ratio (%) :	98.5	99.0	99.5	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 123
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249408	249409	249410	249411
Test Number :	426	427	428	429
Sampling Method :	-	-	-	-
Date Sampled :	17/07/2018	17/07/2018	17/07/2018	17/07/2018
Date Tested :	17/07/2018	17/07/2018	17/07/2018	17/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8876.000 N 31774.000 RL 51.800	Fill Area 1 (BPH) E 8912.000 N 31767.000 RL 52.200	Fill Area 1 (BPH) E 8943.000 N 31769.000 RL 51.600	Fill Area 1 (BPH) E 8943.000 N 31764.000 RL 51.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.3	10.9	10.7	9.9
Hilf MDR Number :	249408	249409	249410	249411
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86.5	93.5	86	86.5
Field Wet Density (t/m ³) :	2.068	2.071	2.126	2.159
Optimum Moisture Content (%) :	11.9	11.7	12.4	11.4
Moisture Variation :	1.7	0.8	1.8	1.6
Peak Converted Wet Density (t/m ³) :	2.150	2.142	2.141	2.155
Hilf Density Ratio (%) :	96.0	96.5	99.5	100.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 124
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249511	249512	249513	249514
Test Number :	430	431	432	433
Sampling Method :	-	-	-	-
Date Sampled :	18/07/2018	18/07/2018	18/07/2018	18/07/2018
Date Tested :	18/07/2018	18/07/2018	18/07/2018	18/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8875.000 N 31767.000 RL 51.850	Fill Area 1 (BPH) E 8905.000 N 31765.000 RL 52.200	Fill Area 1 (BPH) E 8893.000 N 31766.000 RL 52.100	Fill Area 1 (BPH) E 8918.000 N 31763.000 RL 52.200
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.7	9.6	9.6	11.1
Hilf MDR Number :	249511	249512	249513	249514
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86.5	83.5	86	102
Field Wet Density (t/m ³) :	2.205	2.227	2.116	2.140
Optimum Moisture Content (%) :	13.6	11.5	11.2	10.9
Moisture Variation :	1.9	1.9	1.7	-0.2
Peak Converted Wet Density (t/m ³) :	2.124	2.142	2.117	2.120
Hilf Density Ratio (%) :	104.0	104.0	100.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 125
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249515	249516	249517	249518
Test Number :	434	435	436	437
Sampling Method :	-	-	-	-
Date Sampled :	18/07/2018	18/07/2018	18/07/2018	18/07/2018
Date Tested :	18/07/2018	18/07/2018	18/07/2018	18/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8929.000 N 31708.000 RL 52.300	Fill Area 1 (BPH) E 8898.000 N 31720.000 RL 52.400	Fill Area 1 (BPH) E 8875.000 N 31720.000 RL 52.500	Fill Area 1 (BPH) E 8853.600 N 31696.000 RL 57.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.8	12.1	11.3	11.6
Hilf MDR Number :	249515	249516	249517	249518
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	91	97	87
Field Wet Density (t/m ³) :	2.278	2.125	2.283	2.116
Optimum Moisture Content (%) :	10.8	13.3	11.6	13.4
Moisture Variation :	0.0	1.2	0.3	1.8
Peak Converted Wet Density (t/m ³) :	2.142	2.080	2.175	2.083
Hilf Density Ratio (%) :	106.5	102.0	105.0	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 126
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249602	249603	249604	249605
Test Number :	438	439	440	441
Sampling Method :	-	-	-	-
Date Sampled :	19/07/2018	19/07/2018	19/07/2018	19/07/2018
Date Tested :	19/07/2018	19/07/2018	19/07/2018	19/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8905.000 N 31745.000 RL 53.200	Fill Area 1 (BPH) E 8877.000 N 31745.000 RL 53.400	Fill Area 1 (BPH) E 8896.000 N 31723.000 RL 53.400	Fill Area 1 (BPH) E 8863.000 N 31726.000 RL 53.690
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	10	13	8	1
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.497	2.462	2.471	2.470
Field Moisture Content (%) :	9.8	10.0	9.4	10.2
Hilf MDR Number :	249602	249603	249604	249605
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	97.5	103.5	95	95
Field Wet Density (t/m ³) :	2.075	2.105	2.090	2.090
Optimum Moisture Content (%) :	10.0	9.7	9.9	10.7
Moisture Variation :	0.2	-0.3	0.5	0.6
Peak Converted Wet Density (t/m ³) :	2.135*	2.143*	2.087*	2.076*
Hilf Density Ratio (%) :	97.0	98.0	100.0	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 127
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	2/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249606	249607	249608	249609
Test Number :	442	443	444	445
Sampling Method :	-	-	-	-
Date Sampled :	19/07/2018	19/07/2018	19/07/2018	19/07/2018
Date Tested :	19/07/2018	19/07/2018	19/07/2018	19/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8881.000 N 31732.000 RL 54.100	Fill Area 1 (BPH) E 8912.000 N 31728.000 RL 53.200	Fill Area 1 (BPH) E 8886.200 N 31729.000 RL 54.000	Fill Area 1 (BPH) E 8855.000 N 31726.000 RL 53.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	8	12	12	12
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.481	2.458	2.481	2.471
Field Moisture Content (%) :	11.9	11.8	13.7	12.1
Hilf MDR Number :	249606	249607	249608	249609
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	96.5	97	98	98
Field Wet Density (t/m ³) :	2.139	2.087	2.132	2.093
Optimum Moisture Content (%) :	12.3	12.2	14.0	12.4
Moisture Variation :	0.4	0.3	0.2	0.2
Peak Converted Wet Density (t/m ³) :	2.213*	2.155*	2.216*	2.206*
Hilf Density Ratio (%) :	96.5	97.0	96.0	95.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND	Gravelly Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 128
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249717	249718	249719	249720
Test Number :	446	447	448	449
Sampling Method :	-	-	-	-
Date Sampled :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Date Tested :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8604.000 N 31771.000 RL 63.180	Fill Area 1 (Salmons) E 8597.000 N 31771.000 RL 63.700	Fill Area 1 (Salmons) E 8589.000 N 31772.000 RL 64.200	Fill Area 1 (Salmons) E 8581.000 N 31773.000 RL 64.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	11	-	12
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.498	2.522		2.509
Field Moisture Content (%) :	10.2	10.8	10.5	10.0
Hilf MDR Number :	249717	249718	249719	249720
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	98.5	89	87.5
Field Wet Density (t/m ³) :	2.110	2.130	2.090	2.180
Optimum Moisture Content (%) :	10.4	11.0	11.8	11.4
Moisture Variation :	0.2	0.2	1.3	1.4
Peak Converted Wet Density (t/m ³) :	2.19*	2.179*	2.152	2.203*
Hilf Density Ratio (%) :	96.5	98.0	97.0	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC


Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 129
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249721	249722	249723	249724
Test Number :	450	451	452	453
Sampling Method :	-	-	-	-
Date Sampled :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Date Tested :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8873.000 N 31724.000 RL 54.400 (Final Level)	Fill Area 1 (BPH) E 8876.000 N 31740.000 RL 54.300 (Final Level)	Fill Area 1 (BPH) E 8889.000 N 31728.000 RL 53.980 (Final Level)	Fill Area 1 (BPH) E 8910.000 N 31732.000 RL 53.700 (Final Level)
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	14	-	11
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.501	2.487	-	2.521
Field Moisture Content (%) :	10.7	12.7	11.0	12.2
Hilf MDR Number :	249721	249722	249723	249724
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86.5	89	97.5	98
Field Wet Density (t/m ³) :	2.144	2.170	2.076	2.114
Optimum Moisture Content (%) :	12.4	14.3	11.3	12.5
Moisture Variation :	1.7	1.6	0.3	0.2
Peak Converted Wet Density (t/m ³) :	2.181*	2.15*	2.146	2.209*
Hilf Density Ratio (%) :	98.5	101.0	96.5	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025 - Testing.</p>	<p>APPROVED SIGNATORY</p> <p><i>Liam A Mcdowall</i></p> <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
	<p>Document Code RF89-11</p>



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 130
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249725	249726	249727	249728
Test Number :	454	455	456	457
Sampling Method :	-	-	-	-
Date Sampled :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Date Tested :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8697.000 N 31775.000 RL 58.100	Fill Area 1 (Salmons) E 8686.000 N 31774.000 RL 58.500	Fill Area 1 (Salmons) E 8677.000 N 31773.000 RL 59.000	Fill Area 1 (Salmons) E 8666.000 N 31771.000 RL 59.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.9	9.0	12.0	11.9
Hilf MDR Number :	249725	249726	249727	249728
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85.5	87	97	97.5
Field Wet Density (t/m ³) :	2.058	2.102	2.084	2.109
Optimum Moisture Content (%) :	10.4	10.4	12.4	12.2
Moisture Variation :	1.6	1.3	0.3	0.3
Peak Converted Wet Density (t/m ³) :	2.128	2.137	2.197	2.198
Hilf Density Ratio (%) :	96.5	98.5	95.0	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 131
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249729	249730	249731	249732
Test Number :	458	459	460	461
Sampling Method :	-	-	-	-
Date Sampled :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Date Tested :	20/07/2018	20/07/2018	20/07/2018	20/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8843.000 N 31778.000 RL 51.700	Fill Area 1 (BPH) E 8845.000 N 31789.000 RL 51.600	Fill Area 1 (BPH) E 8894.000 N 31779.000 RL 52.800	Fill Area 1 (BPH) E 8877.000 N 31780.000 RL 52.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	-	11	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.480	-	2.512	-
Field Moisture Content (%) :	10.3	10.3	9.7	9.1
Hilf MDR Number :	249729	249730	249731	249732
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	87	84	83	88.5
Field Wet Density (t/m ³) :	2.162	2.061	2.155	2.109
Optimum Moisture Content (%) :	11.8	12.3	11.7	10.3
Moisture Variation :	1.6	2.0	2.0	1.2
Peak Converted Wet Density (t/m ³) :	2.181*	2.149	2.181*	2.124
Hilf Density Ratio (%) :	99.0	96.0	99.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 132
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249805	249806	249807	249808
Test Number :	467	468	469	470
Sampling Method :	-	-	-	-
Date Sampled :	23/07/2018	23/07/2018	23/07/2018	23/07/2018
Date Tested :	23/07/2018	23/07/2018	23/07/2018	23/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8661.000 N 31780.000 RL 59.900	Fill Area 1 (Salmons) E 8650.000 N 31780.000 RL 60.600	Fill Area 1 (Salmons) E 8641.000 N 31781.000 RL 61.100	Fill Area 1 (Salmons) E 8630.900 N 31782.000 RL 61.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	7.6	18.1	9.6	9.4
Hilf MDR Number :	249805	249806	249807	249808
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	77	87.5	84.5	78
Field Wet Density (t/m ³) :	2.072	2.062	2.089	2.091
Optimum Moisture Content (%) :	9.9	20.7	11.4	12.0
Moisture Variation :	2.4	2.5	1.8	2.6
Peak Converted Wet Density (t/m ³) :	2.042	2.040	2.112	2.115
Hilf Density Ratio (%) :	101.5	101.0	99.0	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 133
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249809	249810	249811	249812
Test Number :	471	472	473	474
Sampling Method :	-	-	-	-
Date Sampled :	23/07/2018	23/07/2018	23/07/2018	23/07/2018
Date Tested :	23/07/2018	23/07/2018	23/07/2018	23/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8874.000 N 31724.000 RL 54.400	Fill Area 1 (BPH) E 8898.000 N 31728.000 RL 53.900	Fill Area 1 (BPH) E 8910.000 N 31732.000 RL 53.700	Fill Area 1 (BPH) E 8876.000 N 31740.000 RL 54.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	9
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	2.512
Field Moisture Content (%) :	14.5	14.8	13.5	11.0
Hilf MDR Number :	249809	249810	249811	249812
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	95.5	98	86.5
Field Wet Density (t/m ³) :	2.116	2.120	2.155	2.159
Optimum Moisture Content (%) :	14.5	15.5	13.7	12.7
Moisture Variation :	0.0	0.7	0.2	1.7
Peak Converted Wet Density (t/m ³) :	2.171	2.162	2.148	2.153*
Hilf Density Ratio (%) :	97.5	98.0	100.5	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--





Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 134
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249813	249814	249815	249816
Test Number :	475	476	477	478
Sampling Method :	-	-	-	-
Date Sampled :	23/07/2018	23/07/2018	23/07/2018	23/07/2018
Date Tested :	23/07/2018	23/07/2018	23/07/2018	23/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8883.000 N 31773.000 RL 53.300	Fill Area 1 (BPH) E 8909.000 N 31771.000 RL 53.200	Fill Area 1 (BPH) E 8933.000 N 31766.500 RL 53.000	Fill Area 1 (BPH) E 8932.000 N 31752.000 RL 52.800
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	10	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.502	-	-
Field Moisture Content (%) :	9.6	7.9	11.8	12.2
Hilf MDR Number :	249813	249814	249815	249816
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.4	AS1289.2.1.4
Moisture Ratio (%) :	82	80	108	98
Field Wet Density (t/m ³) :	2.141	2.126	2.056	2.076
Optimum Moisture Content (%) :	11.7	9.9	10.9	12.4
Moisture Variation :	2.1	2.0	-0.9	0.2
Peak Converted Wet Density (t/m ³) :	2.078	2.098*	2.153	2.162
Hilf Density Ratio (%) :	103.0	101.5	95.5	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	<p>APPROVED SIGNATORY</p>  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	---



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 135
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249928	249929	249930	249931
Test Number :	479	480	481	482
Sampling Method :	-	-	-	-
Date Sampled :	24/07/2018	24/07/2018	24/07/2018	24/07/2018
Date Tested :	24/07/2018	24/07/2018	24/07/2018	24/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8664.000 N 31766.000 RL 59.600	Fill Area 1 (Salmons) E 8653.000 N 31767.000 RL 60.100	Fill Area 1 (Salmons) E 8642.000 N 31766.000 RL 60.900	Fill Area 1 (Salmons) E 8629.000 N 31765.000 RL 61.700
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.3	13.2	11.8	10.5
Hilf MDR Number :	249928	249929	249930	249931
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	98.5	96.5	98.5
Field Wet Density (t/m ³) :	2.064	2.084	2.079	2.100
Optimum Moisture Content (%) :	14.3	13.4	12.2	10.6
Moisture Variation :	0.0	0.2	0.5	0.1
Peak Converted Wet Density (t/m ³) :	2.124	2.153	2.122	2.152
Hilf Density Ratio (%) :	97.0	97.0	98.0	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 136
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	07/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	249932	249933	249934	249935
Test Number :	483	484	485	486
Sampling Method :	-	-	-	-
Date Sampled :	24/07/2018	24/07/2018	24/07/2018	24/07/2018
Date Tested :	24/07/2018	24/07/2018	24/07/2018	24/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8593.000 N 31790.000 RL 63.600	Fill Area 1 (Salmons) E 8594.000 N 31781.000 RL 63.800	Fill Area 1 (Salmons) E 8595.000 N 31772.000 RL 64.000	Fill Area 1 (Salmons) E 8595.000 N 31765.000 RL 63.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	10	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.290	-	-	-
Field Moisture Content (%) :	12.1	11.8	12.4	15.5
Hilf MDR Number :	249932	249933	249934	249934
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99	99.5	98	98.5
Field Wet Density (t/m ³) :	2.086	2.091	2.096	2.093
Optimum Moisture Content (%) :	12.2	11.9	12.7	15.8
Moisture Variation :	0.1	0.1	0.2	0.2
Peak Converted Wet Density (t/m ³) :	2.162*	2.131	2.135	2.135
Hilf Density Ratio (%) :	96.5	98.0	98.0	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 137
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250040	250041	250042	250043
Test Number :	487	488	489	490
Sampling Method :	-	-	-	-
Date Sampled :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Date Tested :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8625.000 N 31761.000 RL 62.200	Fill Area 1 (Salmons) E 8615.000 N 31763.000 RL 62.800	Fill Area 1 (Salmons) E 8604.000 N 31763.000 RL 63.400	Fill Area 1 (Salmons) E 8594.000 N 31763.000 RL 64.300
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.9	11.4	12.1	12.4
Hilf MDR Number :	250040	250041	250042	250043
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98.5	98	84	84.5
Field Wet Density (t/m ³) :	2.093	2.075	2.045	2.059
Optimum Moisture Content (%) :	12.1	11.6	14.4	14.7
Moisture Variation :	0.2	0.2	2.3	2.2
Peak Converted Wet Density (t/m ³) :	2.118	2.103	2.067	2.074
Hilf Density Ratio (%) :	99.0	98.5	99.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 138
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250044	250045	250046	250047
Test Number :	491	492	493	494
Sampling Method :	-	-	-	-
Date Sampled :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Date Tested :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8863.000 N 31783.000 RL 53.700	Fill Area 1 (BPH) E 8887.000 N 31780.000 RL 53.800	Fill Area 1 (BPH) E 8909.000 N 31778.000 RL 53.900	Fill Area 1 (BPH) E 8923.000 N 31777.000 RL 53.900
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	12	-	12	11
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.551	-	2.552	2.556
Field Moisture Content (%) :	9.9	11.9	10.8	11.7
Hilf MDR Number :	250044	250045	250046	250047
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	94.5	99	99.5	98.5
Field Wet Density (t/m ³) :	2.072	2.099	2.076	2.110
Optimum Moisture Content (%) :	10.5	12.0	10.8	11.9
Moisture Variation :	0.6	0.1	0.0	0.2
Peak Converted Wet Density (t/m ³) :	2.161*	2.189	2.153*	2.172*
Hilf Density Ratio (%) :	96.0	96.0	96.5	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam McDowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 139
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250048	250049	250050	250051
Test Number :	495	496	497	498
Sampling Method :	-	-	-	-
Date Sampled :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Date Tested :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8694.000 N 31810.000 RL 58.000	Fill Area 1 (Salmons) E 8684.000 N 31811.000 RL 58.400	Fill Area 1 (Salmons) E 8672.000 N 31812.000 RL 59.200	Fill Area 1 (Salmons) E 8660.000 N 31813.000 RL 60.000
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	12	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	1.549	-
Field Moisture Content (%) :	3.2	11.3	10.9	11.6
Hilf MDR Number :	250048	250049	250050	250051
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	93	96	95.5	98
Field Wet Density (t/m ³) :	2.105	2.122	2.089	2.114
Optimum Moisture Content (%) :	3.4	11.7	11.4	11.8
Moisture Variation :	0.2	0.4	0.4	0.2
Peak Converted Wet Density (t/m ³) :	2.138	2.173	2.068*	2.168
Hilf Density Ratio (%) :	98.5	97.5	101.0	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC



Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 140
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250052	250053	250054	250055
Test Number :	499	500	501	502
Sampling Method :	-	-	-	-
Date Sampled :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Date Tested :	25/07/2018	25/07/2018	25/07/2018	25/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8881.000 N 31763.000 RL 54.400 (Final Level)	Fill Area 1 (BPH) E 8913.000 N 31760.000 RL 53.600 (Final Level)	Fill Area 1 (BPH) E 8909.000 N 31775.000 RL 54.300 (Final Level)	Fill Area 1 (BPH) E 8880.000 N 31777.000 RL 54.700 (Final Level)
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	11	10	11
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.552	2.548	2.553	2.548
Field Moisture Content (%) :	10.9	10.4	9.5	9.7
Hilf MDR Number :	250052	250053	250054	250055
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84	83	80.5	80
Field Wet Density (t/m ³) :	2.175	2.153	2.162	2.152
Optimum Moisture Content (%) :	13.0	12.6	11.8	12.1
Moisture Variation :	2.0	2.2	2.3	2.4
Peak Converted Wet Density (t/m ³) :	2.196*	2.189*	2.172*	2.182*
Hilf Density Ratio (%) :	99.0	98.5	99.5	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025 - Testing.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisongeotech.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 141
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250159	250160	250161	250162
Test Number :	503	504	505	506
Sampling Method :	-	-	-	-
Date Sampled :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Date Tested :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E: 8672.000 N: 31796.000 RL: 59.600	Fill Area 1 (Salmons) E: 8661.900 N: 31796.000 RL: 60.200	Fill Area 1 (Salmons) E: 8638.000 N: 31798.000 RL: 61.600	Fill Area 1 (Salmons) E: 8626.000 N: 31798.000 RL: 62.100
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.7	15.8	14.4	13.3
Hilf MDR Number :	250159	250160	250161	250162
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	101.5	101.5	91.5	99
Field Wet Density (t/m ³) :	2.040	2.046	2.075	2.060
Optimum Moisture Content (%) :	13.5	15.6	15.8	13.4
Moisture Variation :	-0.2	-0.2	1.4	0.1
Peak Converted Wet Density (t/m ³) :	2.094	2.040	2.042	2.130
Hilf Density Ratio (%) :	97.5	100.5	101.5	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 142
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250163	250164	250165	250166
Test Number :	507	508	509	510
Sampling Method :	-	-	-	-
Date Sampled :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Date Tested :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E: 8841.000 N: 31749.000 RL: 52.500	Fill Area 1 (BPH) E: 8823.000 N: 31750.000 RL: 52.100	Fill Area 1 (BPH) E: 8837.000 N: 31734.000 RL: 52.700	Fill Area 1 (BPH) E: 8818.000 N: 31735.000 RL: 52.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.1	10.1	9.5	10.3
Hilf MDR Number :	250163	250164	250165	250166
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	98	101	82.5	102
Field Wet Density (t/m ³) :	2.098	2.098	2.110	2.085
Optimum Moisture Content (%) :	10.3	10.0	11.5	10.1
Moisture Variation :	0.2	-0.1	2.0	-0.2
Peak Converted Wet Density (t/m ³) :	2.108	2.119	2.079	2.124
Hilf Density Ratio (%) :	99.5	99.0	101.5	98.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 143
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250167	250168	250169	250170
Test Number :	511	512	513	514
Sampling Method :	-	-	-	-
Date Sampled :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Date Tested :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E: 8620.000 N: 31823.000 RL: 62.100	Fill Area 1 (Salmons) E: 8614.000 N: 31821.000 RL: 62.600	Fill Area 1 (Salmons) E: 8607.000 N: 31817.000 RL: 62.800	Fill Area 1 (Salmons) E: 8602.000 N: 31814.000 RL: 63.000
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.5	8.3	9.6	9.2
Hilf MDR Number :	250167	250168	250169	250170
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	93	78.5	95	82
Field Wet Density (t/m ³) :	2.015	2.106	2.071	2.115
Optimum Moisture Content (%) :	10.2	10.6	10.1	11.2
Moisture Variation :	0.8	2.3	0.6	2.1
Peak Converted Wet Density (t/m ³) :	2.095	2.081	2.076	2.087
Hilf Density Ratio (%) :	96.0	101.0	100.0	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 144
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	10/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250171	250172	250173	250174
Test Number :	515	516	517	518
Sampling Method :	-	-	-	-
Date Sampled :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Date Tested :	26/07/2018	26/07/2018	26/07/2018	26/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E: 8815.000 N: 31773.000 RL: 51.600	Fill Area 1 (BPH) E: 8824.000 N: 31771.500 RL: 51.800	Fill Area 1 (BPH) E: 8836.000 N: 31774.000 RL: 52.100	Fill Area 1 (BPH) E: 8817.000 N: 31785.000 RL: 51.600
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.2	11.3	8.5	8.1
Hilf MDR Number :	250171	250172	250173	250174
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86	78	77.5	72
Field Wet Density (t/m ³) :	2.141	2.169	2.083	2.108
Optimum Moisture Content (%) :	14.2	14.5	11.0	11.3
Moisture Variation :	1.9	3.2	2.6	3.2
Peak Converted Wet Density (t/m ³) :	2.112	2.124	2.030	2.051
Hilf Density Ratio (%) :	101.5	102.0	102.5	103.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	Reported moisture variation does not accurately reflect placement moisture.			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 145
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250340	250341	250342	250343
Test Number :	519	520	521	522
Sampling Method :	-	-	-	-
Date Sampled :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Date Tested :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8700.000 N 31789.000 RL 58.100	Fill Area 1 (Salmons) E 8691.000 N 31790.000 RL 58.600	Fill Area 1 (Salmons) E 8682.000 N 31791.000 RL 59.300	Fill Area 1 (Salmons) E 8671.000 N 31792.000 RL 59.800
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	16.3	16.4	16.7	12.7
Hilf MDR Number :	250340	250341	250342	250343
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	92	91.5	91.5	87.5
Field Wet Density (t/m ³) :	2.038	2.062	2.028	2.050
Optimum Moisture Content (%) :	17.7	17.9	18.3	14.5
Moisture Variation :	1.4	1.5	1.5	1.8
Peak Converted Wet Density (t/m ³) :	2.003	1.971	2.029	2.051
Hilf Density Ratio (%) :	102.0	104.5	100.0	100.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 146
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250344	250345	250346	250347
Test Number :	523	524	525	526
Sampling Method :	-	-	-	-
Date Sampled :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Date Tested :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8838.000 N 31763.000 RL 53.000	Fill Area 1 (BPH) E 8830.000 N 31757.000 RL 53.100	Fill Area 1 (BPH) E 8829.000 N 31773.000 RL 52.800	Fill Area 1 (BPH) E 8817.000 N 31776.000 RL 52.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	9	13	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.500	2.482	2.481	
Field Moisture Content (%) :	10.3	11.7	11.6	11.2
Hilf MDR Number :	250344	250345	250346	250347
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84.5	102	89	86.5
Field Wet Density (t/m ³) :	2.162	2.188	2.182	2.115
Optimum Moisture Content (%) :	12.2	11.5	13.1	13.0
Moisture Variation :	1.9	-0.2	1.4	1.8
Peak Converted Wet Density (t/m ³) :	2.19*	2.199*	2.228*	2.152
Hilf Density Ratio (%) :	98.5	99.5	98.0	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 147
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250348	250349	250350	250351
Test Number :	527	528	529	530
Sampling Method :	-	-	-	-
Date Sampled :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Date Tested :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8745.000 N 31764.000 RL 55.100	Fill Area 1 (Salmons) E 8737.000 N 31766.000 RL 55.900	Fill Area 1 (Salmons) E 8729.000 N 31768.000 RL 56.500	Fill Area 1 (Salmons) E 8720.000 N 31770.000 RL 57.290
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.8	8.8	13.0	12.2
Hilf MDR Number :	250348	250349	250350	250351
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	90.5	82.5	95	89
Field Wet Density (t/m ³) :	2.086	2.061	2.084	2.090
Optimum Moisture Content (%) :	14.1	10.7	13.6	13.7
Moisture Variation :	1.3	1.9	0.7	1.6
Peak Converted Wet Density (t/m ³) :	2.095	2.065	2.106	2.117
Hilf Density Ratio (%) :	99.5	100.0	99.0	98.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 148
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250352	250353	250354	250355
Test Number :	531	532	533	534
Sampling Method :	-	-	-	-
Date Sampled :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Date Tested :	27/07/2018	27/07/2018	27/07/2018	27/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8820.000 N 31749.000 RL 53.200	Fill Area 1 (BPH) E 8832.000 N 31749.000 RL 53.500	Fill Area 1 (BPH) E 8820.000 N 31749.000 RL 53.200	Fill Area 1 (BPH) E 8806.000 N 31750.000 RL 52.500
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	-	-	10
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.515	-	-	2.486
Field Moisture Content (%) :	9.4	9.2	-	12.5
Hilf MDR Number :	250352	250353	250354	250355
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85	87	100.5	87.5
Field Wet Density (t/m ³) :	2.122	2.089	2.113	2.122
Optimum Moisture Content (%) :	11.1	10.6	-	14.3
Moisture Variation :	1.7	1.4	-0.7	1.8
Peak Converted Wet Density (t/m ³) :	2.2*	2.151	2.161	2.207*
Hilf Density Ratio (%) :	96.5	97.0	98.0	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 149
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250368	250369	250370	250371
Test Number :	535	536	537	538
Sampling Method :	-	-	-	-
Date Sampled :	28/07/2018	28/07/2018	28/07/2018	28/07/2018
Date Tested :	28/07/2018	28/07/2018	28/07/2018	28/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8590.000 N 31744.000 RL 64.600	Fill Area 1 (Salmons) E 8580.000 N 31744.000 RL 65.100	Fill Area 1 (Salmons) E 8573.000 N 31744.000 RL 65.500	Fill Area 1 (Salmons) E 8567.000 N 31745.000 RL 65.700
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.3	8.8	8.1	8.9
Hilf MDR Number :	250368	250369	250370	250371
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	83	84.5	86.5	84
Field Wet Density (t/m ³) :	2.093	2.108	2.098	2.201
Optimum Moisture Content (%) :	10.0	10.4	9.4	10.6
Moisture Variation :	1.8	1.7	1.3	1.8
Peak Converted Wet Density (t/m ³) :	2.192	2.183	2.213	2.179
Hilf Density Ratio (%) :	95.5	96.5	95.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 150
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250436	250437	250438	250439
Test Number :	539	540	541	542
Sampling Method :	-	-	-	-
Date Sampled :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Date Tested :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8819.0 N 31759.5 RL 53.2	Fill Area 1 (BPH) E 8831 N 31755 RL 53.7	Fill Area 1 (BPH) E 8843 N 31753 RL 53.9	Fill Area 1 (BPH) E 8831 N 31755 RL 53.7
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	14.2	14.5	13.6	11.6
Hilf MDR Number :	250436	250437	250438	250439
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	90.5	89.5	103.5	102.5
Field Wet Density (t/m ³) :	2.054	2.048	2.068	2.070
Optimum Moisture Content (%) :	15.7	16.2	13.2	11.3
Moisture Variation :	1.5	1.7	-0.5	-0.3
Peak Converted Wet Density (t/m ³) :	1.973	1.999	2.093	2.090
Hilf Density Ratio (%) :	104.0	102.5	99.0	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 151
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250440	250441	250442	250443
Test Number :	543	544	545	546
Sampling Method :	-	-	-	-
Date Sampled :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Date Tested :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8673 N 31789 RL 59.74	Fill Area 1 (Salmons) E 8667 N 31791 RL 60.1	Fill Area 1 (Salmons) E 8661 N 31793 RL 60.50	Fill Area 1 (Salmons) E 8652 N 31796 RL 61.06
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	10	13
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	2.280	2.380
Field Moisture Content (%) :	11.4	9.4	10.9	10.4
Hilf MDR Number :	250440	250441	250442	250443
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	102.5	100.5	97	102.5
Field Wet Density (t/m ³) :	2.077	2.090	2.178	2.219
Optimum Moisture Content (%) :	11.1	9.4	11.2	10.2
Moisture Variation :	-0.2	0.0	0.3	-0.2
Peak Converted Wet Density (t/m ³) :	2.121	2.002	2.144*	2.157*
Hilf Density Ratio (%) :	98.0	104.5	101.5	103.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 152
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250444	250445	250446	250447
Test Number :	547	548	549	550
Sampling Method :	-	-	-	-
Date Sampled :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Date Tested :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8737 N 31780 RL 55.79	Fill Area 1 (Salmons) E 8730 N 31783 RL 56.35	Fill Area 1 (Salmons) E 8721 N 31788 RL 57.01	Fill Area 1 (Salmons) E 8715 N 31791 RL 57.27
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	12
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	2.373
Field Moisture Content (%) :	11.2	11.6	19.6	13.4
Hilf MDR Number :	250444	250445	250446	250447
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	99.5	100	101
Field Wet Density (t/m ³) :	2.068	2.085	2.090	2.104
Optimum Moisture Content (%) :	11.2	11.6	19.6	13.2
Moisture Variation :	0.0	0.0	0.0	-0.1
Peak Converted Wet Density (t/m ³) :	2.102	2.160	2.165	2.185*
Hilf Density Ratio (%) :	98.5	96.5	96.5	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 153
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250448	250449	250450	250451
Test Number :	551	552	553	554
Sampling Method :	-	-	-	-
Date Sampled :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Date Tested :	30/07/2018	30/07/2018	30/07/2018	30/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8806 N 31802 RL 52.814	Fill Area 1 (BPH) E 8807 N 31793 RL 52.9	Fill Area 1 (BPH) E 8810 N 31769 RL 53.057	Fill Area 1 (BPH) E 8808 N 31782 RL 53.0
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	11
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	2.398
Field Moisture Content (%) :	9.6	10.3	12.0	11.0
Hilf MDR Number :	250448	250449	250450	250451
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85.5	87	99	87
Field Wet Density (t/m ³) :	2.086	2.079	2.099	2.122
Optimum Moisture Content (%) :	11.2	11.9	12.1	12.7
Moisture Variation :	1.7	1.6	0.1	1.7
Peak Converted Wet Density (t/m ³) :	1.999	2.002	2.131	2.063*
Hilf Density Ratio (%) :	104.5	104.0	98.5	103.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 154
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250516	250517	250518	250519
Test Number :	555	556	557	558
Sampling Method :	-	-	-	-
Date Sampled :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Date Tested :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8797 N 31755 RL 53.5	Fill Area 1 (BPH) E 8798 N 31766 RL 53.6	Fill Area 1 (BPH) E 8796 N 31779 RL 53.7	Fill Area 1 (BPH) E 8797.5 N 31766 RL 53.6
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	11	-	10	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.575	-	2.585	-
Field Moisture Content (%) :	10.7	10.8	9.5	11.3
Hilf MDR Number :	250516	250517	250518	250519
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	85	85.5	84	85.5
Field Wet Density (t/m ³) :	2.213	2.232	2.188	2.176
Optimum Moisture Content (%) :	12.6	12.6	11.3	13.2
Moisture Variation :	1.9	1.8	1.9	1.9
Peak Converted Wet Density (t/m ³) :	2.162*	2.123	2.146*	2.117
Hilf Density Ratio (%) :	102.5	105.0	102.0	103.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 155
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250520	250521	250522	250523
Test Number :	559	560	561	562
Sampling Method :	-	-	-	-
Date Sampled :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Date Tested :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8623.00 N 31806.00 RL 62.51	Fill Area 1 (Salmons) E 8615.88 N 31806.21 RL 62.61	Fill Area 1 (Salmons) E 8609.10 N 31806.63 RL 63.99	Fill Area 1 (Salmons) E 8602.31 N 31806.60 RL 63.52
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	10	-	9	6
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.526	-	2.521	2.613
Field Moisture Content (%) :	10.7	9.0	9.3	9.7
Hilf MDR Number :	250520	250521	250522	250523
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100	84	84	84
Field Wet Density (t/m ³) :	2.171	2.149	2.185	2.182
Optimum Moisture Content (%) :	10.7	10.7	11.1	11.6
Moisture Variation :	0.0	1.8	1.8	1.9
Peak Converted Wet Density (t/m ³) :	2.181*	2.133	2.169*	2.151*
Hilf Density Ratio (%) :	99.5	101.0	101.0	101.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	APPROVED SIGNATORY  Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 156
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250524	250525	250526	250527
Test Number :	563	564	565	566
Sampling Method :	-	-	-	-
Date Sampled :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Date Tested :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8834 N 31755 RL 53.8	Fill Area 1 (BPH) E 8822 N 31757 RL 54.1	Fill Area 1 (BPH) E 8808 N 31760 RL 53.9	Fill Area 1 (BPH) E 8796 N 31763 RL 53.8
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	9	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.597	-	-	-
Field Moisture Content (%) :	11.7	11.6	9.7	11.5
Hilf MDR Number :	250524	250525	250526	250527
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	85.5	87	85.5
Field Wet Density (t/m ³) :	2.145	2.122	2.140	2.128
Optimum Moisture Content (%) :	11.6	13.6	11.2	13.4
Moisture Variation :	0.0	1.9	1.5	1.9
Peak Converted Wet Density (t/m ³) :	2.138*	2.141	2.055	2.107
Hilf Density Ratio (%) :	100.5	99.0	104.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 157
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250528	250529	250530	250531
Test Number :	567	568	569	570
Sampling Method :	-	-	-	-
Date Sampled :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Date Tested :	31/07/2018	31/07/2018	31/07/2018	31/07/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8735.5 N 31768.83 RL 56.09	Fill Area 1 (Salmons) E 8730.7 N 31771.93 RL 56.46	Fill Area 1 (Salmons) E 8724.81 N 31775.10 RL 56.77	Fill Area 1 (Salmons) E 8719.21 N 31777.98 RL 57.12
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	150	150
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.6	10.9	9.9	10.0
Hilf MDR Number :	250528	250529	250530	250531
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86	85	85.5	86.5
Field Wet Density (t/m ³) :	2.075	2.098	2.151	2.093
Optimum Moisture Content (%) :	12.4	12.8	11.6	11.6
Moisture Variation :	1.8	1.9	1.7	1.6
Peak Converted Wet Density (t/m ³) :	2.003	2.023	2.042	2.070
Hilf Density Ratio (%) :	103.5	103.5	105.5	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 158
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250641	250642	250643	250644
Test Number :	571	572	573	574
Sampling Method :	-	-	-	-
Date Sampled :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Date Tested :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8636.31 N 31799.88 RL 62.37	Fill Area 1 (Salmons) E 8629.57 N 31800.83 RL 62.74	Fill Area 1 (Salmons) E 8624.63 N 31801.31 RL 62.91	Fill Area 1 (Salmons) E 8619.46 N 31802.31 RL 63.19
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	11.1	12.6	12.7	11.9
Hilf MDR Number :	250641	250642	250643	250644
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	86	92	106.5	99
Field Wet Density (t/m ³) :	2.009	2.013	2.035	2.017
Optimum Moisture Content (%) :	12.9	13.7	11.9	12.0
Moisture Variation :	1.8	1.1	-0.8	0.1
Peak Converted Wet Density (t/m ³) :	2.051	2.079	2.103	2.090
Hilf Density Ratio (%) :	98.0	97.0	97.0	96.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 159
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250645	250646	250647	250648
Test Number :	575	576	577	578
Sampling Method :	-	-	-	-
Date Sampled :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Date Tested :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8927.36 N 31578.62 RL 55.1	Fill Area 1 (BPH) E 8918.19 N 31584.27 RL 55.6	Fill Area 1 (BPH) E 8939.14 N 31572.86 RL 54.7	Fill Area 1 (BPH) E 8951.7 N 31564.1 RL 54.46
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	9.5	9.7	11.3	13.3
Hilf MDR Number :	250645	250646	250647	250648
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	79	79	95	96.5
Field Wet Density (t/m ³) :	2.091	2.065	2.020	2.028
Optimum Moisture Content (%) :	12.0	12.2	11.9	13.8
Moisture Variation :	2.5	2.5	0.6	0.5
Peak Converted Wet Density (t/m ³) :	2.110	2.109	2.104	2.109
Hilf Density Ratio (%) :	99.0	98.0	96.0	96.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 160
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250649	250650	250651	250652
Test Number :	579	580	581	582
Sampling Method :	-	-	-	-
Date Sampled :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Date Tested :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8630.55 N 31832.14 RL 61.75	Fill Area 1 (Salmons) E 8623.27 N 31833.02 RL 61.92	Fill Area 1 (Salmons) E 8616.91 N 31833.36 RL 62.30	Fill Area 1 (Salmons) E 8610.66 N 31831.27 RL 62.84
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	150	150	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	12.4	12.6	11.0	12.5
Hilf MDR Number :	250649	250650	250651	250652
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	100.5	104.5	108	107
Field Wet Density (t/m ³) :	2.080	2.070	2.144	2.116
Optimum Moisture Content (%) :	12.3	12.1	10.2	11.7
Moisture Variation :	-0.1	-0.6	-0.8	-0.8
Peak Converted Wet Density (t/m ³) :	2.178	2.179	2.189	2.211
Hilf Density Ratio (%) :	95.5	95.0	98.0	95.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy Clay	Sandy Clay	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 161
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250653	250654	250655	250656
Test Number :	583	584	585	586
Sampling Method :	-	-	-	-
Date Sampled :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Date Tested :	1/08/2018	1/08/2018	1/08/2018	1/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (BPH) E 8796.6 N 31754.8 RL 54.4	Fill Area 1 (BPH) E 8808.5 N 31751.6 RL 54.3	Fill Area 1 (BPH) E 8787.4 N 31768.8 RL 54.2	Fill Area 1 (BPH) E 8788.9 N 31783.8 RL 54.5
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	13	8	9	11
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.677	2.555	2.646	2.561
Field Moisture Content (%) :	9.6	9.3	11.2	10.5
Hilf MDR Number :	250653	250654	250655	250656
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	92.5	82	88.5	99.5
Field Wet Density (t/m ³) :	2.197	2.159	2.207	2.205
Optimum Moisture Content (%) :	10.4	11.3	12.7	10.6
Moisture Variation :	0.8	2.0	1.4	0.0
Peak Converted Wet Density (t/m ³) :	2.213*	2.184*	2.216*	2.223*
Hilf Density Ratio (%) :	99.5	99.0	99.5	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	MDR performed by Gold Coast Laboratory. Corporate Site No. 1900.			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 162
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250721	250722	250723	250724
Test Number :	587	588	589	590
Sampling Method :	-	-	-	-
Date Sampled :	2/08/2018	2/08/2018	2/08/2018	2/08/2018
Date Tested :	2/08/2018	2/08/2018	2/08/2018	2/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Fill Area 1 (Salmons) E 8705.29 N 31806.60 RL 58.78	Fill Area 1 (Salmons) E 8698.18 N 31808.11 RL 58.92	Fill Area 1 (Salmons) E 8690.77 N 31810.12 RL 59.25	Fill Area 1 (Salmons) E 8684.58 N 31811.40 RL 59.62
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	7	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	2.557	-	-
Field Moisture Content (%) :	15.5	15.0	12.3	13.2
Hilf MDR Number :	250721	250722	250723	250724
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	99	99.5	101	99
Field Wet Density (t/m ³) :	2.064	2.083	2.053	2.069
Optimum Moisture Content (%) :	15.7	15.1	12.2	13.4
Moisture Variation :	0.2	0.1	-0.1	0.1
Peak Converted Wet Density (t/m ³) :	2.085	2.13*	2.078	2.092
Hilf Density Ratio (%) :	99.0	98.0	99.0	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 163
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250725	250726	
Test Number :	591	592	
Sampling Method :	-	-	
Date Sampled :	2/08/2018	2/08/2018	
Date Tested :	2/08/2018	2/08/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site (Cut)	On Site (Cut)	
Lot Number :	-	-	
Sample Location :	Fill Area 1 (BPH) E 8816.38 N 31582.7 RL 57.91	Fill Area 1 (BPH) E 8817.6 N 31588.4 RL 58.4	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	6	9	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	2.551	2.554	
Field Moisture Content (%) :	11.1	11.0	
Hilf MDR Number :	250725	250726	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	102	100.5	
Field Wet Density (t/m ³) :	2.113	2.125	
Optimum Moisture Content (%) :	10.9	11.0	
Moisture Variation :	-0.2	0.0	
Peak Converted Wet Density (t/m ³) :	2.11*	2.09*	
Hilf Density Ratio (%) :	100.0	101.5	
Minimum Specification :	95	95	
Moisture Specification :	-	-	
Site Selection :	-	-	
Soil Description :	Clayey SAND	Clayey SAND	
Remarks :	-		

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 164
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250729	250730	250731	250732
Test Number :	593	594	595	596
Sampling Method :	-	-	-	-
Date Sampled :	3/08/2018	3/08/2018	3/08/2018	3/08/2018
Date Tested :	3/08/2018	3/08/2018	3/08/2018	3/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Working Layer - House Lots E 8984 N 31541 Final Level	Working Layer - House Lots E 9035 N 31483 Final Level	Working Layer - House Lots E 9005 N 31519 Final Level	Working Layer - House Lots E 9007 N 31544 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	13	12	12	11
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.410	2.464	2.346	2.406
Field Moisture Content (%) :	10.3	10.6	10.2	10.3
Hilf MDR Number :	250729	250730	250731	250732
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	81.5	85.5	83.5	87
Field Wet Density (t/m ³) :	2.108	2.130	2.102	2.116
Optimum Moisture Content (%) :	12.6	12.4	12.2	11.8
Moisture Variation :	2.3	1.8	2.0	1.6
Peak Converted Wet Density (t/m ³) :	2.163*	2.165*	2.167*	2.176*
Hilf Density Ratio (%) :	97.5	98.5	97.0	97.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---





Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 165
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250733	250734	250735	250736
Test Number :	597	598	599	600
Sampling Method :	-	-	-	-
Date Sampled :	3/08/2018	3/08/2018	3/08/2018	3/08/2018
Date Tested :	3/08/2018	3/08/2018	3/08/2018	3/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Working Layer - House Lots E 8958 N 31567 Final Level	Working Layer - House Lots E 9065 N 31500 Final Level	Working Layer - House Lots E 8944 N 31565 Final Level	Working Layer - House Lots E 8899 N 31600 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	12	10	13	12
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.400	2.314	2.379	2.469
Field Moisture Content (%) :	10.7	9.3	10.0	10.0
Hilf MDR Number :	250733	250734	250735	250736
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84.5	84	82.5	83
Field Wet Density (t/m ³) :	2.135	2.124	2.105	2.127
Optimum Moisture Content (%) :	12.7	11.0	12.1	12.1
Moisture Variation :	2.0	1.8	2.1	2.1
Peak Converted Wet Density (t/m ³) :	2.163*	2.172*	2.168*	2.184*
Hilf Density Ratio (%) :	98.5	98.0	97.0	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	--



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899



www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 166
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250737	250738	250739	250740
Test Number :	601	602	603	604
Sampling Method :	-	-	-	-
Date Sampled :	3/08/2018	3/08/2018	3/08/2018	3/08/2018
Date Tested :	3/08/2018	3/08/2018	3/08/2018	3/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site (Cut)	On Site (Cut)	On Site (Cut)	On Site (Cut)
Lot Number :	-	-	-	-
Sample Location :	Working Layer - House Lots E 8826 N 31593 Final Level	Working Layer - House Lots E 8871 N 31596 Final Level	Working Layer - House Lots E 8592 N 31819 Final Level	Working Layer - House Lots E 8578 N 31803 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	13	12	12	12
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	2.474	2.431	2.361	2.381
Field Moisture Content (%) :	10.6	9.6	10.2	9.9
Hilf MDR Number :	250737	250738	250739	250740
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	87	83.5	85	86.5
Field Wet Density (t/m ³) :	2.114	2.127	2.117	2.136
Optimum Moisture Content (%) :	12.2	11.5	12.0	11.5
Moisture Variation :	1.6	1.9	1.8	1.6
Peak Converted Wet Density (t/m ³) :	2.182*	2.186*	2.175*	2.163*
Hilf Density Ratio (%) :	97.0	97.5	97.5	99.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Clayey SAND	Clayey SAND	Clayey SAND	Clayey SAND
Remarks :	-			

* - denotes adjusted for oversize

 Accredited for compliance with ISO/IEC 17025.	<p>APPROVED SIGNATORY</p>  <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
---	---



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899


www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 168
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	21/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	250891	250892	
Test Number :	608	609	
Sampling Method :	-	-	
Date Sampled :	7/08/2018	7/08/2018	
Date Tested :	7/08/2018	7/08/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	Fill Area 1 E 8684.87 N 31792.65 RL 59.30	Fill Area 1 E 8676.08 N 31795.11 RL 59.80	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	11	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	2.613	
Field Moisture Content (%) :	13.6	13.4	
Hilf MDR Number :	250891	250892	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	98	99.5	
Field Wet Density (t/m ³) :	2.068	2.098	
Optimum Moisture Content (%) :	13.8	13.5	
Moisture Variation :	0.2	0.1	
Peak Converted Wet Density (t/m ³) :	2.093	2.099*	
Hilf Density Ratio (%) :	99.0	100.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p> <p><i>Liam A Mcdowall</i></p> <p>Liam Mcdowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
	<p>Document Code RF89-11</p>



MORRISON
GEOTECHNIC

Brisbane | Gold Coast | Maroochydore
Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955
ABN: 51 009 878 899
www.morrisonge.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 169
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	28/08/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251065	251066	251067	251068
Test Number :	610	611	612	613
Sampling Method :	-	-	-	-
Date Sampled :	10/08/2018	10/08/2018	10/08/2018	10/08/2018
Date Tested :	10/08/2018	10/08/2018	10/08/2018	10/08/2018
Material Type :	General Fill	General Fill	General Fill	General Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	-	-	-	-
Sample Location :	E 8647.000 N 31800.000 Final Level	E 8662.000 N 31803.000 Final Level	E 8675.000 N 31803.000 Final Level	E 8683.000 N 31802.000 Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	13.0	13.4	12.2	12.1
Hilf MDR Number :	251065	251066	251067	251068
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	90	97.5	86	95.5
Field Wet Density (t/m ³) :	2.043	2.099	2.027	2.078
Optimum Moisture Content (%) :	14.4	13.8	14.2	12.6
Moisture Variation :	1.5	0.3	2.0	0.6
Peak Converted Wet Density (t/m ³) :	2.089	2.075	2.078	2.065
Hilf Density Ratio (%) :	98.0	101.0	97.5	100.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	-2% to +3%
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025 - Testing.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 170
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	3/09/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251228	251229	251230	
Test Number :	614	615	616	
Sampling Method :	-	-	-	
Date Sampled :	15/08/2018	15/08/2018	15/08/2018	
Date Tested :	15/08/2018	15/08/2018	15/08/2018	
Material Type :	General Fill	General Fill	General Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	-	-	-	
Sample Location :	E 8706.220 N 31798.000 Final Level	E 8720.780 N 31802.000 Final Level	E 8719.110 N 31823.000 Final Level	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	-	-	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	-	-	
Field Moisture Content (%) :	11.5	9.6	8.3	
Hilf MDR Number :	251228	251229	251230	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	85.5	82.5	79.5	
Field Wet Density (t/m ³) :	2.127	2.051	2.146	
Optimum Moisture Content (%) :	13.5	11.6	10.4	
Moisture Variation :	2.0	2.0	2.1	
Peak Converted Wet Density (t/m ³) :	2.091	2.052	2.086	
Hilf Density Ratio (%) :	101.5	100.0	103.0	
Minimum Specification :	95	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	-2% to +3%	
Site Selection :	-	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 171
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	3/09/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251723	251724	
Test Number :	617	618	
Sampling Method :	-	-	
Date Sampled :	23/08/2018	23/08/2018	
Date Tested :	23/08/2018	23/08/2018	
Material Type :	General Fill	General Fill	
Material Source :	On Site	On Site	
Lot Number :	-	-	
Sample Location :	E 8834.000 N 31653.000 RL 55.600	E 8807.000 N 31668.000 RL 56.600	
Test Depth (mm) :	150	150	
Layer Depth (mm) :	-	-	
Maximum Size (mm) :	19	19	
Oversize Wet (%) :	-	-	
Oversize Dry (%) :	-	-	
Oversize Density (t/m ³) :	-	-	
Field Moisture Content (%) :	11.7	10.4	
Hilf MDR Number :	251723	251724	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	86.5	81	
Field Wet Density (t/m ³) :	2.090	2.087	
Optimum Moisture Content (%) :	13.5	12.8	
Moisture Variation :	1.8	2.4	
Peak Converted Wet Density (t/m ³) :	2.099	2.087	
Hilf Density Ratio (%) :	99.5	100.0	
Minimum Specification :	95	95	
Moisture Specification :	-2% to +3%	-2% to +3%	
Site Selection :	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	
Remarks :	-		



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 172
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	3/09/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251979	251980	251981	251982
Test Number :	619	620	621	622
Sampling Method :	-	-	-	-
Date Sampled :	29/08/2018	29/08/2018	29/08/2018	29/08/2018
Date Tested :	29/08/2018	29/08/2018	29/08/2018	29/08/2018
Material Type :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	1293	1317	1315	1319
Sample Location :	Lot 1293 6m From North Boundary 3m From West Boundary Final Level	Lot 1317 4m From South Boundary 6m From West Boundary Final Level	Lot 1315 4m From North Boundary 6m From West Boundary Final Level	Lot 1319 4m From North Boundary 2m From West Boundary Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	8.9	10.1	10.7	10.7
Hilf MDR Number :	251979	251980	251981	251982
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	75.5	89.5	98.5	85
Field Wet Density (t/m ³) :	2.075	2.188	2.053	2.169
Optimum Moisture Content (%) :	11.8	11.3	10.9	12.6
Moisture Variation :	2.9	1.2	0.2	1.9
Peak Converted Wet Density (t/m ³) :	2.095	2.145	2.099	2.150
Hilf Density Ratio (%) :	99.0	102.0	98.0	101.0
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11



Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 173
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	3/09/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251983	251984	251985	251986
Test Number :	623	624	625	626
Sampling Method :	-	-	-	-
Date Sampled :	29/08/2018	29/08/2018	29/08/2018	29/08/2018
Date Tested :	29/08/2018	29/08/2018	29/08/2018	29/08/2018
Material Type :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	1321	1286	1296	2001
Sample Location :	Lot 1321 5m From South Boundary 3m From East Boundary Final Level	Lot 1286 4m From South Boundary 2m From East Boundary Final Level	Lot 1296 4m From North Boundary 6m From West Boundary Final Level	Lot 2001 3m From North Boundary 4m From East Boundary Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	6.9	10.1	10.7	11.1
Hilf MDR Number :	251983	251984	251985	251986
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	66	90.5	81.5	83
Field Wet Density (t/m ³) :	2.064	2.071	2.083	2.049
Optimum Moisture Content (%) :	10.4	11.2	13.1	13.4
Moisture Variation :	3.6	1.1	2.4	2.2
Peak Converted Wet Density (t/m ³) :	2.109	2.141	2.114	2.104
Hilf Density Ratio (%) :	98.0	96.5	98.5	97.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169



**MORRISON
GEOTECHNIC**

Brisbane | Gold Coast | Maroochydore

Unit 1, 35 Limestone Street (PO Box 3063), Darra Q 4076 P (07) 3279 0900 F (07) 3279 0955

ABN: 51 009 878 899

www.morrisongeo.com.au

Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 174
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	3/09/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251987	251988	251989	251990
Test Number :	627	628	629	630
Sampling Method :	-	-	-	-
Date Sampled :	29/08/2018	29/08/2018	29/08/2018	29/08/2018
Date Tested :	29/08/2018	29/08/2018	29/08/2018	29/08/2018
Material Type :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill
Material Source :	On Site	On Site	On Site	On Site
Lot Number :	2003	1138	1261	1258
Sample Location :	Lot 2003 5m From North Boundary 7m From East Boundary Final Level	Lot 1138 4m From North Boundary 6m From East Boundary Final Level	Lot 1261 3m From North Boundary 6m From East Boundary Final Level	Lot 1258 4m From North Boundary 4m From East Boundary Final Level
Test Depth (mm) :	150	150	150	150
Layer Depth (mm) :	-	-	-	-
Maximum Size (mm) :	19	19	19	19
Oversize Wet (%) :	-	-	-	-
Oversize Dry (%) :	-	-	-	-
Oversize Density (t/m ³) :	-	-	-	-
Field Moisture Content (%) :	10.9	9.6	10.8	8.1
Hilf MDR Number :	251987	251988	251989	251990
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1
Compactive Effort :	Standard	Standard	Standard	Standard
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1
Moisture Ratio (%) :	84.5	82.5	89	77.5
Field Wet Density (t/m ³) :	2.051	2.082	2.098	2.106
Optimum Moisture Content (%) :	12.9	11.6	12.1	10.5
Moisture Variation :	2.0	2.0	1.3	2.4
Peak Converted Wet Density (t/m ³) :	2.074	2.115	2.142	2.112
Hilf Density Ratio (%) :	99.0	98.5	98.0	99.5
Minimum Specification :	95	95	95	95
Moisture Specification :	-	-	-	-
Site Selection :	-	-	-	-
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	Sandy CLAY
Remarks :	-			



Accredited for compliance with ISO/IEC 17025.

APPROVED SIGNATORY

Liam A Mcdowall

Liam Mcdowall (Brisbane) - Branch Manager
NATA Accreditation Number
1162 / 1169

Document Code RF89-11




Hilf Density Ratio Report

Client :	SHADFORTH'S CIVIL PTY LTD	Report Number:	DL18/096 - 175
Address :	99 SANDALWOOD LANE, FOREST GLEN, QLD, 4556	Report Date :	3/09/2018
Project Name :	EARTHWORKS - EVERLEIGH PRECINCT 1.1	Order Number :	2161-11002
Project Number :	DL18/096	Test Method :	AS1289.5.8.1 & 5.7.1
Location:	TEVIOT ROAD , GREENBANK	Page 1 of 1	

Sample Number :	251991	251992	251993	
Test Number :	631	632	633	
Sampling Method :	-	-	-	
Date Sampled :	29/08/2018	29/08/2018	29/08/2018	
Date Tested :	29/08/2018	29/08/2018	29/08/2018	
Material Type :	Allotment Fill	Allotment Fill	Allotment Fill	
Material Source :	On Site	On Site	On Site	
Lot Number :	1256	1254	1252	
Sample Location :	Lot 1256 5m From South Boundary 4m From West Boundary Final Level	Lot 1254 6m From North Boundary 4m From East Boundary Final Level	Lot 1252 7m From South Boundary 5m From East Boundary Final Level	
Test Depth (mm) :	150	150	150	
Layer Depth (mm) :	-	-	-	
Maximum Size (mm) :	19	19	19	
Oversize Wet (%) :	-	8	8	
Oversize Dry (%) :	-	-	-	
Oversize Density (t/m ³) :	-	2.500	2.520	
Field Moisture Content (%) :	7.6	8.1	9.3	
Hilf MDR Number :	251991	251992	251993	
Hilf MDR Method :	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	AS1289.5.1.1 & 5.7.1	
Compactive Effort :	Standard	Standard	Standard	
Field Density Method :	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	AS1289.5.8.1 & 5.7.1	
Moisture Method :	AS1289.2.1.1	AS1289.2.1.1	AS1289.2.1.1	
Moisture Ratio (%) :	62.5	65	81.5	
Field Wet Density (t/m ³) :	2.081	2.123	2.220	
Optimum Moisture Content (%) :	12.1	12.4	11.4	
Moisture Variation :	4.5	4.3	2.2	
Peak Converted Wet Density (t/m ³) :	2.079	2.129*	2.185*	
Hilf Density Ratio (%) :	100.0	99.5	101.5	
Minimum Specification :	95	95	95	
Moisture Specification :	-	-	-	
Site Selection :	-	-	-	
Soil Description :	Sandy CLAY	Sandy CLAY	Sandy CLAY	
Remarks :	-			

* - denotes adjusted for oversize

 <p>Accredited for compliance with ISO/IEC 17025.</p>	<p>APPROVED SIGNATORY</p> <p><i>Liam A McDowall</i></p> <p>Liam McDowall (Brisbane) - Branch Manager NATA Accreditation Number 1162 / 1169</p>
	<p>Document Code RF89-11</p>

Important Information about Your Geotechnical Engineering Report

Subsurface problems are a principal cause of construction delays, cost overruns, claims, and disputes.

While you cannot eliminate all such risks, you can manage them. The following information is provided to help.

Geotechnical Services Are Performed for Specific Purposes, Persons, and Projects

Geotechnical engineers structure their services to meet the specific needs of their clients. A geotechnical engineering study conducted for a civil engineer may not fulfill the needs of a construction contractor or even another civil engineer. Because each geotechnical engineering study is unique, each geotechnical engineering report is unique, prepared *solely* for the client. No one except you should rely on your geotechnical engineering report without first conferring with the geotechnical engineer who prepared it. *And no one — not even you — should apply the report for any purpose or project except the one originally contemplated.*

Read the Full Report

Serious problems have occurred because those relying on a geotechnical engineering report did not read it all. Do not rely on an executive summary. Do not read selected elements only.

A Geotechnical Engineering Report Is Based on A Unique Set of Project-Specific Factors

Geotechnical engineers consider a number of unique, project-specific factors when establishing the scope of a study. Typical factors include: the client's goals, objectives, and risk management preferences; the general nature of the structure involved, its size, and configuration; the location of the structure on the site; and other planned or existing site improvements, such as access roads, parking lots, and underground utilities. Unless the geotechnical engineer who conducted the study specifically indicates otherwise, do not rely on a geotechnical engineering report that was:

- not prepared for you,
- not prepared for your project,
- not prepared for the specific site explored, or
- completed before important project changes were made.

Typical changes that can erode the reliability of an existing geotechnical engineering report include those that affect:

- the function of the proposed structure, as when it's changed from a parking garage to an office building, or from a light industrial plant to a refrigerated warehouse,

- elevation, configuration, location, orientation, or weight of the proposed structure,
- composition of the design team, or
- project ownership.

As a general rule, *always* inform your geotechnical engineer of project changes—even minor ones—and request an assessment of their impact. *Geotechnical engineers cannot accept responsibility or liability for problems that occur because their reports do not consider developments of which they were not informed.*

Subsurface Conditions Can Change

A geotechnical engineering report is based on conditions that existed at the time the study was performed. *Do not rely on a geotechnical engineering report* whose adequacy may have been affected by: the passage of time; by man-made events, such as construction on or adjacent to the site; or by natural events, such as floods, earthquakes, or groundwater fluctuations. *Always* contact the geotechnical engineer before applying the report to determine if it is still reliable. A minor amount of additional testing or analysis could prevent major problems.

Most Geotechnical Findings Are Professional Opinions

Site exploration identifies subsurface conditions only at those points where subsurface tests are conducted or samples are taken. Geotechnical engineers review field and laboratory data and then apply their professional judgment to render an opinion about subsurface conditions throughout the site. Actual subsurface conditions may differ—sometimes significantly—from those indicated in your report. Retaining the geotechnical engineer who developed your report to provide construction observation is the most effective method of managing the risks associated with unanticipated conditions.

A Report's Recommendations Are *Not* Final

Do not overrely on the construction recommendations included in your report. *Those recommendations are not final*, because geotechnical engineers develop them principally from judgment and opinion. Geotechnical engineers can finalize their recommendations only by observing actual

subsurface conditions revealed during construction. *The geotechnical engineer who developed your report cannot assume responsibility or liability for the report's recommendations if that engineer does not perform construction observation.*

A Geotechnical Engineering Report Is Subject to Misinterpretation

Other design team members' misinterpretation of geotechnical engineering reports has resulted in costly problems. Lower that risk by having your geotechnical engineer confer with appropriate members of the design team after submitting the report. Also retain your geotechnical engineer to review pertinent elements of the design team's plans and specifications. Contractors can also misinterpret a geotechnical engineering report. Reduce that risk by having your geotechnical engineer participate in prebid and preconstruction conferences, and by providing construction observation.

Do Not Redraw the Engineer's Logs

Geotechnical engineers prepare final boring and testing logs based upon their interpretation of field logs and laboratory data. To prevent errors or omissions, the logs included in a geotechnical engineering report should *never* be redrawn for inclusion in architectural or other design drawings. Only photographic or electronic reproduction is acceptable, *but recognize that separating logs from the report can elevate risk.*

Give Contractors a Complete Report and Guidance

Some owners and design professionals mistakenly believe they can make contractors liable for unanticipated subsurface conditions by limiting what they provide for bid preparation. To help prevent costly problems, give contractors the complete geotechnical engineering report, *but* preface it with a clearly written letter of transmittal. In that letter, advise contractors that the report was not prepared for purposes of bid development and that the report's accuracy is limited; encourage them to confer with the geotechnical engineer who prepared the report (a modest fee may be required) and/or to conduct additional study to obtain the specific types of information they need or prefer. A prebid conference can also be valuable. *Be sure contractors have sufficient time* to perform additional study. Only then might you be in a position to give contractors the best information available to you, while requiring them to at least share some of the financial responsibilities stemming from unanticipated conditions.

Read Responsibility Provisions Closely

Some clients, design professionals, and contractors do not recognize that geotechnical engineering is far less exact than other engineering disciplines. This lack of understanding has created unrealistic expectations that

have led to disappointments, claims, and disputes. To help reduce the risk of such outcomes, geotechnical engineers commonly include a variety of explanatory provisions in their reports. Sometimes labeled "limitations" many of these provisions indicate where geotechnical engineers' responsibilities begin and end, to help others recognize their own responsibilities and risks. *Read these provisions closely.* Ask questions. Your geotechnical engineer should respond fully and frankly.

Geoenvironmental Concerns Are Not Covered

The equipment, techniques, and personnel used to perform a *geoenvironmental* study differ significantly from those used to perform a *geotechnical* study. For that reason, a geotechnical engineering report does not usually relate any geoenvironmental findings, conclusions, or recommendations; e.g., about the likelihood of encountering underground storage tanks or regulated contaminants. *Unanticipated environmental problems have led to numerous project failures.* If you have not yet obtained your own geoenvironmental information, ask your geotechnical consultant for risk management guidance. *Do not rely on an environmental report prepared for someone else.*

Obtain Professional Assistance To Deal with Mold

Diverse strategies can be applied during building design, construction, operation, and maintenance to prevent significant amounts of mold from growing on indoor surfaces. To be effective, all such strategies should be devised for the *express purpose* of mold prevention, integrated into a comprehensive plan, and executed with diligent oversight by a professional mold prevention consultant. Because just a small amount of water or moisture can lead to the development of severe mold infestations, a number of mold prevention strategies focus on keeping building surfaces dry. While groundwater, water infiltration, and similar issues may have been addressed as part of the geotechnical engineering study whose findings are conveyed in this report, the geotechnical engineer in charge of this project is not a mold prevention consultant; ***none of the services performed in connection with the geotechnical engineer's study were designed or conducted for the purpose of mold prevention. Proper implementation of the recommendations conveyed in this report will not of itself be sufficient to prevent mold from growing in or on the structure involved.***

Rely on Your ASFE-Member Geotechnical Engineer for Additional Assistance

Membership in ASFE/THE BEST PEOPLE ON EARTH exposes geotechnical engineers to a wide array of risk management techniques that can be of genuine benefit for everyone involved with a construction project. Confer with your ASFE-member geotechnical engineer for more information.



8811 Colesville Road/Suite G106, Silver Spring, MD 20910
Telephone: 301/565-2733 Facsimile: 301/589-2017
e-mail: info@asfe.org www.asfe.org

Copyright 2004 by ASFE, Inc. Duplication, reproduction, or copying of this document, in whole or in part, by any means whatsoever, is strictly prohibited, except with ASFE's specific written permission. Excerpting, quoting, or otherwise extracting wording from this document is permitted only with the express written permission of ASFE, and only for purposes of scholarly research or book review. Only members of ASFE may use this document as a complement to or as an element of a geotechnical engineering report. Any other firm, individual, or other entity that so uses this document without being an ASFE member could be committing negligent or intentional (fraudulent) misrepresentation.