

Level One Compliance Report

BULK EARTHWORKS FILLING OPERATIONS Everleigh Estate Precinct 9.6

July 19, 2023

Prepared By

MORRISON GEOTECHNIC

Prepared for:

Golding Contractors Pty Ltd

Document Reference: PTP/10047



MORRISON
GEOTECHNIC

Gold Coast Office
Job No: PTP/10047
Ref No: P9.6
Author: Gary Taylor

19 July 2023

Shadforth Civil
99 Sandalwood Lane
Forest Glen Qld 4556

ATTENTION: CALLUM WATTS
Email: callum.watts@shadcivil.com.au

**RE: LEVEL ONE COMPLIANCE REPORT FOR BULK EARTHWORKS FILLING OPERATIONS,
EVERLEIGH ESTATE - PRECINCT 9.6, TEVIOT ROAD, GREENBANK**

1.0	INTRODUCTION	2
1.1	General	2
1.2	Previous Earthworks	4
1.3	The Project	4
2.0	THE BRIEF	4
2.1	Additional Requirements	4
3.0	METHODOLOGY	5
3.1	Stripped Surface Assessment	5
3.2	Filling Operations	6
4.0	STATEMENT OF COMPLIANCE	9
5.0	EXCLUSIONS	9
6.0	LIMITATIONS	10
	ATTACHMENTS:	11
	Appendix A – Site Plans Showing Test Locations	11
	Appendix B – Laboratory Test Results Reports	11

Figure 2: Actual Constructed Area of Fill (600mm BFSL) – Shadforth Survey Plans


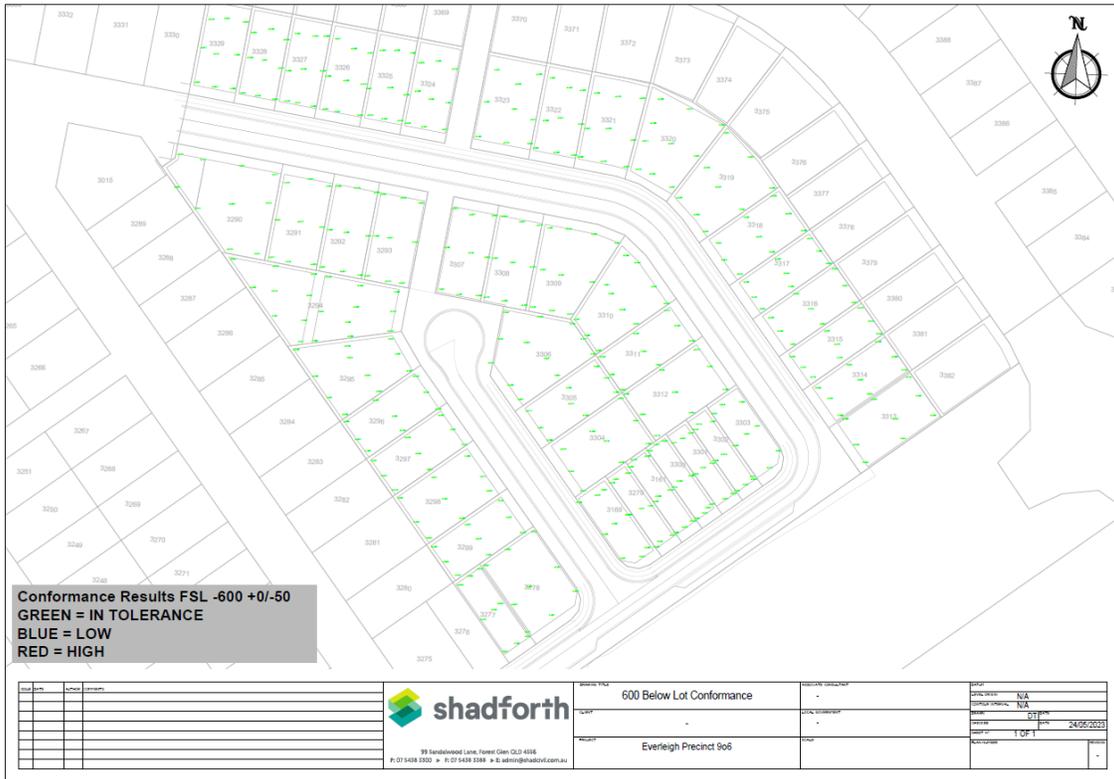


Figure 3: Actual Constructed Area of Fill (100mm BFSL) – Shadforth Survey Plans

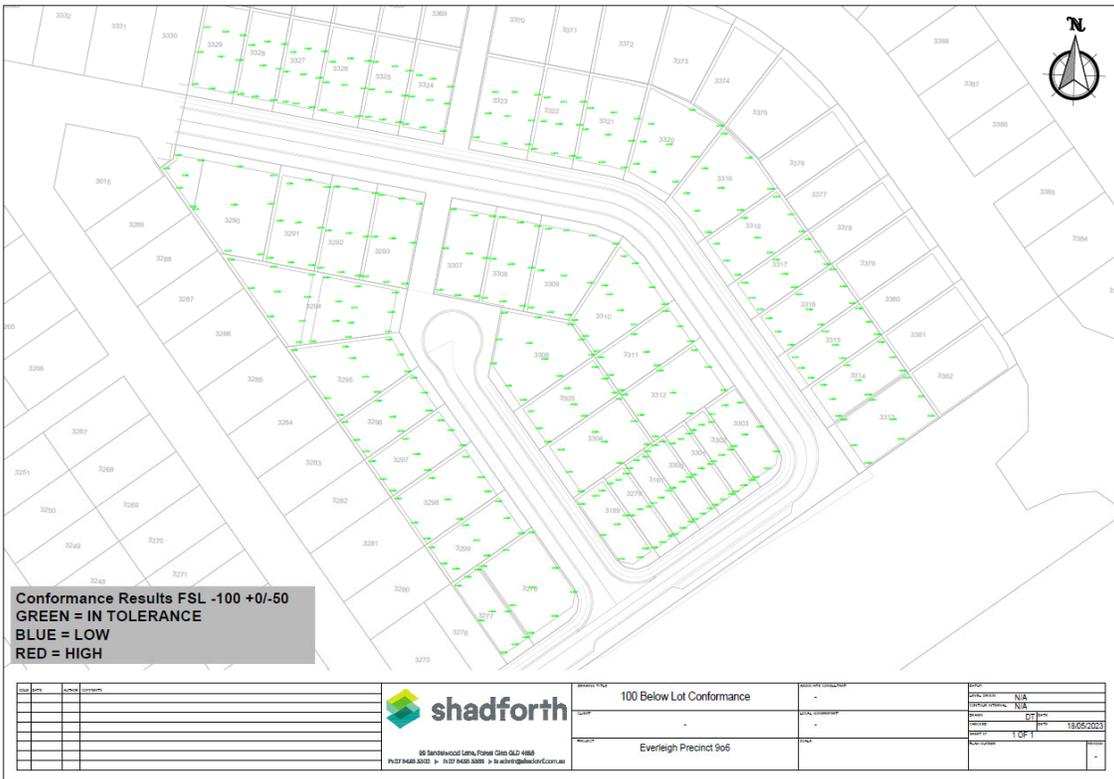

1.2 Previous Earthworks

As far as Morrison Geotechnic are aware, there were no previous earthworks at the Site.

1.3 The Project

The project includes filling operations to construct building platforms to support proposed residences, new pavements, and underground services. The Site is bounded by sports and recreation precinct to the south, existing developments to the west and future precincts to the north and east.

2.0 THE BRIEF

The Brief from the Client and relevant documents were limited to:

- Level One Inspection and Testing of the placement and compaction of fill materials in general accordance with AS3798 2007 – “Guidelines on Earthworks for Commercial and Residential Developments”.
- Relative Density Control Testing in accordance with AS1289 – Testing of Soils for Engineering Purposes and at frequencies required in AS3798 Table 8.1.
- Earthworks Notes on MIR-0906-C200-B Drawing.
- Recommendations in Morrison Geotechnic report “Recommended Filling Earthworks Specification” report 16520B, dated 25th June 2020.

All other design requirements such as CBR and Quality of Materials, site classification, material assessments, foundation assessments and slope / global stability appraisals were not included in the Brief and are therefore excluded from this Report.

For the actual constructed fill thickness and extremities on fill placed, a disclosure plan should be requested from the developer.

2.1 Additional Requirements

All fill at The Site was to be constructed in accordance with the Earthworks Specification as shown on Premise Drawing – MIR-0906-C200-B.

The earthworks specification is presented as Figure 4 below.

Figure 4 Earthworks Specification

EARTHWORKS SPECIFICATION

SPECIFICATION	DEPTH RANGE (m)				PAVEMENT SUBGRADE	TRENCH BACKFILL
	0.0 - 0.6	0.6 - 3.00	3.00 - 5.00	> 5.00		
CBR %	-	-	-	-	10	15
LAYER THICKNESS (mm)	300	300	300	300	BETWEEN SUBGRADE AND 0.3m BELOW	300
MAXIMUM PARTICLE SIZE (mm)	200	500	500	500	200	200
% PASSING 37.5mm	80% MIN	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES			
% PASSING 0.075mm	30% MIN	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES AND AS3798
COMPACTION	95% STD	95% STD	95% STD	95% STD	100% STD	95% MOD IN ROADS AND 95% STD OUTSIDE ROADS
MOISTURE	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	60% - 90% OF OMC	+/- 2% OMC
<p>NOTES:</p> <ol style="list-style-type: none"> 1. OMC - OPTIMUM MOISTURE CONTENT 2. LAYER OF THICKNESS IS LIMITED TO 300mm TO ALLOW IDENTIFICATION OF LARGER PARTICLES AND ALLOW EVERY CHANCE OF BREAK DOWN IN FILLING OR REMOVAL. 3. TREATMENT OF ROCK TO SIZES ABOVE SHOULD BE CARRIED OUT IN CUT PRIOR TO LOADING TO FILL AREAS. TREATED ROCK TO BE APPROVED BY GITA PRIOR TO TRANSPORTING. 4. UPPER 0.6m, (PARTICULARLY IN AREAS OF DEEP FILL), OF THE FILL PROFILE TO BE RELATIVELY IMPERMEABLE HENCE INCREASE IN FINES COMPONENT. 5. PROOF ROLL TESTING ON EACH COMPACTED LAYER USING RUBBER WHEELED PLANT SUCH AS LOADED ADT'S OR LOADED SCRAPERS. UNFAVOURABLE DEFORMATION OF THE COMPACTED SURFACE UNDER LOAD OF ADT'S OR SCRAPERS WILL REQUIRE REPAIR PRIOR TO ADDITIONAL PLACEMENT. 6. MECHANICAL INTERLOCK METHODOLOGY IS NOT APPROPRIATE DUE TO POOR DURABILITY OF SITE WON SANDSTONE. FILL COMPOSITION IS REQUIRED TO INCLUDE AN APPROPRIATE SAND GRAVEL AND FINES COMPONENT CONFORMING TO THE REQUIREMENTS OF AS798. <p>KEY OUTCOMES FOR EARTHWORKS OPERATIONS</p> <ol style="list-style-type: none"> 1. DELIVER RESIDENTIAL LOTS WITH FAVOURABLE LOT CLASSIFICATIONS - I.E - NO P CLASSIFICATIONS 2. FILL THICKNESS DOES NOT VARY MORE THAN 2m OVER A DISTANCE OF 10m 3. CONSTRUCT FILL AND LIMIT LONG TERM CREEP SETTLEMENTS TO WITHIN 0.5% TO 1.0% OF THE FILL THICKNESS 4. BUILDING PLATFORM THAT ALLOWS BUILDERS TO CONSTRUCT SLAB ON GROUND RAFTS USING LIGHT EARTHMOVING EQUIPMENT 5. MATERIAL WON FROM CUTS AND USED IN FILL WITH REQUIRE <ul style="list-style-type: none"> • CUTS IN ROCK AS WELL AS BLENDED WITH • CUTS IN FINER MATERIALS SUCH AS SANDS AND CLAYS 6. CREATING A FILL PLATFORM THAT IS ABLE TO BE TESTED IN ACCORDANCE WITH AS3798 AND AS1289 						

Lots and pavements where rock of medium strength or stronger was exposed at the final cut earthworks levels, were cut to a depth of approximately 0.6m below the final earthworks levels. The excavated rock was then replaced with fill materials compliant with the specification requirements for materials within the 0.0m to 0.6m depth range as described in Figure 4 and compacted accordingly.

3.0 METHODOLOGY

Earthworks Inspections and Testing was carried out on the stripped and exposed ground surfaces and during the placement and compaction of fill materials forming residential allotments and road subgrades.

Field and laboratory testing included walk over assessments of the existing ground conditions, proof roll testing of the stripped surface including the natural surface, observations of filling and compaction activities, field density testing using a soil moisture density gauge and Hilf Density compactions.

3.1 Stripped Surface Assessment

The fill areas covered by this report were stripped and cleared of visible loose materials, vegetation, and topsoil.

Materials exposed after stripping and that formed the fill foundation can be broadly summarised as:

- Natural - Silty Sand (SM) – at least dense, fine to medium grained sands, traces of low plasticity fines, grey – brown and moist.
- Natural – Sandy Clay (CI) – at least very stiff, medium plasticity, fine to medium grained sand, pale brown mottled orange and moist.
- Bedrock – Sandstone (XW-HW) – Extremely to Highly weathered, very low to low strength, orange – yellow brown
- Bedrock – Sandstone (MW-SW) – Moderately to Slightly weathered, medium, high, and very high strength, yellow grey, and pale grey

Following the stripped surface assessment of the fill areas, the foundation was approved for filling using the following process:

- Walk over assessments confirming that a competent natural foundation had been exposed.
- Proof roll testing using a large sized truck carrying out multiple passes confirming no movement of the exposed natural foundation.

A photo showing the showing a typical stripped surface is given in Picture 1.

Picture 1: View of The Site During Stripping Operations



3.2 Filling Operations

Fill materials were sourced onsite and can be broadly summarised as:

- Onsite Gravelly Sandy Clay (CI), medium plasticity fines, fine to coarse sand, fine to coarse gravel, yellow - brown and moist.
- Ripped Sandstone with engineering properties of Gravelly Clayey Sand (SC), fine to coarse sand, fine to coarse gravel, low to medium plasticity fines with cobbles up to 200mm max.
- Blasted Sandstone with engineering properties of Gravelly Clayey Sand (SC), fine to coarse sand, fine to coarse gravel, low to medium plasticity fines with cobbles up to 200mm max.

Ripping operations were required to loosen high and very high strength sandstone. Ripped rock was then processed using mechanical crushing plant.

The methodology for the rock crushing operations can be broadly summarised as: -

- Large rock fragments were broken down by an excavator with a hammer attachment to sizes acceptable for the mechanical crushing plant.
- Mechanical crushing to reduce rock fragments to 200mm size or less.
- Mixing crushed product with onsite materials using a front-end loader and placed into stockpiles assessed to be suitable for filling and earthworks operations.

Placement and compaction of the fill materials was carried out using the following plant:

- | | | |
|-------------------|--------------------|-----------------------------|
| • Water Carts | • Excavators | • Cat 825 Compactor |
| • Pad Foot Roller | • Grader | • Articulated Dump Truck's |
| • Dozers | • Front End Loader | • Mechanical Rock Crusher's |

The fill materials were moisture conditioned at the fill source and during placement to moisture contents suitable for compaction. Deleterious materials such as organics, sticks, roots and over size particles were sorted and removed during placement or were rejected for use. Occasional oversize particles including cobbles may be present in the deeper fill profile, however, are not considered to affect the fill as a mass.

Placement of the fill materials was carried out in layers appropriate for the above plant and compacted using the above plant carrying out multiple passes.

Our representative observed the filling process as described above which was assessed to be consistent for the entire thickness of fill.

Field density tests and laboratory compactions were carried out on the fill materials in accordance with Table 5.1 and 8.1 of AS3798 2007 (Guidelines on Earthworks for Commercial and Residential Developments) and tested to AS1289 test methods (Testing of Soils for Engineering Purposes).

Testing achieved the required specification of 95% of the maximum Hilf Density at the test locations.

Fill placed and compacted at measured density ratios less than 95% was tyned, moisture conditioned and re-compacted until the required specification was achieved. Retesting was carried out using the Random Stratified Location method.

The Location of the field density tests are shown on the Site Plan contained in Appendix A. These test locations and levels were not obtained by survey and therefore should only be considered as approximate.

Photos showing the typical fill construction activities are given in Pictures 2 to 4.

Picture 2: View of the Crushing Operation and Produced Product



Picture 3: View of the Site During Construction



Picture 4: View of the Site During Construction



4.0 STATEMENT OF COMPLIANCE

Our representatives observed the relevant earthworks operations including the stripped surface, fill placement and compaction operations and carried out field density tests and laboratory compaction tests in accordance with the required standards (AS3798, AS1289). Testing achieved the required specification of 95% Standard Maximum Dry Density (SMDD) at the test locations.

Level One Inspection and Testing has been carried out on the filling operation at the Site (limited to the extent shown in Figure 1). Based on the observations made by our Geo-technicians and the results of the field and laboratory tests, the placed and compacted fill at the above project has, as far as we have been able to assess, been constructed in general accordance with the intent of AS3798.

The fill can be deemed to be “controlled” in accordance with AS2870-2011 Residential Slabs and Footings.

5.0 EXCLUSIONS

This statement does not include any topsoil, which may be placed for use as dressing, trench backfill, areas outside the locations shown in Figure 1 or any other subsequent earthworks after 29th May 2023.

Assessments of material quality such as soaked CBR and site classifications are excluded from this commission.

Our on-site attendance specifically excludes assessments of fill material quality and engineering properties that are outside the requirements of AS3798 – 2007.

Footings and ground slabs for any structures constructed over natural soils or controlled fill should be designed to accommodate the characteristic ground surface movements and settlement potential. Assessments of these design parameters are beyond the scope of this Report.

6.0 LIMITATIONS

This Report has been prepared by Morrison Geotechnic (**Morrison Geotechnic**) and may include contributions from Morrison Geotechnic's officers and employees, sub-contractors, sub-consultants or agents (**Contributors**).

This Report is for the sole benefit and use of Shadforth Civil Pty Ltd (**Client**), its designers, clients, and relevant statutory authorities for the sole purpose of providing geotechnical advice and recommendations in respect of the Bulk Earthworks Filling Operations at Precinct 9.6, Everleigh Estate (**Project**). The Report is only intended to address those issues expressly described in the Brief/ Work Instructions in this Report.

This Report should not be used or relied upon for any other purpose without Morrison Geotechnic's prior written consent. Morrison Geotechnic and the Contributors do not accept any responsibility or liability in any way whatsoever for the use or reliance of this Report by anyone other than Golding Urban Pty Ltd (**Client**), its designers, its clients and relevant statutory authorities or by anyone else for any purpose other than that for which it has been prepared.

Except with Morrison Geotechnic's prior written consent, this Report may not be:

- (a) released to any other party, whether in whole or in part (other than to the Client's officers, employees, advisers, designers, clients and relevant statutory authorities);
- (b) used or relied upon by any other party.

Morrison Geotechnic and the Contributors do not accept any liability or responsibility whatsoever for, or in respect of, any use or reliance upon this Report by any other party. Morrison Geotechnic is not obliged to enter into discussions with any third party in respect of this Report.

The information (including technical information and information obtained through discussions) on which this report is based has been provided by the Client and third parties. Morrison Geotechnic and the Contributors:

- (a) have relied upon and presumed the accuracy of this information.
- (b) have not verified the accuracy or reliability of this information (other than as expressly stated in this Report).
- (c) have not made any independent investigations or enquiries in respect of those matters of which it has no actual knowledge at the time of giving this Report to the Client; and
- (d) make no warranty or guarantee, expressed or implied, as to the accuracy or reliability of this information.

Morrison Geotechnic and the Contributors do not accept responsibility or liability for any incorrect assumptions related to this Report. For the avoidance of doubt, this Report:

- (a) is not an environmental, contamination or hazardous materials assessment; may be invalid, incomplete or inaccurate (including errors in the scope of work, investigation methodology, observations, opinions and advice) where the information provided to Morrison Geotechnic was invalid, incomplete or inaccurate.
- (b) is limited to observations of those parts of the site described in Section 1.0.

No warranty or guarantee, whether express or implied, is made in respect of the geotechnical data, information, advice, opinions and recommendations present in this Report.

If further information becomes available, or additional assumptions need to be made, Morrison Geotechnic reserves its right to amend this Report.

If you have any queries regarding the above, please contact our office.

Yours faithfully



GARY TAYLOR
For and on behalf of
MORRISON GEOTECHNIC



SIMON WYNNE (RPEQ 17390)
For and on behalf of
MORRISON GEOTECHNIC

ATTACHMENTS:

Appendix A – Site Plans Showing Test Locations
Appendix B – Laboratory Test Results Reports




Appendix A

Site Plan & Test Locations

MORRISON GEOTECHNIC



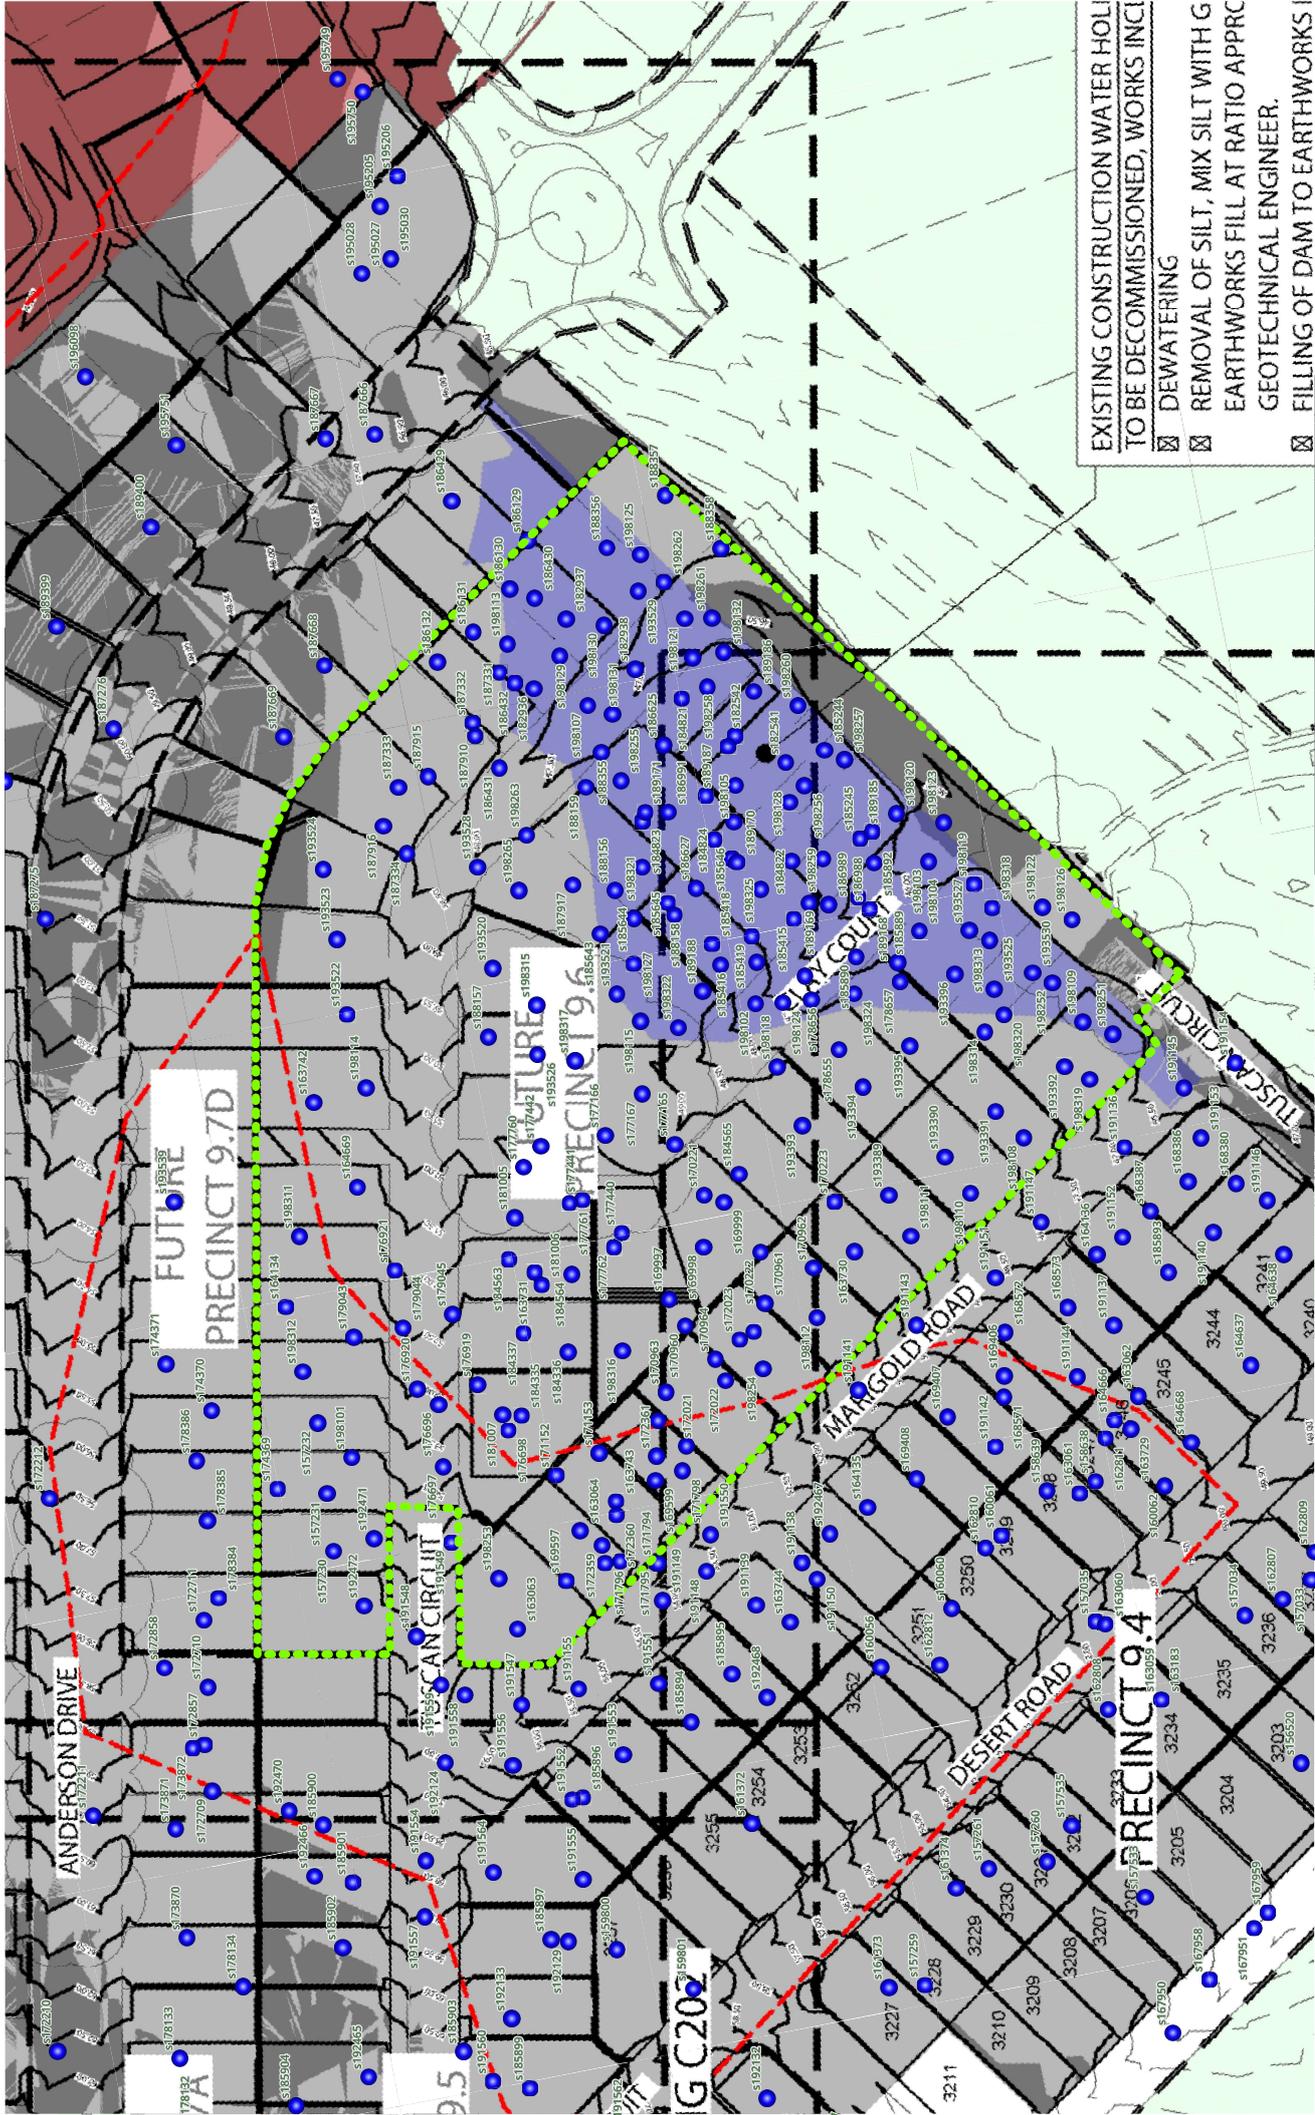

EVERLEIGH PRECINCT 9.6 - LEVEL 1 TESTS



Appendix B

Laboratory Test Reports

MORRISON GEOTECHNIC



MORRISON
GEOTECHNIC

Dry Density / Moisture Ratio Report

Client :	Shadforth	Report Number :	SR/PTP/10047 - 14/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	23/09/2022
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.1.1,					
----------------	---	--	--	--	--	--

Sample Number :	S/157230	S/157231	S/157232	S/157259	S/157260	S/157261
Date Tested :	13/09/2022	13/09/2022	13/09/2022	13/09/2022	13/09/2022	13/09/2022
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	Allotment Fill					
Test / Layer Depths :	275 / 300	275 / 300	275 / 300	275 / 300	275 / 300	275 / 300

Sampling Method :	AS1289.1.2.1 - cl6.4b					
Time :	10:51	10:58	11:06	11:31	11:39	11:45
Lot Number :	3330	3329	3328	3228	3229	3230
Location 1 :	E: 499236	E: 499249	E: 499265	E: 499115	E: 499137	E: 499138
Location 2 :	N: 6932064	N: 6932063	N: 6932062	N: 6931953	N: 6931921	N: 6931934
Location 3 :	RL: 54.9	RL: 54.7	RL: 54.2	RL: 55.6	RL: 55.3	RL: 54.9
Location 4 :	-	-	-	-	-	-

Test Fraction (mm) :	< 19mm					
Oversize Wet :	7%	3%	3%	3%	7%	4%
Oversize Dry :	8%	3%	4%	3%	8%	5%
Oversize Density - Dry (t/m ³) :	2.47	2.53	2.51	2.48	2.53	2.55
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/157230	S/157231	S/157232	S/157259	S/157260	S/157261
MDR Test Date :	16/09/2022	15/09/2022	14/09/2022	14/09/2022	16/09/2022	14/09/2022
Soil Description :	Gravelly Sandy Clay					

MDR Test Results						
MDD (t/m ³) :	1.86	1.93	1.98	1.89	1.92	1.85
OMC :	15.0%	16.0%	12.0%	13.5%	16.5%	17.5%
ADJ MDD (t/m ³) :	1.90	1.94	2.00	1.91	1.96	1.87
ADJ OMC :	13.5%	15.5%	11.5%	13.0%	15.5%	17.0%

Moisture Test Results :						
Field Moisture Content :	13.0%	15.5%	12.5%	12.0%	13.5%	15.0%
Moisture Specification :	+/-2.0% of OMC					
Variation from OMC :	1.0% Dry of OMC	0.0% Dry of OMC	1.0% Wet of OMC	1.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	93.5%	99.5%	110.5%	92.5%	88.0%	88.0%

Density Test Results						
Field Dry Density (t/m ³) :	1.91	1.86	1.90	1.90	1.88	1.84
Density Specification :	95%	95%	95%	95%	95%	95%
Dry Density Ratio :	101.0%	96.0%	95.0%	99.5%	96.0%	98.0%

	-	-	-	-	-	-
--	---	---	---	---	---	---

Soil Particle Density (APD) t/m ³ :	
Soil Particle Density (APD) Date :	

Remarks :	
-----------	--

 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  Samuel Bamford - Signatory
---	--

Dry Density / Moisture Ratio Report

Client :	Shadforth			Report Number :	SR/PTP/10047 - 27/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	6/12/2022	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.1.1,					
Sample Number :	S/163059	S/163060	S/163061	S/163062	S/163063	S/163064
Date Tested :	11/10/2022	11/10/2022	11/10/2022	11/10/2022	11/10/2022	11/10/2022
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / -	150 / -	150 / -	150 / -	150 / -	150 / -
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	11:27	11:30	11:37	11:46	11:50	11:58
Lot Number :	3234	3236	3248	3246	Layer 1	Layer 2
Location 1 :	E: 499168	E: 499187	E: 499217	E: 499236	E: 499211	E: 499230
Location 2 :	N: 6931889	N: 6931898	N: 6931898	N: 6931881	N: 6932027	N: 6932009
Location 3 :	FFL	FFL	0.6m BFL	0.6m BFL	Layer 1	Layer 2
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Dry :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/163059	S/163060	S/163061	S/163062	S/163063	S/163064
MDR Test Date :	12/10/2022	12/10/2022	13/10/2022	14/10/2022	13/10/2022	12/10/2022
Soil Description :	Sandy Clayey Gravel	Sandy Clayey Gravel	Sandy Clayey Gravel	Sandy Clayey Gravel	Sandy Clayey Gravel	Sandy Clayey Gravel
MDR Test Results						
MDD (t/m ³) :	1.98	2.04	1.99	1.97	1.97	1.97
OMC :	13.0%	11.0%	10.0%	12.0%	10.5%	11.5%
ADJ MDD (t/m ³) :	-	-	-	-	-	-
ADJ OMC :	-	-	-	-	-	-
Moisture Test Results :						
Field Moisture Content :	11.0%	10.0%	10.0%	12.0%	9.0%	10.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	1.0% Dry of OMC	0.0% Dry of OMC	0.0% Wet of OMC	1.5% Dry of OMC	1.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	83.0%	92.0%	98.0%	101.5%	86.5%	90.5%
Density Test Results						
Field Dry Density (t/m ³) :	1.94	1.97	1.95	1.90	1.96	1.95
Density Specification :	95%	95%	95%	95%	95%	95%
Dry Density Ratio :	97.5%	97.0%	97.5%	96.5%	99.5%	99.0%
-						
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the items that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Samuel Bamford - Signatory					

Dry Density / Moisture Ratio Report

Client :	Shadforth			Report Number :	SR/PTP/10047 - 33/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	6/12/2022	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.1.1,					
Sample Number :	S/163729	S/163730	S/163731			
Date Tested :	12/10/2022	12/10/2022	12/10/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 300	150 / 300	150 / 300			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:45	14:50	14:55			
Lot Number :	3246	3246	3246			
Location 1 :	E: 499229	E: 499280	E: 499289			
Location 2 :	N: 6931884	N: 6931937	N: 6932008			
Location 3 :	-	-	-			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Overflow Wet :	0%	0%	0%			
Overflow Dry :	0%	0%	0%			
Overflow Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/163729	S/163730	S/163731			
MDR Test Date :	14/10/2022	14/10/2022	13/10/2022			
Soil Description :	Gravelly Sandy Clay	Gravelly Sandy Clay	Gravelly Sandy Clay			
MDR Test Results						
MDD (t/m ³) :	1.98	1.96	1.94			
OMC :	13.5%	11.0%	10.5%			
ADJ MDD (t/m ³) :	-	-	-			
ADJ OMC :	-	-	-			
Moisture Test Results :						
Field Moisture Content :	13.0%	9.5%	10.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	0.0% Dry of OMC	1.5% Dry of OMC	0.0% Wet of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	98.5%	87.5%	102.0%			
Density Test Results						
Field Dry Density (t/m ³) :	1.97	1.99	1.99			
Density Specification :	95%	95%	95%			
Dry Density Ratio :	99.5%	102.0%	103.0%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Samuel Bamford - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 37/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	25/01/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-
Project Number :	PTP/10047			Page 1 of 1	
Location :	Greenbank				
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,				
Sample Number :	S/163742	S/163743	S/163744		
Date Tested :	13/10/2022	13/10/2022	13/10/2022		
Material Source :	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / 300	150 / 300	150 / 300		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	12:08	12:16	12:28		
Lot Number :	-	-	-		
Location 1 :	General Fill	General Fill	General Fill		
Location 2 :	E: 499336	E: 499235	E: 499201		
Location 3 :	N: 6932049	N: 6932000	N:6931967		
Location 4 :	2m BFL	2.2m BFL	1.7m BFL		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm		
Oversize Wet :	7%	9%	15%		
Oversize Density - Dry (t/m ³) :	2.19	2.20	2.05		
Assigned MDR (Yes/No) :	No	No	No		
MDR Sample Number :	S/163742	S/163743	S/163744		
MDR Test Date :	27/10/2022	26/10/2022	27/10/2022		
Compaction Type :	Standard	Standard	Standard		
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown		
<i>MDR Test Results</i>					
PCWD (t/m ³) :	2.23	2.21	2.17		
Moisture Variation :	0.5%	0.5%	0.5%		
ADJ PCWD (t/m ³) :	2.22	2.21	2.16		
ADJ Moisture Variation :	0.5%	0.5%	0.5%		
<i>Moisture Test Results :</i>					
Field Moisture Content :	9.5%	9.5%	9.0%		
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC		
Variation from OMC :	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-		
Moisture Ratio :	N/A	N/A	N/A		
<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.14	2.18	2.17		
Density Specification :	95%	95%	95%		
Wet Density Ratio :	96.5%	98.5%	100.5%		
Soil Particle Density (APD) t/m ³ :					
Soil Particle Density (APD) Date :					
Remarks :					
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 41/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	25/01/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/164134	S/164135	S/164136			
Date Tested :	14/10/2022	14/10/2022	14/10/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:49	11:23	13:14			
Lot Number :	-	-	-			
Location 1 :	E: 499292	E: 499223	E: 499269			
Location 2 :	N: 6932064	N: 6931945	N: 6931884			
Location 3 :	2m BFL	FL	FL			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	1%	0%	5%			
Oversize Density - Dry (t/m ³) :	1.15	-	1.15			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/164134	S/164135	S/164136			
MDR Test Date :	31/10/2022	1/11/2022	4/11/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravely Sandy Clay - Brown	Gravely Sandy Clay - Brown	Gravely Sandy Clay - Brown			
MDR Test Results						
PCWD (t/m ³) :	2.11	2.09	2.10			
Moisture Variation :	1.5%	2.0%	0.5%			
ADJ PCWD (t/m ³) :	2.01	-	2.09			
ADJ Moisture Variation :	1.5%	-	0.5%			
Moisture Test Results :						
Field Moisture Content :	10.0%	12.0%	15.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	0.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.12	2.10	2.14			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	105.5%	100.5%	102.0%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :	Note - density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer					
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p>			<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 30/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	10/11/2022	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/164666	S/164668	S/164669			
Date Tested :	18/10/2022	18/10/2022	18/10/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:36	10:44	10:55			
Lot Number :	-	-	-			
Location 1 :	E: 499231.7	E: 499223.5	E: 499238.8			
Location 2 :	N: 6931887.3	N: 6931871.3	N: 6931861.9			
Location 3 :	0.3m BFL	0.3m BFL	0.3m BFL			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	14%	6%	0%			
Oversize Density - Dry (t/m ³) :	2.33	2.20	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/164666	S/164668	S/164669			
MDR Test Date :	9/11/2022	9/11/2022	7/11/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Clay with Gravel - Brown	Sandy Clay with Gravel - Brown	Sandy Clay with Gravel - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.10	2.05	2.17			
Moisture Variation :	2.0%	1.5%	2.0%			
ADJ PCWD (t/m ³) :	2.13	2.06	-			
ADJ Moisture Variation :	1.5%	1.5%	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	4.5%	5.0%	7.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.09	2.17	2.15			
Density Specification :	98%	98%	98%			
Wet Density Ratio :	98.5%	105.0%	99.0%			
Characteristic Value (Q020) :	CV(min) = 97.8%	CV(max) = 103.8%	Mean = 100.8%	Std. Dev. = 3.6%	n = 3	k = 0.828
	-	-	-			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				APPROVED SIGNATORY  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 45/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/169597	S/169598	S/169599			
Date Tested :	11/11/2022	11/11/2022	11/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	09:00	09:11	09:33			
Lot Number :	3015	3289	3288			
Location 1 :	E: 499219.53	E: 499221.56	E: 499237.91			
Location 2 :	N: 6932014.30	N: 6932001.67	N: 6931990.42			
Location 3 :	RL: 54.08	RL: 53.41	RL: 52.56			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 37.5mm	< 19mm			
Oversize Wet :	20%	18%	13%			
Oversize Density - Dry (t/m ³) :	1.80	1.68	1.84			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/169597	S/169598	S/169599			
MDR Test Date :	29/11/2022	30/11/2022	29/11/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Clay Sandy - Brown	Sandy Clayey Gravel - Brown	Sandy Gravelly Clay - Brown			
MDR Test Results						
PCWD (t/m ³) :	2.11	2.18	2.19			
Moisture Variation :	2.5%	1.5%	2.5%			
ADJ PCWD (t/m ³) :	2.04	2.07	2.14			
ADJ Moisture Variation :	2.0%	1.0%	2.0%			
Moisture Test Results						
Field Moisture Content :	6.0%	6.5%	7.0%			
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC			
Variation from OMC :	2.0% Dry of OMC	1.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.01	1.98	2.19			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	98.5%	96.0%	102.0%			
	-	-	-			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 48/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/169997	S/169998	S/169999			
Date Tested :	14/11/2022	14/11/2022	14/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:15	14:19	14:26			
Lot Number :	3296	3297	3298			
Location 1 :	E: 499277.41	E: 499287.39	E: 499296.52			
Location 2 :	N: 6931979.60	N: 6931969.80	N: 6931963.42			
Location 3 :	RL: 51.40	RL: 50.15	RL: 49.65			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	8%	9%	9%			
Oversize Density - Dry (t/m ³) :	2.25	2.26	2.28			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/169997	S/169998	S/169999			
MDR Test Date :	30/11/2022	2/12/2022	2/12/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravelly Sandy Clay - Yellow/Brown	Gravelly Sandy Clay - Yellow/Brown	Gravelly Sandy Clay - Yellow/Brown			
MDR Test Results						
PCWD (t/m ³) :	2.04	2.08	1.99			
Moisture Variation :	2.0%	1.0%	2.5%			
ADJ PCWD (t/m ³) :	2.05	2.10	2.01			
ADJ Moisture Variation :	2.0%	1.0%	2.0%			
Moisture Test Results :						
Field Moisture Content :	6.0%	6.0%	6.0%			
Moisture Specification :	-	-	-			
Variation from OMC :	2.0% Dry of OMC	1.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.03	2.17	2.03			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.0%	103.5%	101.0%			
	-	-	-			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p style="font-size: small;">Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 49/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/170221	S/170222	S/170223			
Date Tested :	15/11/2022	15/11/2022	15/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	13:30	13:35	13:44			
Lot Number :	3285	3284	3283			
Location 1 :	E: 499298.93	E: 494299.26	E: 499291.90			
Location 2 :	N: 6931967.40	N: 6931951.25	N: 6931939.14			
Location 3 :	RL: 49.65	RL: 49.64	RL: 49.85			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	11%	12%	15%			
Oversize Density - Dry (t/m ³) :	2.26	2.29	2.20			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/170221	S/170222	S/170223			
MDR Test Date :	13/12/2022	13/12/2022	12/12/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Clay - Brown	Sandy Gravelly Clay - Brown	Sandy Clay - Brown and Yellow			
MDR Test Results						
PCWD (t/m ³) :	2.07	2.16	2.07			
Moisture Variation :	2.5%	2.5%	2.5%			
ADJ PCWD (t/m ³) :	2.09	2.18	2.09			
ADJ Moisture Variation :	2.0%	2.0%	2.0%			
Moisture Test Results :						
Field Moisture Content :	5.5%	6.5%	6.0%			
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.05	2.10	2.13			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	98.0%	96.5%	102.0%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 50/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/170960	S/170961	S/170962			
Date Tested :	16/11/2022	16/11/2022	16/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	13:31	13:35	13:42			
Lot Number :	3286	3285	3284			
Location 1 :	E: 499270.83	E: 499272.41	E: 499278.11			
Location 2 :	N: 6931977.2	N: 6931958.81	N: 6931946.70			
Location 3 :	RL: 52.60	RL: 51.65	RL: 50.65			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	3%	0%	5%			
Oversize Density - Dry (t/m ³) :	2.35	-	2.36			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/170960	S/170961	S/170962			
MDR Test Date :	13/12/2022	13/12/2022	13/12/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Gravel - Brown	Gravelly Sandy Clay - Brown	Sandy Gravel - Brown			
MDR Test Results						
PCWD (t/m ³) :	2.01	2.09	1.93			
Moisture Variation :	1.5%	1.0%	2.5%			
ADJ PCWD (t/m ³) :	2.02	-	1.95			
ADJ Moisture Variation :	1.5%	-	2.0%			
Moisture Test Results :						
Field Moisture Content :	8.0%	8.5%	8.0%			
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC			
Variation from OMC :	1.5% Dry of OMC	1.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.02	1.99	2.01			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	100.0%	95.0%	103.0%			
	-	-	-			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 51/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/170963	S/170964	S/170965			
Date Tested :	17/11/2022	17/11/2022	17/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:00	14:04	14:15			
Lot Number :	3287	3286	3285			
Location 1 :	E: 499257.0	E: 499262.1	E: 499266.55			
Location 2 :	N: 6931984.34	N: 6931972.1	N: 6931962.54			
Location 3 :	RL: 53.41	RL: 52.59	RL: 51.80			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 37.5mm	< 19mm			
Oversize Wet :	13%	16%	6%			
Oversize Density - Dry (t/m ³) :	2.26	2.28	2.18			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/170963	S/170964	S/170965			
MDR Test Date :	16/12/2022	19/12/2022	13/12/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Gravel - Brown	Clayey Sand - Grey	Sandy Clay - Yellow/Light Brown			
MDR Test Results						
PCWD (t/m ³) :	2.02	1.97	2.03			
Moisture Variation :	2.0%	3.0%	2.0%			
ADJ PCWD (t/m ³) :	2.05	2.01	2.04			
ADJ Moisture Variation :	2.0%	2.5%	2.0%			
Moisture Test Results :						
Field Moisture Content :	6.0%	5.0%	6.5%			
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.5% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.02	2.06	2.07			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	98.5%	102.0%	101.5%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 52/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/171152	S/171153	S/171154			
Date Tested :	18/11/2022	18/11/2022	18/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:02	14:10	14:17			
Lot Number :	3286	3285	3284			
Location 1 :	E: 499243.27	E: 499246.34	E: 499251.12			
Location 2 :	N: 6932011.94	N: 6932001.55	N: 6931987.32			
Location 3 :	RL: 51.84	RL: 50.95	RL: 50.13			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	5%	7%	5%			
Oversize Density - Dry (t/m ³) :	2.31	2.23	2.21			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/171152	S/171153	S/171154			
MDR Test Date :	20/12/2022	20/12/2022	20/12/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown			
MDR Test Results						
PCWD (t/m ³) :	2.04	2.01	2.15			
Moisture Variation :	2.0%	2.0%	-1.0%			
ADJ PCWD (t/m ³) :	2.05	2.03	2.15			
ADJ Moisture Variation :	2.0%	2.0%	-1.0%			
Moisture Test Results						
Field Moisture Content :	8.5%	7.5%	11.5%			
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	1.0% Wet of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.10	2.12	2.14			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	102.0%	104.5%	99.5%			
-						
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p style="font-size: small;">Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 54/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/171796	S/171797	S/171798			
Date Tested :	22/11/2022	22/11/2022	22/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:17	14:28	14:41			
Lot Number :	3289	3288	3287			
Location 1 :	E: 499221.85	E: 499219.50	E: 499238.83			
Location 2 :	N: 6932004.94	N: 6931993.48	N: 6931984.11			
Location 3 :	RL: 54.35	RL: 53.41	RL: 52.97			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	12%	10%	13%			
Oversize Density - Dry (t/m ³) :	2.32	2.42	2.70			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/171796	S/171797	S/171798			
MDR Test Date :	22/12/2022	22/12/2022	22/12/2022			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravelly Sandy Clay - Brown	Gravelly Sandy Clay - Brown	Silty Sandy Clay - Brown			
MDR Test Results						
PCWD (t/m ³) :	2.06	2.07	2.14			
Moisture Variation :	2.5%	2.0%	1.0%			
ADJ PCWD (t/m ³) :	2.09	2.10	2.20			
ADJ Moisture Variation :	2.0%	1.5%	1.0%			
Moisture Test Results :						
Field Moisture Content :	5.0%	4.5%	8.0%			
Moisture Specification :	-	-	-			
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC	1.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.04	2.05	2.09			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	97.5%	97.5%	95.0%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 55/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-
Project Number :	PTP/10047			Page 1 of 1	
Location :	Greenbank				
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,				
Sample Number :	S/172021	S/172022	S/172023		
Date Tested :	23/11/2022	23/11/2022	23/11/2022		
Material Source :	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / -	150 / -	150 / -		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	14:00	14:12	14:23		
Lot Number :	3287	3286	3285		
Location 1 :	E: 499244.26	E: 499257.02	E: 499265.48		
Location 2 :	N: 6931982.20	N: 6931970.75	N: 6931965.91		
Location 3 :	RL: 53.36	RL: 52.41	RL: 51.50		
Location 4 :	-	-	-		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm		
Oversize Wet :	17%	10%	8%		
Oversize Density - Dry (t/m ³) :	2.21	2.15	2.22		
Assigned MDR (Yes/No) :	No	No	No		
MDR Sample Number :	S/172021	S/172022	S/172023		
MDR Test Date :	3/01/2022	9/01/2023	3/01/2022		
Compaction Type :	Standard	Standard	Standard		
Soil Description :	Gravelly Sand - Brown	Gravelly Sandy Clay - Grey	Gravelly Sand - Brown		
<i>MDR Test Results</i>					
PCWD (t/m ³) :	2.12	2.06	2.10		
Moisture Variation :	2.0%	2.5%	2.0%		
ADJ PCWD (t/m ³) :	2.13	2.07	2.11		
ADJ Moisture Variation :	1.5%	2.0%	2.0%		
<i>Moisture Test Results :</i>					
Field Moisture Content :	8.0%	8.5%	8.0%		
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC		
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-		
Moisture Ratio :	N/A	N/A	N/A		
<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.18	2.18	2.15		
Density Specification :	95%	95%	95%		
Wet Density Ratio :	102.0%	105.0%	102.5%		
Soil Particle Density (APD) t/m ³ :					
Soil Particle Density (APD) Date :					
Remarks :					
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Nick Dobson - Signatory				

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 57/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	3/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/172359	S/172360	S/172361			
Date Tested :	25/11/2022	25/11/2022	25/11/2022			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	09:15	09:20	09:25			
Lot Number :	3015	3289	3288			
Location 1 :	E: 499225.85	E: 499231.90	E: 499243.26			
Location 2 :	N: 6932004.91	N: 6932000.42	N: 6931989.09			
Location 3 :	RL: 55.06	RL: 54.65	RL: 53.17			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	9%	4%	9%			
Oversize Density - Dry (t/m ³) :	2.29	2.35	2.26			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/172359	S/172360	S/172361			
MDR Test Date :	10/01/2023	10/01/2023	11/01/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravelly Sand - Light Brown	Sandy Gravel Grey	Sandy Gravel Bown			
MDR Test Results						
PCWD (t/m ³) :	1.97	2.17	1.95			
Moisture Variation :	2.5%	0.5%	2.0%			
ADJ PCWD (t/m ³) :	1.99	2.17	1.97			
ADJ Moisture Variation :	2.5%	0.5%	2.0%			
Moisture Test Results :						
Field Moisture Content :	4.5%	11.0%	5.0%			
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC			
Variation from OMC :	2.5% Dry of OMC	0.5% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.06	2.13	2.08			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	103.5%	98.0%	105.5%			
	-	-	-			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 69/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	21/02/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
----------------	---	--	--	--	--	--

Sample Number :	S/174369	S/174370	S/174371	S/174417	S/174418	
Date Tested :	9/12/2022	9/12/2022	9/12/2022	9/12/2022	9/12/2022	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill					
Test / Layer Depths :	150 / -	150 / -	150 / -	150 / -	150 / -	

Sampling Method :	AS1289.1.2.1 - cl6.4b					
Time :	10:31	10:38	10:42	11:57	12:04	
Lot Number :	3364	3365	3366	4001	4002	
Location 1 :	E: 499252.16	E: 499272.33	E: 499284.41	E: 498989.53	E: 498989.07	
Location 2 :	N: 6932073.64	N: 6932084.70	N: 6932092.69	N: 6932192.55	N: 6932207.49	
Location 3 :	RL: 66.01	RL: 65.73	RL: 64.76	RL: 69.48	RL: 69.48	
Location 4 :	-	-	-	-	-	

Test Fraction (mm) :	< 19mm					
Override Wet :	13%	12%	7%	12%	7%	
Override Density - Dry (t/m ³) :	2.15	2.21	2.29	2.25	2.32	
Assigned MDR (Yes/No) :	No	No	No	No	No	
MDR Sample Number :	S/174369	S/174370	S/174371	S/174417	S/174418	
MDR Test Date :	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	
Compaction Type :	Standard	Standard	Standard	Standard	Standard	
Soil Description :	Clayey Sandy Gravel - Brown					

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.08	2.03	2.05	2.06	2.09	
Moisture Variation :	2.0%	1.0%	1.0%	2.0%	1.5%	
ADJ PCWD (t/m ³) :	2.09	2.05	2.07	2.08	2.11	
ADJ Moisture Variation :	2.0%	1.0%	1.0%	1.5%	1.5%	

<i>Moisture Test Results :</i>						
Field Moisture Content :	7.5%	8.0%	7.5%	6.0%	6.0%	
Moisture Specification :	+/-2.0% of OMC					
Variation from OMC :	2.0% Dry of OMC	1.0% Dry of OMC	1.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	
Relative Moisture Ratio (Q250) :	-	-	-	-	-	
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.06	2.02	2.10	2.06	2.12	
Density Specification :	98%	98%	98%	98%	98%	
Wet Density Ratio :	99.0%	98.5%	101.5%	99.0%	100.5%	

Soil Particle Density (APD) t/m ³ :	
Soil Particle Density (APD) Date :	
Remarks :	

 <p>WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
	<p>Base Laboratory Address - 8/36 Blanck Street, ORMEAUX, QLD 4208</p>	

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 72/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	21/02/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
----------------	---	--	--	--	--	--

Sample Number :	S/176696	S/176697	S/176698			
Date Tested :	10/01/2023	10/01/2023	10/01/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 200	150 / 200	150 / 200			

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:31	10:36	10:42			
Lot Number :	-	-	-			
Location 1 :	E: 499264.0	E: 499250.0	E: 499255.2			
Location 2 :	N: 6932034.7	N: 6932036.3	N: 6932020.5			
Location 3 :	RL: 49.16	RL: 49.24	RL: 49.19			
Location 4 :	-	-	-			

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	15%	6%	9%			
Oversize Density - Dry (t/m ³) :	2.34	2.40	2.53			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/176696	S/176697	S/176698			
MDR Test Date :	3/02/2023	3/02/2023	3/02/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravelly Clay - Brown	Gravelly Clay - Brown	Gravelly Clay - Brown			

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.11	1.94	2.15			
Moisture Variation :	2.0%	2.0%	1.5%			
ADJ PCWD (t/m ³) :	2.14	1.97	2.18			
ADJ Moisture Variation :	1.5%	2.0%	1.5%			

<i>Moisture Test Results :</i>						
Field Moisture Content :	6.5%	11.0%	7.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.13	2.04	2.15			
Density Specification :	98%	98%	98%			
Wet Density Ratio :	99.5%	103.5%	99.0%			

--	--	--	--	--	--	--

--	--	--	--	--	--	--

Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						

Remarks :						
-----------	--	--	--	--	--	--

 <p>WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
	Document Number : RF1	Date : 29/08/2022

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 64/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	13/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/176919	S/176920	S/176921			
Date Tested :	12/01/2023	12/01/2023	12/01/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:33	10:40	10:42			
Lot Number :	-	-	-			
Location 1 :	E: 499266.63	E: 499268.19	E: 499295.40			
Location 2 :	N: 6932025.22	N: 6932038.76	N: 6932038.55			
Location 3 :	RL: 49.38	RL: 49.66	RL: 49.14			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	19%	19%	20%			
Oversize Density - Dry (t/m ³) :	2.16	2.23	2.18			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/176919	S/176920	S/176921			
MDR Test Date :	6/02/2023	6/02/2023	6/02/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy CLAY - Bown	Gravelly SAND - Brown	Gravelly SAND - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.10	2.16	2.15			
Moisture Variation :	2.5%	2.5%	2.5%			
ADJ PCWD (t/m ³) :	2.11	2.17	2.15			
ADJ Moisture Variation :	2.0%	2.0%	2.0%			
<i>Moisture Test Results :</i>						
Field Moisture Content :	6.0%	6.0%	6.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.08	2.14	2.14			
Density Specification :	98%	98%	98%			
Wet Density Ratio :	98.5%	98.5%	99.5%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p style="font-size: small;">Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 73/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	21/02/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,		
----------------	---	--	--

Sample Number :	S/177165	S/177166	S/177167		
Date Tested :	13/01/2023	13/01/2023	13/01/2023		
Material Source :	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / -	150 / -	150 / -		

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	14:03	14:15	14:22		
Lot Number :	-	-	-		
Location 1 :	E: 499311.40	E: 499316.25	E: 49323.82		
Location 2 :	N: 6931971.77	N: 6931986.50	N: 6931976.74		
Location 3 :	RL: 48.11	RL: 48.23	RL: 48.14		
Location 4 :	-	-	-		

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm		
OverSize Wet :	10%	7%	5%		
OverSize Density - Dry (t/m ³) :	2.19	2.18	1.64		
Assigned MDR (Yes/No) :	No	No	No		
MDR Sample Number :	S/177165	S/177166	S/177167		
MDR Test Date :	7/02/2023	7/02/2023	7/02/2023		
Compaction Type :	Standard	Standard	Standard		
Soil Description :	Gravelly Sandy Clay - Brown	Gravelly Sandy Clay - Brown	Gravelly Sandy Clay - Brown		

<i>MDR Test Results</i>					
PCWD (t/m ³) :	2.15	2.12	2.12		
Moisture Variation :	2.0%	2.0%	1.5%		
ADJ PCWD (t/m ³) :	2.15	2.13	2.09		
ADJ Moisture Variation :	1.5%	2.0%	1.5%		

<i>Moisture Test Results :</i>					
Field Moisture Content :	8.5%	8.5%	9.0%		
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC		
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-		
Moisture Ratio :	N/A	N/A	N/A		

<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.15	2.21	2.12		
Density Specification :	98%	98%	98%		
Wet Density Ratio :	100.0%	103.5%	101.5%		

--	--	--	--	--	--

--	--	--	--	--	--

Soil Particle Density (APD) t/m ³ :					
Soil Particle Density (APD) Date :					

Remarks :					
-----------	--	--	--	--	--

 <p style="font-size: 8px;">WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
---	---	---

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 74/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	21/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/177440	S/177441	S/177442			
Date Tested :	17/01/2023	17/01/2023	17/01/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:30	10:40	10:46			
Lot Number :	-	-	-			
Location 1 :	E: 499294.03	E: 499302.95	E: 499316.56			
Location 2 :	N: 6931987.16	N: 6931994.43	N: 6932001.12			
Location 3 :	RL: 48.49	RL: 48.42	RL: 48.46			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	8%	4%			
Oversize Density - Dry (t/m ³) :	-	2.31	2.32			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/177440	S/177441	S/177442			
MDR Test Date :	7/02/2023	7/02/2023	7/02/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Clay - Brown	Sandy Clay - Brown	Sandy Clay - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.12	2.09	2.10			
Moisture Variation :	1.5%	1.5%	1.5%			
ADJ PCWD (t/m ³) :	-	2.11	2.10			
ADJ Moisture Variation :	-	1.5%	1.5%			
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.0%	7.5%	7.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.13	2.12	2.09			
Density Specification :	98%	98%	98%			
Wet Density Ratio :	100.0%	100.5%	99.0%			
-						
-						
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 75/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	21/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/177760	S/177761	S/177762			
Date Tested :	19/01/2023	19/01/2023	19/01/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:31	10:37	10:45			
Lot Number :	-	-	-			
Location 1 :	E: 499312.73	E: 499302.88	E: 499291.20			
Location 2 :	N: 6932005.81	N: 6931997.30	N: 6931989.50			
Location 3 :	RL: 48.84	RL: 46.80	RL: 48.79			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/177760	S/177761	S/177762			
MDR Test Date :	9/02/2023	9/02/2023	9/02/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Clay - Brown	Sandy Clay - Brown	Sandy Clay - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.15	2.13	2.15			
Moisture Variation :	1.5%	2.0%	1.5%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	8.0%	7.5%	8.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.17	2.14	2.17			
Density Specification :	98%	98%	98%			
Wet Density Ratio :	100.5%	100.5%	101.5%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				APPROVED SIGNATORY  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 78/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	21/02/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,		
----------------	---	--	--

Sample Number :	S/178655	S/178656	S/178657		
Date Tested :	25/01/2023	25/01/2023	25/01/2023		
Material Source :	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / -	150 / -	150 / -		

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	14:01	14:10	14:17		
Lot Number :	-	-	-		
Location 1 :	E: 499325.21	E: 499337.44	E: 499337.69		
Location 2 :	N: 6931931.75	N: 6931935.63	N: 6931915.38		
Location 3 :	RL: 46.55	RL: 46.58	RL: 46.55		
Location 4 :	-	-	-		

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm		
OverSize Wet :	11%	16%	11%		
OverSize Density - Dry (t/m ³) :	2.10	2.26	2.24		
Assigned MDR (Yes/No) :	No	No	No		
MDR Sample Number :	S/178655	S/178656	S/178657		
MDR Test Date :	14/02/2023	14/02/2023	14/02/2023		
Compaction Type :	Standard	Standard	Standard		
Soil Description :	Gravelly Sand - Brown	Gravelly Sand - Brown	Gravelly Sand - Brown		

<i>MDR Test Results</i>					
PCWD (t/m ³) :	2.08	2.06	2.10		
Moisture Variation :	2.0%	2.5%	1.5%		
ADJ PCWD (t/m ³) :	2.08	2.09	2.11		
ADJ Moisture Variation :	2.0%	2.0%	1.5%		

<i>Moisture Test Results :</i>					
Field Moisture Content :	10.5%	10.5%	9.5%		
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC		
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-		
Moisture Ratio :	N/A	N/A	N/A		

<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.07	2.11	2.17		
Density Specification :	95%	95%	95%		
Wet Density Ratio :	99.5%	101.0%	103.0%		

--	--	--	--	--	--

--	--	--	--	--	--

Soil Particle Density (APD) t/m ³ :					
Soil Particle Density (APD) Date :					

Remarks :					
-----------	--	--	--	--	--

 <small>WORLD RECOGNISED ACCREDITATION</small>	<small>Note: The results contained in this report relate only to the item/s that were tested/sampled</small> Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208	APPROVED SIGNATORY  Nick Dobson - Signatory
--	---	---

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 65/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	16/02/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/179043	S/179044	S/179045			
Date Tested :	30/01/2023	30/01/2023	30/01/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / -	150 / -	150 / -			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:06	14:13	14:21			
Lot Number :	-	-	-			
Location 1 :	E: 499282.43	E: 499282.34	E: 499283.30			
Location 2 :	N: 6932050.32	N: 6932039.17	N: 6932027.68			
Location 3 :	RL: 51.63	RL: 51.61	RL: 51.60			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	11%	16%	14%			
Oversize Density - Dry (t/m ³) :	2.40	2.53	2.04			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/179043	S/179044	S/179045			
MDR Test Date :	7/02/2023	7/02/2023	7/02/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Gravel	Sandy Gravel	Sandy Gravel			
MDR Test Results						
PCWD (t/m ³) :	2.13	2.11	2.10			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	2.16	2.17	2.10			
ADJ Moisture Variation :	2.0%	2.0%	2.0%			
Moisture Test Results						
Field Moisture Content :	6.0%	6.0%	6.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.11	2.06	2.11			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	97.5%	95.0%	100.5%			
	-	-	-			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Darra) Accreditation Number - 2851 Base Laboratory Site Number - 2844 - Darra Base Laboratory Address - 1/35 Limestone Street, Darra, QLD 4076</p>				APPROVED SIGNATORY  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 83/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	15/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/181005	S/181006	S/181007			
Date Tested :	10/02/2023	10/02/2023	10/02/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:10	14:15	14:20			
Lot Number :	-	-	-			
Location 1 :	E: 499302	E: 499286	E: 499259			
Location 2 :	N: 6932010	N: 6932007	N: 6932021			
Location 3 :	RL: 51.52	RL: 51.61	RL: 51.94			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/181005	S/181006	S/181007			
MDR Test Date :	24/02/2023	24/02/2023	24/02/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Clay - Brown	Sandy Clay - Brown	Sandy Clay - Brown			
MDR Test Results						
PCWD (t/m ³) :	2.07	2.11	2.08			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
Moisture Test Results :						
Field Moisture Content :	8.0%	7.0%	8.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
Density Test Results						
Field Wet Density (t/m ³) :	2.05	2.08	2.10			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.0%	98.0%	100.5%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 86/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	20/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/182541	S/182542	S/182543			
Date Tested :	21/02/2023	21/02/2023	21/02/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:32	10:36	10:45			
Lot Number :	-	-	-			
Location 1 :	E: 499391	E: 499399	E: 499418			
Location 2 :	N: 6931931	N: 6931941	N: 6931947			
Location 3 :	RL: 44.88	RL: 44.53	RL: 44.17			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Override Wet :	1%	9%	10%			
Override Density - Dry (t/m ³) :	2.33	2.29	2.13			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/182541	S/182542	S/182543			
MDR Test Date :	2/03/2023	2/03/2023	2/03/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Clay - Brown	Sandy Clay - Brown	Sandy Clay - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.13	2.02	2.12			
Moisture Variation :	2.0%	1.5%	2.0%			
ADJ PCWD (t/m ³) :	2.13	2.05	2.13			
ADJ Moisture Variation :	2.0%	1.5%	2.0%			
<i>Moisture Test Results :</i>						
Field Moisture Content :	8.0%	7.0%	7.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.12	2.08	2.10			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.5%	101.5%	99.0%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 82/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	8/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/182936	S/182937	S/182938			
Date Tested :	22/02/2023	22/02/2023	22/02/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:33	10:40	10:51			
Lot Number :	-	-	-			
Location 1 :	E: 499418	E: 499432	E: 499418			
Location 2 :	N: 6931983	N: 6931973	N: 6931960			
Location 3 :	RL: 46.52	RL: 46.13	RL: 45.72			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Override Wet :	9%	11%	14%			
Override Density - Dry (t/m ³) :	2.38	2.32	2.28			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/182936	S/182937	S/182938			
MDR Test Date :	6/03/2023	6/03/2023	6/03/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Clay - Brown	Clay - Brown	Clay - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.13	2.16	2.08			
Moisture Variation :	-0.5%	0.0%	0.5%			
ADJ PCWD (t/m ³) :	2.15	2.18	2.10			
ADJ Moisture Variation :	-0.5%	-	0.5%			
<i>Moisture Test Results :</i>						
Field Moisture Content :	11.0%	11.5%	10.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	0.5% Wet of OMC	At OMC	0.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.04	2.17	2.00			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	95.0%	99.5%	95.5%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 84/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	16/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/184335	S/184336	S/184337			
Date Tested :	28/02/2023	28/02/2023	28/02/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:26	10:34	10:39			
Lot Number :	-	-	-			
Location 1 :	E: 499258	E: 499270	E: 499276			
Location 2 :	N: 6932017	N: 6932004	N: 6932013			
Location 3 :	RL: 52.84	RL: 52.40	RL: 52.30			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Override Wet :	14%	19%	16%			
Override Density - Dry (t/m ³) :	2.23	2.29	2.28			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/184335	S/184336	S/184337			
MDR Test Date :	9/03/2023	9/03/2023	9/03/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravelly Sand - Brown	Gravelly Sand - Brown	Gravelly Sand - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.11	2.02	2.03			
Moisture Variation :	2.5%	2.5%	2.5%			
ADJ PCWD (t/m ³) :	2.12	2.07	2.06			
ADJ Moisture Variation :	2.0%	2.0%	2.0%			
<i>Moisture Test Results :</i>						
Field Moisture Content :	5.5%	5.5%	5.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.02	2.03	2.07			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	95.0%	98.5%	100.5%			
-						
-						
-						
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208				APPROVED SIGNATORY  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 85/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	16/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/184563	S/184564	S/184565			
Date Tested :	2/03/2023	2/03/2023	2/03/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:31	10:38	10:42			
Lot Number :	-	-	-			
Location 1 :	E: 499293	E: 499287	E: 499302			
Location 2 :	N: 6932013	N: 6932000	N: 6931959			
Location 3 :	RL: 52.15	RL: 52.18	RL: 49.76			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Override Wet :	18%	20%	19%			
Override Density - Dry (t/m ³) :	2.36	2.34	2.33			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/184563	S/184564	S/184565			
MDR Test Date :	13/03/2023	13/03/2023	13/03/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Gravelly CLAY - Brown	Gravelly CLAY - Brown	Gravelly SAND - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.17	2.08	2.12			
Moisture Variation :	2.0%	2.5%	2.5%			
ADJ PCWD (t/m ³) :	2.20	2.13	2.16			
ADJ Moisture Variation :	2.0%	2.0%	2.0%			
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.0%	8.5%	8.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.19	2.06	2.13			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.5%	97.0%	98.5%			
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 93/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	20/03/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-
Project Number :	PTP/10047				Page 1 of 1	
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/184821	S/184822	S/184823	S/184824		
Date Tested :	3/03/2023	3/03/2023	3/03/2023	3/03/2023		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175		
Sampling Method :	AS1289.1.2.1 - c16.4b	AS1289.1.2.1 - c16.4b	AS1289.1.2.1 - c16.4b	AS1289.1.2.1 - c16.4b		
Time :	12:30	00:43	00:51	13:00		
Lot Number :	-	-	-	-		
Location 1 :	Precinct 96 (Filling Basin Area)	Precinct 96 (Filling Basin Area)	Precinct 96 (Filling Basin Area)	Precinct 96 (Filling Basin Area)		
Location 2 :	E: 499413	E: 499369	E: 499384	E: 499377		
Location 3 :	N: 6931953	N: 6931934	N: 6931965	N: 6931950		
Location 4 :	RL: 45.81	RL: 45.74	RL: 46.40	RL: 46.00		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	16%	11%	11%	11%		
Oversize Density - Dry (t/m ³) :	2.26	2.24	2.27	2.20		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/184821	S/184822	S/184823	S/184824		
MDR Test Date :	14/03/2023	14/03/2023	14/03/2023	14/03/2023		
Compaction Type :	Standard	Standard	Standard	Standard		
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown		
MDR Test Results						
PCWD (t/m ³) :	2.10	2.12	2.13	2.13		
Moisture Variation :	2.5%	2.5%	2.0%	1.5%		
ADJ PCWD (t/m ³) :	2.12	2.13	2.14	2.13		
ADJ Moisture Variation :	2.0%	2.5%	1.5%	1.0%		
Moisture Test Results :						
Field Moisture Content :	7.5%	8.0%	8.5%	8.5%		
Moisture Specification :	-	-	-	-		
Variation from OMC :	2.0% Dry of OMC	2.5% Dry of OMC	1.5% Dry of OMC	1.0% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-	-		
Moisture Ratio :	N/A	N/A	N/A	N/A		
Density Test Results						
Field Wet Density (t/m ³) :	2.17	2.14	2.16	2.15		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	102.0%	100.5%	101.0%	101.0%		
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/10047 - 87/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	20/03/2023		
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks		Test Request :	-		
Project Number :	PTP/10047		Page 1 of 1			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/185244	S/185245				
Date Tested :	6/03/2023	6/03/2023				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	150 / 175	150 / 175				
Sampling Method :	AS1289.1.2.1 - c6.4b	AS1289.1.2.1 - c6.4b				
Time :	10:30	10:40				
Lot Number :	-	-				
Location 1 :	Basin Fill	Basin Fill				
Location 2 :	E: 499392	E: 499371				
Location 3 :	N: 6931922	N: 6931918				
Location 4 :	RL: 45.30	RL: 46.80				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	17%	17%				
Oversize Density - Dry (t/m ³) :	2.26	2.40				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/185244	S/185245				
MDR Test Date :	14/03/2023	14/03/2023				
Compaction Type :	Standard	Standard				
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.09	2.14				
Moisture Variation :	1.0%	1.0%				
ADJ PCWD (t/m ³) :	2.12	2.18				
ADJ Moisture Variation :	1.0%	1.0%				
<i>Moisture Test Results :</i>						
Field Moisture Content :	8.0%	8.0%				
Moisture Specification :	-	-				
Variation from OMC :	1.0% Dry of OMC	1.0% Dry of OMC				
Relative Moisture Ratio (Q250) :	-	-				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.15	2.09				
Density Specification :	95%	95%				
Wet Density Ratio :	101.5%	96.0%				
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208			APPROVED SIGNATORY  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 88/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	20/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/185415	S/185416	S/185418	S/185419			
Date Tested :	7/03/2023	7/03/2023	7/03/2023	7/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	12:30	00:41	12:52	13:05			
Lot Number :	-	-	-	-			
Location 1 :	Basin Fill	Basin Fill	Basin Fill	Basin Fill			
Location 2 :	E: 499356	E: 499349	E: 499354	E: 499354			
Location 3 :	N: 6931936	N: 6931954	N: 6931955	N: 6931946			
Location 4 :	RL: 43.93	RL: 44.33	RL: 44.73	RL: 44.93			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	14%	17%	20%	19%			
Oversize Density - Dry (t/m ³) :	2.34	2.35	2.34	2.35			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/185415	S/185416	S/185418	S/185419			
MDR Test Date :	15/03/2023	15/03/2023	15/03/2023	15/03/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Gravelly CLAY - Brown	Gravelly CLAY - Brown	Gravelly CLAY - Brown	Gravelly CLAY - Brown			
<i>MDR Test Results</i>							
PCWD (t/m ³) :	1.93	1.97	1.97	1.96			
Moisture Variation :	2.0%	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	1.97	2.03	2.03	2.02			
ADJ Moisture Variation :	2.0%	2.0%	2.0%	1.5%			
<i>Moisture Test Results :</i>							
Field Moisture Content :	5.5%	5.0%	6.0%	7.5%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.03	2.09	2.04	2.03			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	103.0%	103.0%	100.5%	100.5%			
Soil Particle Density (APD) t/m ³ :							
Soil Particle Density (APD) Date :							
Remarks :							
 Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208				APPROVED SIGNATORY  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 89/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	20/03/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/185643	S/185644	S/185645	S/185646			
Date Tested :	8/03/2023	8/03/2023	8/03/2023	8/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:30	10:45	11:00	11:30			
Lot Number :	-	-	-	-			
Location 1 :	Basin Fill	Basin Fill	Basin Fill	Basin Fill			
Location 2 :	E: 499361	E: 499363	E: 499365	E: 499372			
Location 3 :	N: 6931979	N: 6931971	N: 6931963	N: 6931947			
Location 4 :	RL: 45.43	RL: 46.13	RL: 46.53	RL: 55.1			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	7%	12%	20%	9%			
Oversize Density - Dry (t/m ³) :	2.40	2.40	2.42	2.34			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/185643	S/185644	S/185645	S/185646			
MDR Test Date :	15/03/2023	15/03/2023	15/03/2023	15/03/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown			
<i>MDR Test Results</i>							
PCWD (t/m ³) :	2.20	2.19	2.11	2.19			
Moisture Variation :	2.5%	2.5%	2.0%	0.5%			
ADJ PCWD (t/m ³) :	2.21	2.21	2.17	2.20			
ADJ Moisture Variation :	2.5%	2.0%	2.0%	0.5%			
<i>Moisture Test Results :</i>							
Field Moisture Content :	7.0%	6.0%	7.0%	10.0%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	2.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	0.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.29	2.27	2.20	2.22			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	103.5%	102.5%	101.5%	101.0%			
-							
Soil Particle Density (APD) t/m ³ :							
Soil Particle Density (APD) Date :							
Remarks :							
 Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208				APPROVED SIGNATORY  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 90/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	20/03/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-
Project Number :	PTP/10047				Page 1 of 1	
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/185889	S/185890	S/185891	S/185892		
Date Tested :	9/03/2023	9/03/2023	9/03/2023	9/03/2023		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	10:00	10:08	10:15	10:22		
Lot Number :	-	-	-	-		
Location 1 :	Basin Fill	Basin Fill	Basin Fill	Basin Fill		
Location 2 :	E: 499342	E: 499345	E: 499358	E: 499365		
Location 3 :	N: 6931915	N: 6931924	N: 6931921	N: 6931916		
Location 4 :	RL: 45.05	RL: 45.45	RL: 45.85	RL: 46.25		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	0%	0%	0%	0%		
Oversize Density - Dry (t/m ³) :	-	-	-	-		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/185889	S/185890	S/185891	S/185892		
MDR Test Date :	16/03/2023	16/03/2023	16/03/2023	16/03/2023		
Compaction Type :	Standard	Standard	Standard	Standard		
Soil Description :	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown		
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.15	2.19	2.17	2.21		
Moisture Variation :	1.5%	2.0%	1.5%	2.0%		
ADJ PCWD (t/m ³) :	-	-	-	-		
ADJ Moisture Variation :	-	-	-	-		
<i>Moisture Test Results :</i>						
Field Moisture Content :	7.0%	10.5%	9.5%	10.0%		
Moisture Specification :	-	-	-	-		
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-	-		
Moisture Ratio :	N/A	N/A	N/A	N/A		
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.15	2.15	2.16	2.15		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	100.0%	98.5%	100.0%	97.5%		
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 92/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	20/03/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-
Project Number :	PTP/10047				Page 1 of 1	
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/186129	S/186130	S/186131	S/186132		
Date Tested :	10/03/2023	10/03/2023	10/03/2023	10/03/2023		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	10:00	10:30	11:00	23:30		
Lot Number :	-	-	-	-		
Location 1 :	Basin Fill	Basin Fill	Basin Fill	Basin Fill		
Location 2 :	E: 499451	E: 499441	E: 499433	E: 49928		
Location 3 :	N: 6931978	N: 6931984	N: 6931994	N: 6932003		
Location 4 :	RL: 46.68	RL: 46.9	RL: 47.27	RL: 47.6		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	10%	15%	8%	11%		
Oversize Density - Dry (t/m ³) :	2.33	2.15	2.35	2.25		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/186129	S/186130	S/186131	S/186132		
MDR Test Date :	17/03/2023	15/03/2023	15/03/2023	15/03/2023		
Compaction Type :	Standard	Standard	Standard	Standard		
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown		
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.26	2.27	2.31	2.26		
Moisture Variation :	0.0%	2.0%	1.0%	2.0%		
ADJ PCWD (t/m ³) :	2.26	2.25	2.31	2.26		
ADJ Moisture Variation :	0.0%	2.0%	1.0%	2.0%		
<i>Moisture Test Results :</i>						
Field Moisture Content :	10.5%	7.0%	9.5%	8.5%		
Moisture Specification :	-	-	-	-		
Variation from OMC :	0.0% Wet of OMC	2.0% Dry of OMC	1.0% Dry of OMC	2.0% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-	-		
Moisture Ratio :	N/A	N/A	N/A	N/A		
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.29	2.28	2.28	2.29		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	101.5%	101.5%	98.5%	101.0%		
Soil Particle Density (APD) t/m ³ :						
Soil Particle Density (APD) Date :						
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Number :	SR/PTP/10047 - 94/1
Client Address :	Everleigh Estate - Precinct 9.4 Earthworks				Report Date :	22/03/2023
Project Name :	PTP/10047				Test Request :	-
Project Number :	Greenbank				Page 1 of 1	
Location :						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/186429	S/186430	S/186431	S/186432		
Date Tested :	14/03/2023	14/03/2023	14/03/2023	14/03/2023		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill	General Fill		
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	10:30	10:45	11:00	11:15		
Lot Number :	Basin	Basin	Basin	Basin		
Location 1 :	E: 499463	E: 499438	E: 499402	E: 499420		
Location 2 :	N: 6931993	N: 6931979	N: 6931994	N: 6931987		
Location 3 :	RL: 47.7	RL: 47.3	RL: 47.0	RL: 48.1		
Location 4 :	-	-	-	-		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	4%	0%	0%	6%		
Oversize Density - Dry (t/m ³) :	2.06	-	-	2.19		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/186429	S/186430	S/186431	S/186432		
MDR Test Date :	21/03/2023	21/03/2023	20/03/2023	20/03/2023		
Compaction Type :	Standard	Standard	Standard	Standard		
Soil Description :	Gravelly Clayey SAND Brown	Gravelly Clayey SAND Brown	Gravelly Clayey SAND Brown	Gravelly Clayey SAND Brown		
MDR Test Results						
PCWD (t/m ³) :	2.21	2.20	2.20	2.20		
Moisture Variation :	4.0%	4.0%	4.0%	4.0%		
ADJ PCWD (t/m ³) :	2.20	-	-	2.20		
ADJ Moisture Variation :	4.0%	-	-	3.5%		
Moisture Test Results						
Field Moisture Content :	5.0%	6.0%	6.5%	5.5%		
Moisture Specification :	-	-	-	-		
Variation from OMC :	4.0% Dry of OMC	4.0% Dry of OMC	4.0% Dry of OMC	3.5% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-	-		
Moisture Ratio :	N/A	N/A	N/A	N/A		
Density Test Results						
Field Wet Density (t/m ³) :	2.23	2.23	2.21	2.23		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	101.5%	101.0%	100.5%	101.5%		
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Ben Pittard - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Number :	SR/PTP/10047 - 95/1
Client Address :	Everleigh Estate - Precinct 9.4 Earthworks				Report Date :	22/03/2023
Project Name :	PTP/10047				Test Request :	-
Project Number :	Greenbank				Page 1 of 1	
Location :						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/186625	S/186626	S/186627	S/186628		
Date Tested :	15/03/2023	15/03/2023	15/03/2023	15/03/2023		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	Basin Fill	Basin Fill	Basin Fill	Basin Fill		
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	10:30	10:45	11:00	11:20		
Lot Number :	-	-	-	-		
Location 1 :	Basin	Basin	Basin	Basin		
Location 2 :	E 499400	E 499386	E 499367	E 499348		
Location 3 :	N 6931957	N 6931964	N 6931956	N 6931946		
Location 4 :	RL 47.07	RL 47.37	RL 47.21	RL 47.20		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	18%	13%	18%	15%		
Oversize Density - Dry (t/m ³) :	1.90	2.56	1.94	2.15		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/186625	S/186626	S/186627	S/186628		
MDR Test Date :	22/03/2023	22/03/2023	22/03/2023	22/03/2023		
Compaction Type :	Standard	Standard	Standard	Standard		
Soil Description :	Gravelly SAND - Light Brown	Gravelly SAND - Light Brown	Gravelly SAND - Light Brown	Gravelly SAND - Light Brown		
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.07	2.05	2.14	2.15		
Moisture Variation :	3.0%	2.5%	2.5%	0.5%		
ADJ PCWD (t/m ³) :	2.04	2.10	2.10	2.15		
ADJ Moisture Variation :	2.5%	2.0%	2.0%	0.5%		
<i>Moisture Test Results</i>						
Field Moisture Content :	5.0%	6.0%	4.5%	5.0%		
Moisture Specification :	-	-	-	-		
Variation from OMC :	2.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	0.5% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-	-		
Moisture Ratio :	N/A	N/A	N/A	N/A		
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.11	2.10	2.17	2.19		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	103.5%	100.5%	103.0%	102.0%		
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Ben Pittard - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 96/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	6/04/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-
Project Number :	PTP/10047			Page 1 of 1	
Location :	Greenbank				
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,				
Sample Number :	S/186988	S/186989	S/186990	S/186991	
Date Tested :	17/03/2023	17/03/2023	17/03/2023	17/03/2023	
Material Source :	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	
Sampling Method :	AS1289.1.2.1 - cl6.4a	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	10:30	10:45	11:00	11:15	
Lot Number :	-	-	-	-	
Location 1 :	Basin	Basin	Basin	Basin	
Location 2 :	E 499355	E 499359	E 499371	E 499385	
Location 3 :	N 6931919	N 6931932	N 6931946	N 6931959	
Location 4 :	0.3m Below Finish Level	0.3m Below Finish Level	0.3m Below Finish Level	0.3m Below Finish Level	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	11%	11%	13%	12%	
Oversize Density - Dry (t/m ³) :	2.24	2.24	2.24	2.25	
Assigned MDR (Yes/No) :	No	No	No	No	
MDR Sample Number :	S/186988	S/186989	S/186990	S/186991	
MDR Test Date :	27/03/2023	27/03/2023	27/03/2023	27/03/2023	
Compaction Type :	Standard	Standard	Standard	Standard	
Soil Description :	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	
<i>MDR Test Results</i>					
PCWD (t/m ³) :	2.12	2.08	2.10	2.12	
Moisture Variation :	4.0%	4.0%	3.5%	2.0%	
ADJ PCWD (t/m ³) :	2.13	2.10	2.12	2.14	
ADJ Moisture Variation :	3.5%	3.5%	3.0%	2.0%	
<i>Moisture Test Results :</i>					
Field Moisture Content :	4.5%	4.5%	5.5%	6.0%	
Moisture Specification :	-	-	-	-	
Variation from OMC :	3.5% Dry of OMC	3.5% Dry of OMC	3.0% Dry of OMC	2.0% Dry of OMC	
Relative Moisture Ratio (Q250) :	-	-	-	-	
Moisture Ratio :	N/A	N/A	N/A	N/A	
<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.13	2.13	2.13	2.14	
Density Specification :	95%	95%	95%	95%	
Wet Density Ratio :	99.5%	101.5%	100.5%	100.0%	
Remarks :					
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  Ben Pittard - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 98/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	6/04/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-
Project Number :	PTP/10047			Page 1 of 1	
Location :	Greenbank				
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,				
Sample Number :	S/187331	S/187332	S/187333	S/187334	
Date Tested :	21/03/2023	21/03/2023	21/03/2023	21/03/2023	
Material Source :	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	13:00	13:15	13:30	13:45	
Lot Number :	-	-	-	-	
Location 1 :	E 499423	E 499413	E 499402	E 499387	
Location 2 :	N 6931990	N 6931998	N 6932017	N 6932018	
Location 3 :	0.5m Below Finish Level	0.3m Below Finish Level	0.5m Below Finish Level	0.5m Below Finish Level	
Location 4 :	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	16%	17%	16%	18%	
Oversize Density - Dry (t/m ³) :	2.36	2.38	2.35	2.29	
Assigned MDR (Yes/No) :	No	No	No	No	
MDR Sample Number :	S/187331	S/187332	S/187333	S/187334	
MDR Test Date :	3/04/2023	4/04/2023	4/04/2023	4/04/2023	
Compaction Type :	Standard	Standard	Standard	Standard	
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	
<i>MDR Test Results</i>					
PCWD (t/m ³) :	2.13	2.16	2.13	2.15	
Moisture Variation :	2.5%	2.5%	3.0%	2.5%	
ADJ PCWD (t/m ³) :	2.17	2.19	2.16	2.17	
ADJ Moisture Variation :	2.5%	2.0%	2.5%	2.5%	
<i>Moisture Test Results :</i>					
Field Moisture Content :	6.5%	6.5%	7.0%	6.5%	
Moisture Specification :	-	-	-	-	
Variation from OMC :	2.5% Dry of OMC	2.0% Dry of OMC	2.5% Dry of OMC	2.5% Dry of OMC	
Relative Moisture Ratio (Q250) :	-	-	-	-	
Moisture Ratio :	N/A	N/A	N/A	N/A	
<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.16	2.16	2.14	2.16	
Density Specification :	95%	95%	95%	95%	
Wet Density Ratio :	99.5%	98.5%	99.0%	99.5%	
Remarks :					
 Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208	APPROVED SIGNATORY  Ben Pittard - Signatory				

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 100/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	6/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/187910	S/187915	S/187916	S/187917			
Date Tested :	24/03/2023	24/03/2023	24/03/2023	24/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	11:00	11:15	11:30	11:45			
Lot Number :	-	-	-	-			
Location 1 :	Lot 3306 - Lot 3313	Lot 3306 - Lot 3313	Lot 3306 - Lot 3313	Lot 3306 - Lot 3313			
Location 2 :	E 499410	E 499403	E 499394	E 499373			
Location 3 :	N 6931998	N 69312010	N 6932022	N 6931983			
Location 4 :	RL.41.10	RL.41.51	RL.41.72	RL.41.49			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	18%	12%	13%	9%			
Oversize Density - Dry (t/m ³) :	2.31	2.32	2.25	2.30			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/187910	S/187915	S/187916	S/187917			
MDR Test Date :	5/04/2023	5/04/2023	5/04/2023	5/04/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown			
<i>MDR Test Results</i>							
PCWD (t/m ³) :	2.18	2.16	2.17	2.13			
Moisture Variation :	1.5%	2.0%	1.5%	1.5%			
ADJ PCWD (t/m ³) :	2.20	2.18	2.18	2.14			
ADJ Moisture Variation :	1.5%	1.5%	1.5%	1.5%			
<i>Moisture Test Results :</i>							
Field Moisture Content :	7.5%	8.0%	8.5%	9.0%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.18	2.18	2.16	2.16			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	99.0%	100.0%	99.0%	100.5%			
Remarks :							
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Ben Pittard - Signatory</p>			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 101/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	11/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/188156	S/188157	S/188158	S/188159			
Date Tested :	27/03/2023	27/03/2023	27/03/2023	27/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill			
Test / Layer Depths :	175 / 150	175 / 150	175 / 150	175 / 150			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:00	10:15	10:30	22:45			
Lot Number :	-	-	-	-			
Location 1 :	Lots 3188 - 3370	Lots 3188 - 3370	Lots 3188 - 3370	Lots 3188 - 3370			
Location 2 :	E - 499370	E - 499343	E - 499362	E - 499394			
Location 3 :	N - 6931974	N - 6932008	N - 6931962	N - 6931976			
Location 4 :	RL 50.66	RL 50.26	RL 49.26	RL 48.76			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Upsize Wet :	17%	11%	0%	18%			
Upsize Density - Dry (t/m ³) :	2.34	2.26	-	2.29			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/188156	S/188157	S/188158	S/188159			
MDR Test Date :	11/04/2023	11/04/2023	5/04/2023	5/04/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Clayey Gravelly SAND - Brown	Clayey Gravelly SAND - Brown	Clayey Gravelly SAND - Brown	Clayey Gravelly SAND - Brown			
MDR Test Results							
PCWD (t/m ³) :	2.16	2.19	2.18	2.19			
Moisture Variation :	2.0%	1.5%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	2.19	2.20	-	2.21			
ADJ Moisture Variation :	1.5%	1.5%	-	1.5%			
Moisture Test Results :							
Field Moisture Content :	6.5%	8.0%	10.0%	6.5%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
Density Test Results							
Field Wet Density (t/m ³) :	2.23	2.22	2.23	2.22			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	102.0%	100.5%	102.5%	100.5%			
Remarks :							
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Ben Pittard - Signatory</p>			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 102/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	11/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/188355	S/188356	S/188357	S/188358			
Date Tested :	28/03/2023	28/03/2023	28/03/2023	28/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill			
Test / Layer Depths :	175 / 150	175 / 150	175 / 150	175 / 150			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	10:43	11:00	11:15	11:30			
Lot Number :	-	-	-	-			
Location 1 :	Lots 3318 - 3313	Lots 3318 - 3313	Lots 3318 - 3313	Lots 3318 - 3313			
Location 2 :	E - 499401	E - 499446	E - 499455	E - 499441			
Location 3 :	N - 6931971	N - 6931961	N - 6931946	N - 6931936			
Location 4 :	RL 40.9	RL 40.6	RL 40.3	RL 39.7			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Override Wet :	13%	13%	19%	16%			
Override Density - Dry (t/m ³) :	2.24	2.29	2.24	2.21			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/188355	S/188356	S/188357	S/188358			
MDR Test Date :	11/04/2023	11/04/2023	11/04/2023	11/04/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Sandy CLAY - Light Brown	Sandy CLAY - Light Brown	Sandy CLAY - Light Brown	Sandy CLAY - Light Brown			
MDR Test Results							
PCWD (t/m ³) :	2.13	2.17	2.12	2.14			
Moisture Variation :	3.0%	2.5%	2.5%	3.0%			
ADJ PCWD (t/m ³) :	2.15	2.18	2.14	2.15			
ADJ Moisture Variation :	2.5%	2.0%	2.5%	2.5%			
Moisture Test Results :							
Field Moisture Content :	7.0%	7.0%	6.0%	6.5%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	2.5% Dry of OMC	2.0% Dry of OMC	2.5% Dry of OMC	2.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
Density Test Results							
Field Wet Density (t/m ³) :	2.20	2.17	2.19	2.18			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	102.5%	99.5%	102.5%	101.5%			
Remarks :							
	Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208				APPROVED SIGNATORY  Ben Pittard - Signatory		
	Document Number : RF1				Date : 12/03/2023		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/10047 - 103/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	18/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/189168	S/189169	S/189170	S/189171			
Date Tested :	31/03/2023	31/03/2023	31/03/2023	31/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 150	175 / 150	175 / 150	175 / 150			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	13:30	13:45	14:00	14:15			
Lot Number :	-	-	-	-			
Location 1 :	Basin	Basin	Basin	Basin			
Location 2 :	E 499355	E 499359	E 499371	E 499385			
Location 3 :	N 69331919	N 69331932	N 69331946	N 69331959			
Location 4 :	0.3m Below Finish Level	0.3m Below Finish Level	0.3m Below Finish Level	0.3m Below Finish Level			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	18%	13%	10%	13%			
Oversize Density - Dry (t/m ³) :	2.29	2.22	2.18	2.36			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/189168	S/189169	S/189170	S/189171			
MDR Test Date :	11/04/2023	11/04/2023	11/04/2023	11/04/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown	Sandy GRAVEL - Brown			
<i>MDR Test Results</i>							
PCWD (t/m ³) :	2.20	2.22	2.21	2.19			
Moisture Variation :	0.0%	2.0%	0.0%	1.5%			
ADJ PCWD (t/m ³) :	2.21	2.22	2.20	2.21			
ADJ Moisture Variation :	-	2.0%	-	1.5%			
<i>Moisture Test Results :</i>							
Field Moisture Content :	7.0%	8.5%	8.5%	6.5%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	At OMC	2.0% Dry of OMC	At OMC	1.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.26	2.28	2.25	2.25			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	102.0%	102.5%	102.0%	101.5%			
Remarks :							
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Ben Pittard - Signatory						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforths				Report Number :	SR/PTP/10047 - 104/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	18/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-	
Project Number :	PTP/10047				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/189185	S/189186	S/189187	S/189188			
Date Tested :	31/03/2023	31/03/2023	31/03/2023	31/03/2023			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	Allotment Fill	Allotment Fill	Allotment Fill	Allotment Fill			
Test / Layer Depths :	175 / 150	175 / 150	175 / 150	175 / 150			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	13:45	14:00	14:15	14:30			
Lot Number :	-	-	-	-			
Location 1 :	Lots 3318 - 3313	Lots 3318 - 3313	Lots 3318 - 3313	Lots 3318 - 3313			
Location 2 :	E 499372	E 499408	E 499387	E 499344			
Location 3 :	N 6931915	N 6931935	N 6931950	N 6931959			
Location 4 :	RL 40.7	RL 40.9	RL 41.05	RL 42.25			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Override Wet :	17%	15%	17%	12%			
Override Density - Dry (t/m ³) :	2.19	2.27	2.24	2.08			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/189185	S/189186	S/189187	S/189188			
MDR Test Date :	12/04/2023	12/04/2023	12/04/2023	12/04/2023			
Compaction Type :	Standard	Standard	Standard	Standard			
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown			
MDR Test Results							
PCWD (t/m ³) :	2.18	2.15	2.16	2.15			
Moisture Variation :	1.0%	2.5%	0.5%	2.5%			
ADJ PCWD (t/m ³) :	2.18	2.17	2.18	2.14			
ADJ Moisture Variation :	0.5%	2.0%	0.5%	2.5%			
Moisture Test Results :							
Field Moisture Content :	8.5%	7.5%	8.5%	7.5%			
Moisture Specification :	-	-	-	-			
Variation from OMC :	0.5% Dry of OMC	2.0% Dry of OMC	0.5% Dry of OMC	2.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-	-			
Moisture Ratio :	N/A	N/A	N/A	N/A			
Density Test Results							
Field Wet Density (t/m ³) :	2.23	2.23	2.21	2.21			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	102.5%	102.5%	101.5%	103.0%			
Remarks :							
	Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208				APPROVED SIGNATORY  Ben Pittard - Signatory		
	Document Number : RF1				Date : 12/03/2023		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 114/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	28/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/192461	S/192462	S/192463	S/192464	S/192465	S/192466
Date Tested :	19/04/2023	19/04/2023	19/04/2023	19/04/2023	19/04/2023	19/04/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	09:00	09:15	09:30	09:45	10:00	10:15
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499079.6	E 499037.1	E 499051.6	E 499100.3	E 499118.4	E 499165
Location 2 :	N 6932045	N 6932046.8	N 6932043.2	N 6932094.1	N 6932078.9	N 6932082.1
Location 3 :	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	17%	12%	12%	15%	15%	13%
Oversize Density - Dry (t/m ³) :	2.24	2.25	2.27	2.36	2.02	2.35
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/192461	S/192462	S/192463	S/192464	S/192465	S/192466
MDR Test Date :	24/04/2023	24/04/2023	24/04/2023	24/04/2023	24/04/2023	24/04/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown
MDR Test Results						
PCWD (t/m ³) :	2.06	2.06	2.07	2.07	2.08	2.10
Moisture Variation :	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%
ADJ PCWD (t/m ³) :	2.09	2.08	2.10	2.11	2.07	2.13
ADJ Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
Moisture Test Results :						
Field Moisture Content :	5.0%	6.5%	5.5%	6.0%	5.5%	6.0%
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC	±2% of OMC	±2% of OMC	±2% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.14	2.13	2.15	2.15	2.13	2.13
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	102.0%	102.0%	102.5%	102.0%	103.0%	100.0%
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Ben Pittard - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 114/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	28/04/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 2 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/192467	S/192468	S/192469	S/192470	S/192471	S/192472
Date Tested :	19/04/2023	19/04/2023	19/04/2023	19/04/2023	19/04/2023	19/04/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:30	10:45	11:00	11:15	11:30	11:45
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499218.7	E 499185.2	E 499017	E 499180.5	E 499237.1	E 499222.6
Location 2 :	N 6931954.5	N 6931975.2	N 6932033.1	N 6932084.9	N 6932054.6	N 6932059.6
Location 3 :	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	15%	19%	8%	15%	19%	15%
Oversize Density - Dry (t/m ³) :	2.35	2.25	2.31	2.34	2.32	2.16
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/192467	S/192468	S/192469	S/192470	S/192471	S/192472
MDR Test Date :	24/04/2023	24/04/2023	24/04/2023	24/04/2023	24/04/2023	24/04/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown
MDR Test Results						
PCWD (t/m ³) :	2.10	2.07	2.06	2.14	2.07	2.10
Moisture Variation :	1.5%	2.0%	2.0%	1.5%	1.5%	2.0%
ADJ PCWD (t/m ³) :	2.13	2.10	2.08	2.17	2.12	2.11
ADJ Moisture Variation :	1.5%	1.5%	2.0%	1.5%	1.0%	1.5%
Moisture Test Results :						
Field Moisture Content :	5.0%	5.0%	5.5%	5.5%	5.0%	6.5%
Moisture Specification :	±2% of OMC	±2% of OMC	±2% of OMC	±2% of OMC	±2% of OMC	±2% of OMC
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	1.0% Dry of OMC	1.5% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.14	2.13	2.14	2.13	2.14	2.12
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	100.5%	101.5%	103.0%	98.0%	101.0%	100.5%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Ben Pittard - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Number :	SR/PTP/10047 - 114/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	28/04/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks				Test Request :	-
Project Number :	PTP/10047				Page 3 of 3	
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/192473	S/192474	S/192475	S/192476		
Date Tested :	19/04/2023	19/04/2023	19/04/2023	19/04/2023		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill	General Fill		
Test / Layer Depths :	175 / 150	175 / 150	175 / 150	175 / 150		
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	12:00	12:15	12:30	12:45		
Lot Number :	-	-	-	-		
Location 1 :	General Fill Area 9.7	General Fill Area 9.7	General Fill Area 9.7	General Fill Area 9.7		
Location 2 :	E 499317	E 499310	E 499250	E 499269		
Location 3 :	N 6932130	N 6932184	N 6932172	N 6932174		
Location 4 :	0.9m Below Finish Level	0.6m Below Finish Level	0.3m Below Finish Level	Finish Level		
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	10%	20%	17%	20%		
Oversize Density - Dry (t/m ³) :	2.21	2.23	2.20	2.15		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/192473	S/192474	S/192475	S/192476		
MDR Test Date :	26/04/2023	21/04/2023	21/04/2023	21/04/2023		
Compaction Type :	Standard	Standard	Standard	Standard		
Soil Description :	Clayey SAND- Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown		
MDR Test Results						
PCWD (t/m ³) :	2.21	2.21	2.22	2.21		
Moisture Variation :	2.5%	3.0%	2.5%	3.0%		
ADJ PCWD (t/m ³) :	2.21	2.22	2.22	2.20		
ADJ Moisture Variation :	2.5%	2.5%	2.5%	2.5%		
Moisture Test Results :						
Field Moisture Content :	8.5%	7.0%	7.5%	7.0%		
Moisture Specification :	-	-	-	-		
Variation from OMC :	2.5% Dry of OMC	2.5% Dry of OMC	2.5% Dry of OMC	2.5% Dry of OMC		
Relative Moisture Ratio (Q250) :	-	-	-	-		
Moisture Ratio :	N/A	N/A	N/A	N/A		
Density Test Results						
Field Wet Density (t/m ³) :	2.21	2.21	2.21	2.21		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	100.0%	100.0%	99.5%	100.5%		
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Ben Pittard - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 121/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	24/05/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 2	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,
----------------	---

Sample Number :	S/193389	S/193390	S/193391	S/193392	S/193393	S/193394
Date Tested :	26/04/2023	26/04/2023	26/04/2023	26/04/2023	26/04/2023	26/04/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill					
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	13:00	13:10	13:20	13:30	13:40	13:50
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499291	E 499297	E 499305	E 499312	E 499310	E 499316
Location 2 :	N 6931927	N 6931913	N 6931900	N 6931883	N 6931943	N 6931928
Location 3 :	1m Below Finish Level	0.6m Below Finish Level	1.5m Below Finish Level	0.5m Below Finish Level	0.5m Below Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-

Test Fraction (mm) :	< 19mm					
Oversize Wet :	6%	10%	14%	10%	0%	0%
Oversize Density - Dry (t/m ³) :	2.51	2.31	2.28	2.30	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/193389	S/193390	S/193391	S/193392	S/193393	S/193394
MDR Test Date :	28/04/2023	28/04/2023	28/04/2023	28/04/2023	2/05/2023	28/04/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly SAND - Brown					

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.13	2.17	2.13	2.12	2.06	2.10
Moisture Variation :	2.5%	2.0%	2.5%	2.5%	2.0%	2.0%
ADJ PCWD (t/m ³) :	2.15	2.18	2.15	2.14	-	-
ADJ Moisture Variation :	2.0%	2.0%	2.0%	2.0%	-	-

<i>Moisture Test Results :</i>						
Field Moisture Content :	5.5%	5.0%	4.5%	5.5%	10.0%	9.5%
Moisture Specification :	+/-2.0% of OMC					
Variation from OMC :	2.0% Dry of OMC					
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.19	2.21	2.18	2.18	2.10	2.10
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	101.5%	101.0%	101.0%	102.0%	102.0%	100.0%

Remarks :	
-----------	--

 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
--	---

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/10047 - 121/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	24/05/2023		
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks		Test Request :	-		
Project Number :	PTP/10047		Page 2 of 2			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/193395	S/193396				
Date Tested :	26/04/2023	26/04/2023				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	150 / 175	150 / 175				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	14:00	14:10				
Lot Number :	-	-				
Location 1 :	E 499323	E 499337				
Location 2 :	N 6931916	N 6931903				
Location 3 :	Finish Level	Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	0%	0%				
Oversize Density - Dry (t/m ³) :	-	-				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/193395	S/193396				
MDR Test Date :	2/05/2023	2/05/2023				
Compaction Type :	Standard	Standard				
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.05	2.04				
Moisture Variation :	1.0%	1.0%				
ADJ PCWD (t/m ³) :	-	-				
ADJ Moisture Variation :	-	-				
<i>Moisture Test Results :</i>						
Field Moisture Content :	10.0%	11.5%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	1.0% Dry of OMC	1.0% Dry of OMC				
Relative Moisture Ratio (Q250) :	-	-				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.08	2.09				
Density Specification :	95%	95%				
Wet Density Ratio :	101.5%	102.5%				
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Number :	SR/PTP/10047 - 122/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	24/05/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 4		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/193520	S/193521	S/193522	S/193523	S/193524	S/193525
Date Tested :	27/04/2023	27/04/2023	27/04/2023	27/04/2023	27/04/2023	27/04/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	11:00	11:10	11:20	11:30	11:40	11:50
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499358	E 499347	E 499354	E 499371	E 499387	E 499332
Location 2 :	N 6932004	N 6931978	N 6932038	N 6932037	N 6932037	N 6931895
Location 3 :	1m Below Finish Level	0.6m Below Finish Level	1.5m Below Finish Level	0.3m Below Finish Level	0.5m Below Finish Level	1m Below Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	11%	11%	10%	12%	11%	10%
Oversize Density - Dry (t/m ³) :	2.41	2.36	2.20	2.37	2.15	2.26
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/193520	S/193521	S/193522	S/193523	S/193524	S/193525
MDR Test Date :	2/05/2023	2/05/2023	2/05/2023	2/05/2023	2/05/2023	2/05/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly Clayey SAND Light Brown	Gravelly Clayey SAND Light Brown	Gravelly Clayey SAND Light Brown	Gravelly Clayey SAND Light Brown	Gravelly Clayey SAND Light Brown	Gravelly Clayey SAND Light Brown
MDR Test Results						
PCWD (t/m ³) :	2.18	2.17	2.17	2.15	2.19	2.14
Moisture Variation :	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%
ADJ PCWD (t/m ³) :	2.21	2.19	2.17	2.18	2.19	2.15
ADJ Moisture Variation :	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%
Moisture Test Results						
Field Moisture Content :	6.5%	7.0%	8.0%	7.0%	7.5%	6.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.17	2.16	2.18	2.18	2.17	2.17
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	98.5%	99.0%	100.5%	100.0%	99.0%	101.0%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 122/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	24/05/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 2 of 4		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/193526	S/193527	S/193528	S/193529	S/193530	S/193531
Date Tested :	27/04/2023	27/04/2023	27/04/2023	27/04/2023	27/04/2023	27/04/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	12:00	12:10	12:20	12:30	12:40	12:50
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499337	E 499346	E 499381	E 499435	E 499334	E 499055
Location 2 :	N 6931998	N 6931898	N 6932003	N 6931956	N 6931886	N 6932187
Location 3 :	Finish level	0.9m Below Finish Level	0.5m Below Finish Level	1.5m Below Finish Level	1.2m Below Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	13%	18%	12%	0%	0%
Oversize Density - Dry (t/m ³) :	-	2.28	2.19	2.26	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/193526	S/193527	S/193528	S/193529	S/193530	S/193531
MDR Test Date :	3/05/2023	3/05/2023	3/05/2023	3/05/2023	3/05/2023	3/05/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly Clayey SAND - Brown	Gravelly Clayey SAND - Brown	Gravelly Clayey SAND - Brown	Gravelly Clayey SAND - Brown	Gravelly Clayey SAND - Brown	Gravelly Clayey SAND - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.12	2.15	2.13	2.15	2.13	2.13
Moisture Variation :	2.0%	2.5%	2.5%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	2.17	2.14	2.16	-	-
ADJ Moisture Variation :	-	2.0%	2.0%	2.0%	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	6.5%	8.0%	7.0%	7.5%	8.5%	8.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.16	2.19	2.18	2.17	2.16	2.17
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	102.0%	101.0%	102.0%	100.0%	101.5%	102.0%
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>					
	Document Number : RF1			Date : 11/04/2023		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 122/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	24/05/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 3 of 4		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/193532	S/193533	S/193534	S/193535	S/193536	S/193537
Date Tested :	27/04/2023	27/04/2023	27/04/2023	27/04/2023	27/04/2023	27/04/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	13:00	13:10	13:20	13:30	13:40	13:50
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499126	E 499075	E 499170	E 499202	E 499203	E 499232
Location 2 :	N 6932205	N 6932178	N 6932160	N 6932184	N 6932158	N 6932152
Location 3 :	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/193532	S/193533	S/193534	S/193535	S/193536	S/193537
MDR Test Date :	3/05/2023	3/05/2023	3/05/2023	3/05/2023	3/05/2023	3/05/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly SAND - Brown	Gravelly SAND - Brown	Gravelly SAND - Brown	Gravelly SAND - Brown	Gravelly SAND - Brown	Gravelly SAND - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.15	2.13	2.16	2.16	2.15	2.16
Moisture Variation :	2.0%	1.5%	1.5%	2.0%	1.5%	1.5%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	8.5%	8.5%	7.5%	8.5%	9.5%	9.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.17	2.15	2.18	2.17	2.18	2.16
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	101.0%	101.0%	101.0%	100.0%	101.5%	100.0%
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/10047 - 122/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	24/05/2023		
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks		Test Request :	-		
Project Number :	PTP/10047		Page 4 of 4			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/193538	S/193539				
Date Tested :	27/04/2023	27/04/2023				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	150 / 175	150 / 175				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	14:00	14:10				
Lot Number :	-	-				
Location 1 :	E 499267	E 499320				
Location 2 :	N 6932150	N 6932084				
Location 3 :	Finish Level	Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	0%	0%				
Oversize Density - Dry (t/m ³) :	-	-				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/193538	S/193539				
MDR Test Date :	4/05/2023	4/05/2023				
Compaction Type :	Standard	Standard				
Soil Description :	Gravelly Clayey SAND Dark Brown	Gravelly Clayey SAND Dark Brown				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.17	2.16				
Moisture Variation :	1.5%	1.5%				
ADJ PCWD (t/m ³) :	-	-				
ADJ Moisture Variation :	-	-				
<i>Moisture Test Results :</i>						
Field Moisture Content :	6.0%	9.0%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC				
Relative Moisture Ratio (Q250) :	-	-				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.15	2.18				
Density Specification :	95%	95%				
Wet Density Ratio :	99.0%	100.5%				
Remarks :						
 <p style="font-size: x-small;">Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth					Report Number :	SR/PTP/10047 - 131/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD					Report Date :	2/06/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks					Test Request :	-
Project Number :	PTP/10047					Page 1 of 3	
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/198101	S/198102	S/198103	S/198104	S/198105	S/198106	
Date Tested :	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	13:00	13:10	13:20	13:30	13:40	13:50	
Lot Number :	-	-	-	-	-	-	
Location 1 :	E 499256	E 499339	E 499363	E 499348	E 499388	E 499397	
Location 2 :	N 6932056	N 6931948	N 6931904	N 6931909	N 6931943	N 6931943	
Location 3 :	Finish Level	0.6m Below Finish Level	0.3m Below Finish Level	Finish Level	0.5m Below Finish Level	Finish Level	
Location 4 :	-	-	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	0%	0%	0%	0%	0%	0%	
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-	
Assigned MDR (Yes/No) :	No	No	No	No	No	No	
MDR Sample Number :	S/198101	S/198102	S/198103	S/198104	S/198105	S/198106	
MDR Test Date :	30/05/2023	30/05/2023	30/05/2023	30/05/2023	30/05/2023	30/05/2023	
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard	
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	
<i>MDR Test Results</i>							
PCWD (t/m ³) :	2.15	2.15	2.14	2.15	2.15	2.14	
Moisture Variation :	2.0%	2.0%	1.5%	1.5%	2.0%	2.0%	
ADJ PCWD (t/m ³) :	-	-	-	-	-	-	
ADJ Moisture Variation :	-	-	-	-	-	-	
<i>Moisture Test Results :</i>							
Field Moisture Content :	10.0%	9.5%	10.5%	10.0%	9.5%	10.5%	
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-	
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A	
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.13	2.15	2.16	2.14	2.17	2.16	
Density Specification :	95%	95%	95%	95%	95%	95%	
Wet Density Ratio :	99.0%	100.0%	101.0%	100.0%	101.0%	101.0%	
Remarks :							
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth					Report Number :	SR/PTP/10047 - 131/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD					Report Date :	2/06/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks					Test Request :	-
Project Number :	PTP/10047					Page 2 of 3	
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/198107	S/198108	S/198109	S/198110	S/198111	S/198112	
Date Tested :	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	14:00	14:10	14:20	14:30	14:40	14:50	
Lot Number :	-	-	-	-	-	-	
Location 1 :	E 499412	E 499298	E 499321	E 499288	E 499281	E 499267	
Location 2 :	N 6931972	N 6931895	N 6931877	N 6931909	N6931924	N 6931948	
Location 3 :	Finish Level	0.9m Below Finish Level	Finish Level	0.3m Below Finish Level	Finish Level	Finish Level	
Location 4 :	-	-	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	0%	0%	0%	0%	0%	0%	
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-	
Assigned MDR (Yes/No) :	No	No	No	No	No	No	
MDR Sample Number :	S/198107	S/198108	S/198109	S/198110	S/198111	S/198112	
MDR Test Date :	30/05/2023	30/05/2023	30/05/2023	30/05/2023	30/05/2023	30/05/2023	
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard	
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	
<i>MDR Test Results</i>							
PCWD (t/m ³) :	2.12	2.11	2.13	2.11	2.12	2.10	
Moisture Variation :	2.0%	2.0%	1.5%	1.5%	1.5%	1.5%	
ADJ PCWD (t/m ³) :	-	-	-	-	-	-	
ADJ Moisture Variation :	-	-	-	-	-	-	
<i>Moisture Test Results :</i>							
Field Moisture Content :	9.5%	9.5%	10.0%	10.0%	10.0%	9.5%	
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-	
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A	
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.15	2.16	2.13	2.15	2.14	2.15	
Density Specification :	95%	95%	95%	95%	95%	95%	
Wet Density Ratio :	101.0%	102.5%	100.0%	102.0%	101.0%	102.5%	
Remarks :							
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Nick Dobson - Signatory						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 131/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	2/06/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 3 of 3	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,		
----------------	---	--	--

Sample Number :	S/198113	S/198114	S/198115			
Date Tested :	26/05/2023	26/05/2023	26/05/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	15:00	15:10	15:20			
Lot Number :	-	-	-			
Location 1 :	E 499429	E 499337	E 499340			
Location 2 :	N 6931987	N 6932037	N 6931974			
Location 3 :	Finish Level	Finish Level	Finish Level			
Location 4 :	-	-	-			

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/198113	S/198114	S/198115			
MDR Test Date :	30/05/2023	30/05/2023	30/05/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown			

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.12	2.12	2.13			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			

<i>Moisture Test Results :</i>						
Field Moisture Content :	10.0%	9.5%	10.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.15	2.14	2.16			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	101.5%	101.0%	101.5%			

Remarks :						
-----------	--	--	--	--	--	--

 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
--	---

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Number :	SR/PTP/10047 - 132/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	7/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198118	S/198119	S/198120	S/198121	S/198122	S/198123
Date Tested :	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	13:00	13:05	13:15	13:20	13:25	13:30
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499324	E 499356	E 499375	E 499427	E 499348	E 499371
Location 2 :	N6931946	N 6931895	N 6931909	N 6931947	N 6931881	N 6931899
Location 3 :	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level	0.5m Below Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/198118	S/198119	S/198120	S/198121	S/198122	S/198123
MDR Test Date :	31/05/2023	31/05/2023	31/05/2023	31/05/2023	31/05/2023	31/05/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown
MDR Test Results						
PCWD (t/m ³) :	2.13	2.15	2.14	2.13	2.15	2.17
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
Moisture Test Results :						
Field Moisture Content :	10.0%	10.0%	9.0%	10.5%	9.5%	9.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.14	2.15	2.12	2.12	2.15	2.16
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	100.0%	100.0%	99.5%	99.5%	100.0%	99.5%
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/10047 - 132/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	7/06/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 2 of 3	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,
----------------	---

Sample Number :	S/198124	S/198125	S/198126	S/198127	S/198128	S/198129
Date Tested :	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023	26/05/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill					
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	13:40	13:45	13:50	13:55	14:05	14:15
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499338	E 499443	E 499344	E 499353	E 499382	E 499424
Location 2 :	N 6931942	N6931954	N 6931875	N 6931973	N 6931932	N 6931976
Location 3 :	Finish Level	0.3m Below Finish Level	0.6m Below Finish Level	0.3m Below Finish Level	Finish Level	0.9m Below Finish Level
Location 4 :	-	-	-	-	-	-

Test Fraction (mm) :	< 19mm					
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/198124	S/198125	S/198126	S/198127	S/198128	S/198129
MDR Test Date :	31/05/2023	31/05/2023	31/05/2023	31/05/2023	31/05/2023	31/05/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown					

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.10	2.12	2.10	2.17	2.13	2.10
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-

<i>Moisture Test Results :</i>						
Field Moisture Content :	9.5%	10.0%	10.5%	10.0%	10.0%	9.5%
Moisture Specification :	+/-2.0% of OMC					
Variation from OMC :	2.0% Dry of OMC					
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.11	2.13	2.14	2.16	2.15	2.13
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	100.5%	100.5%	101.5%	100.0%	101.0%	101.0%

Remarks :	
-----------	--

 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
--	---

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 132/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	7/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 3 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198130	S/198131	S/198132			
Date Tested :	26/05/2023	26/05/2023	26/05/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	14:20	14:25	14:35			
Lot Number :	-	-	-			
Location 1 :	E 499429	E 499409	E 499418			
Location 2 :	N 6931965	N 6931967	N 6931940			
Location 3 :	Finish Level	Finish Level	Finish Level			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/198130	S/198131	S/198132			
MDR Test Date :	31/05/2023	31/05/2023	31/05/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.13	2.16	2.15			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.5%	9.5%	9.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.11	2.16	2.14			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.5%	100.0%	99.5%			
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Number :	SR/PTP/10047 - 133/1	
Client Address :	Everleigh Estate - Precinct 9.4 Earthworks			Report Date :	8/06/2023	
Project Name :	PTP/10047			Test Request :	-	
Project Number :	Greenbank			Page 1 of 3		
Location :						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198251	S/198252	S/198253	S/198254	S/198255	S/198256
Date Tested :	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:30	10:40	10:50	11:00	11:10	11:20
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499317	E 499331	E 499223	E 499258	E 499394	E 499385
Location 2 :	N 6931871	N 6931882	N 6932029	N 6931962	N 6931968	N 6931928
Location 3 :	Finish Level	0.5m Below Finish Level	Finish Level	0.8m Below Finish Level	0.3m Below Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/198251	S/198252	S/198253	S/198254	S/198255	S/198256
MDR Test Date :	1/06/2023	1/06/2023	1/06/2023	1/06/2023	1/06/2023	1/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown
MDR Test Results						
PCWD (t/m ³) :	2.20	2.20	2.21	2.21	2.19	2.21
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
Moisture Test Results :						
Field Moisture Content :	10.0%	10.5%	10.5%	9.5%	9.5%	10.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.13	2.17	2.17	2.15	2.14	2.16
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	97.0%	98.5%	98.0%	97.5%	97.5%	98.0%
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Nick Dobson - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 133/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	8/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 2 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198257	S/198258	S/198259	S/198260	S/198261	S/198262
Date Tested :	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	11:30	11:40	11:50	12:00	12:10	12:20
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499389	E 499411	E 499368	E 499403	E 499426	E 499436
Location 2 :	N 6931918	N 6931945	N 6931927	N 6931926	N 6931941	N 6931950
Location 3 :	1m Below Finish Level	0.9m Below Finish Level	1.2m Below Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/198257	S/198258	S/198259	S/198260	S/198261	S/198262
MDR Test Date :	31/05/2023	31/05/2023	31/05/2023	31/05/2023	31/05/2023	31/05/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown
MDR Test Results						
PCWD (t/m ³) :	2.13	2.11	2.17	2.16	2.11	2.12
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
Moisture Test Results :						
Field Moisture Content :	11.0%	8.5%	10.0%	9.5%	9.0%	9.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.15	2.14	2.17	2.16	2.14	2.15
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	101.0%	101.5%	100.0%	100.5%	101.0%	101.0%
Remarks :						
 Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208	APPROVED SIGNATORY  Nick Dobson - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 133/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	8/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 3 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198263	S/198264	S/198265			
Date Tested :	29/05/2023	29/05/2023	29/05/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	12:30	12:40	12:50			
Lot Number :	-	-	-			
Location 1 :	E 499386	E 499380	E 499374			
Location 2 :	6931991N	N 6931945	N 6931995			
Location 3 :	Finish Level	Finish Level	Finish Level			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
OverSize Wet :	0%	0%	0%			
OverSize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/198263	S/198264	S/198265			
MDR Test Date :	31/05/2023	31/05/2023	31/05/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.14	2.14	2.16			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.5%	10.0%	9.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.13	2.14	2.17			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.5%	100.5%	100.5%			
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 134/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	12/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 1 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198311	S/198312	S/198313	S/198314	S/198315	S/198316
Date Tested :	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:00	10:10	10:15	10:20	10:25	10:30
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499307	E 499277	E 499343	E 499323	E 499348	E 499268
Location 2 :	N 6932058	N 6932063	N 6931894	N 6931899	N 6931996	N 6931992
Location 3 :	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/198311	S/198312	S/198313	S/198314	S/198315	S/198316
MDR Test Date :	1/06/2023	1/06/2023	1/06/2023	1/06/2023	1/06/2023	1/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.14	2.11	2.16	2.17	2.14	2.14
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.5%	9.5%	8.5%	11.5%	10.0%	10.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.15	2.14	2.12	2.16	2.13	2.12
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	100.5%	101.5%	98.0%	99.5%	99.5%	99.0%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 134/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	12/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 2 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198317	S/198318	S/198319	S/198320	S/198321	S/198322
Date Tested :	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023	29/05/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:35	10:40	10:45	10:50	10:55	11:00
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499334	E 499350	E 499308	E 499326	E 499374	E 499337
Location 2 :	N 6931990	N 6931892	N 6931878	N 6931894	N 6931967	N 6931966
Location 3 :	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/198317	S/198318	S/198319	S/198320	S/198321	S/198322
MDR Test Date :	1/06/2023	1/06/2023	1/06/2023	1/06/2023	1/06/2023	1/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.13	2.15	2.17	2.14	2.15	2.12
Moisture Variation :	2.0%	1.5%	2.0%	1.5%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.0%	10.5%	9.0%	10.0%	9.5%	9.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.15	2.14	2.15	2.17	2.14	2.12
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	101.0%	100.0%	99.5%	101.0%	99.5%	100.0%
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/10047 - 134/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	12/06/2023	
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks			Test Request :	-	
Project Number :	PTP/10047			Page 3 of 3		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/198323	S/198324	S/198325			
Date Tested :	29/05/2023	29/05/2023	29/05/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	11:05	11:10	11:15			
Lot Number :	-	-	-			
Location 1 :	E 499343	E 499337	E 499364			
Location 2 :	N 6931936	N 6931926	N 6931942			
Location 3 :	Finish Level	Finish Level	Finish Level			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/198323	S/198324	S/198325			
MDR Test Date :	1/06/2023	1/06/2023	1/06/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.10	2.11	2.10			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	10.5%	10.5%	11.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.11	2.13	2.11			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	100.5%	101.0%	100.5%			
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		


Particle Size Distribution Report

Client :	Shadforths	Report Number :	SR/PTP/10047 - 136/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	16/06/2023
Project Name :	Everleigh Estate - Precinct 9.4 Earthworks	Test Request :	-
Project Number :	PTP/10047	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.3.6.1, AS1289.2.1.1,
----------------	-----------------------------

Material Description	Sandy GRAVEL trace Clay - Brown
----------------------	---------------------------------

Sample Number :	S/199767	Sampling Method :	AS1289.1.2.1 - cl6.4b
Date Tested :	12/06/2023	Time :	10:39
Material Source :	Onsite	Location 1 :	E 499471
For Use As :	General Fill	Location 2 :	N 6932106
Lot Number :	-	Location 3 :	Depth 0.00m - 0.60m
PSD Specification Number :	N/A	Location 4 :	-

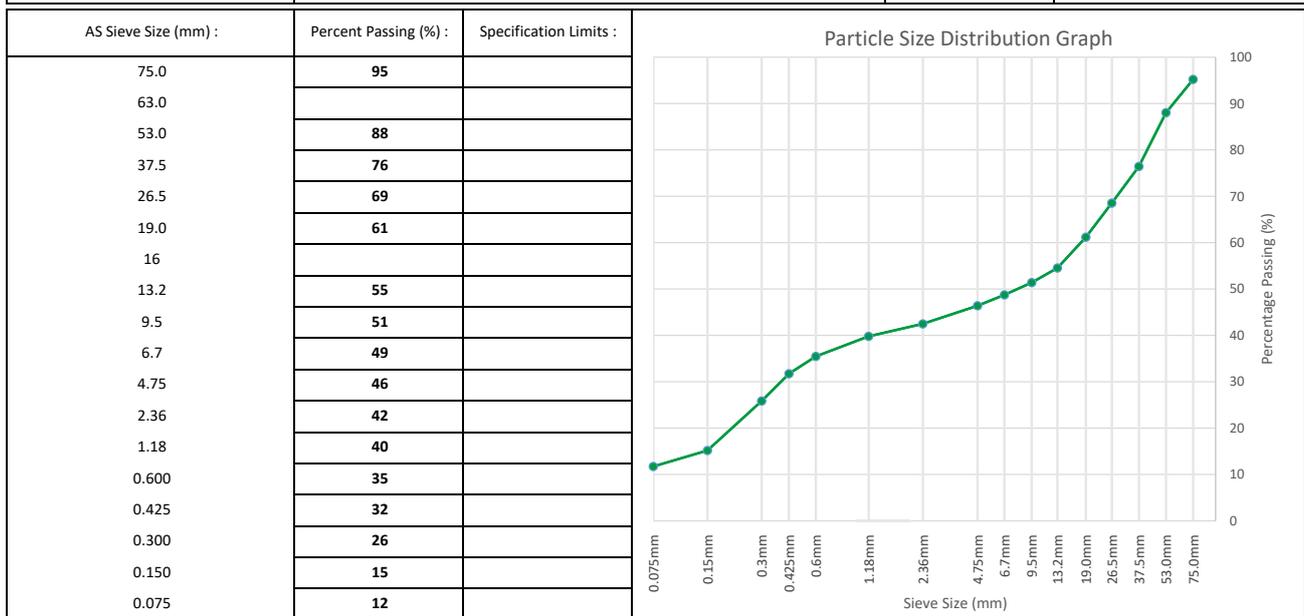

Remarks :	-
-----------	---

 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Joshua Andres - Signatory</p>
---	--