

Prepared for: Shadforth Civil

Level 1 Earthworks Report Everleigh Precinct 8.3, Greenbank

7/01/2025 | PTP/14114 - 0004 - Rev0



REPORT DETAILS

Unique Document Identification

Item	Description
Document Title	Level 1 Earthworks Report
Project Number	PTP/14114
Document ID	PTP/14114 - 0004 - Rev0
Client	Shadforth Civil
Client Contact	Jacob Hines

Protest Office Details

Item	Description
Location	Gold Coast
Address	8/36 Blanck Street, Ormeau, QLD, 4208
Telephone	(07) 5647 0411
Email	admin@protestcmt.com.au
Web	www.protestcmt.com.au


Revision Details

Revision No.	Date	Comments
0	7/01/2025	Final Report Issued

Document Approval

Author

Reviewed By




Gary Taylor
Project Coordinator
Gary.taylor@protestcmt.com.au

Simon Wynne (RPEQ 17390)
Senior Geotechnical Engineer
Simon.wynne@ptgconsulting.com.au

1 INTRODUCTION

This report summarises the results of inspection and testing provided by Protest CMT (Protest) for the bulk earthworks as part of the Everleigh Precinct 8.3 project undertaken between June 2023 and July 2024. The works were undertaken at the request of Shadforth Civil.

The scope of inspection and testing undertaken was in general accordance with AS3798-2007 - 'Guidelines on Earthworks for Commercial and Residential Developments'. As part of the inspection and testing undertaken, Protest provided Level 1 supervision in accordance with Section 8.2 of AS3798-2007. Figure 1 indicates the approximate extent of Level 1 works carried out.



Figure 1: Approximate extent of level 1 works (in red) (Image extracted from Vexcel)

Approximately 28,400 m³ of fill was placed on site. Drawing No. MIR-1010, Sheet C200 (Premise) attached is the bulk earthworks layout plan. The frequency of field density testing adopted for this project was generally based on AS3798-2007, Table 8.1 - 'Frequency of Field Density Tests' with a minimum of one test per 500 m³ placed for a large project type.

Based on the information provided within the notes of Drawing No. MIR-1010, Sheet C210 (Premise), the minimum relative compaction requirements were specified. A summary of the criteria is shown in Table 1.

Table 1: Test Request Compaction and Moisture Content Specification

Fill Type	Dry Density Ratio	Moisture Variation
Residential General Fill	95%	±2% (Dry/Wet of OMC)

(Note: OMC = Optimum Moisture Content)

2 THE BRIEF

The Brief from the Client and relevant documents were limited to:

- » Level One Inspection and Testing of the placement and compaction of fill materials in general accordance with AS3798 2007 – “Guidelines on Earthworks for Commercial and Residential Developments”.
- » Relative Density Control Testing in accordance with AS1289 – Testing of Soils for Engineering Purposes and at frequencies required in AS3798 Table 8.1.
- » Earthworks Notes on drawing MIR-1010-C210-B (Premise).
- » Recommendations in Morrison Geotechnic Pty Ltd report “Recommended Filling Earthworks Specification” report 16520B, dated 25th June 2020.

For the actual constructed fill thickness and extremities on fill placed, a disclosure plan should be requested from the developer.

2.1 Additional Requirements

All fill at the Site was to be constructed in accordance with the Earthworks Specification as shown on Premise Drawing – MIR-1010-C210-B. The earthworks specification is presented as Figure 2 below.

EARTHWORKS SPECIFICATION

SPECIFICATION	DEPTH RANGE (m)				PAVEMENT SUBGRADE	TRENCH BACKFILL
	0.0 - 0.6	0.6 - 3.00	3.00 - 5.00	> 5.00		
CBR %	-	-	-	-	10	15
LAYER THICKNESS (mm)	300	500	300	300	BETWEEN SUBGRADE AND 0.3m BELOW	300
MAXIMUM PARTICLE SIZE (mm)	200	500	500	500	200	200
% PASSING 37.5mm	80% MIN	REFER NOTES AND KEY OUTCOMES	REFER NOTES AND KEY OUTCOMES			
% PASSING 0.075mm	30% MIN	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES	REFER NOTES AND AS3798
COMPACTION	95% STD	95% STD	95% STD	95% STD	100% STD	95% MOD IN ROADS AND 95% STD OUTSIDE ROADS
MOISTURE	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	+/- 2% OMC	60% - 90% OF OMC	+/- 2% OMC
<p>NOTES:</p> <ol style="list-style-type: none"> 1. OMC - OPTIMUM MOISTURE CONTENT 2. LAYER OF THICKNESS IS LIMITED TO 300mm TO ALLOW IDENTIFICATION OF LARGER PARTICLES AND ALLOW EVERY CHANCE OF BREAK DOWN IN FILLING OR REMOVAL. 3. TREATMENT OF ROCK TO SIZES ABOVE SHOULD BE CARRIED OUT IN CUT PRIOR TO LOADING TO FILL AREAS. TREATED ROCK TO BE APPROVED BY GITA PRIOR TO TRANSPORTING. 4. UPPER 0.6m, (PARTICULARLY IN AREAS OF DEEP FILL), OF THE FILL PROFILE TO BE RELATIVELY IMPERMEABLE HENCE INCREASE IN FINES COMPONENT. 5. PROOF ROLL TESTING ON EACH COMPACTED LAYER USING RUBBER WHEELED PLANT SUCH AS LOADED ADT'S OR LOADED SCRAPERS. UNFAVOURABLE DEFORMATION OF THE COMPACTED SURFACE UNDER LOAD OF ADT'S OR SCRAPERS WILL REQUIRE REPAIR PRIOR TO ADDITIONAL PLACEMENT. 6. MECHANICAL INTERLOCK METHODOLOGY IS NOT APPROPRIATE DUE TO POOR DURABILITY OF SITE WON SANDSTONE. FILL COMPOSITION IS REQUIRED TO INCLUDE AN APPROPRIATE SAND GRAVEL AND FINES COMPONENT CONFORMING TO THE REQUIREMENTS OF AS798. <p>KEY OUTCOMES FOR EARTHWORKS OPERATIONS</p> <ol style="list-style-type: none"> 1. DELIVER RESIDENTIAL LOTS WITH FAVOURABLE LOT CLASSIFICATIONS - I.E - NO P CLASSIFICATIONS 2. FILL THICKNESS DOES NOT VARY MORE THAN 2m OVER A DISTANCE OF 10m 3. CONSTRUCT FILL AND LIMIT LONG TERM CREEP SETTLEMENTS TO WITHIN 0.5% TO 1.0% OF THE FILL THICKNESS 4. BUILDING PLATFORM THAT ALLOWS BUILDERS TO CONSTRUCT SLAB ON GROUND RAFTS USING LIGHT EARTHMOVING EQUIPMENT 5. MATERIAL WON FROM CUTS AND USED IN FILL WITH REQUIRE: <ul style="list-style-type: none"> • CUTS IN ROCK AS WELL AS BLENDED WITH • CUTS IN FINER MATERIALS SUCH AS SANDS AND CLAYS 6. CREATING A FILL PLATFORM THAT IS ABLE TO BE TESTED IN ACCORDANCE WITH AS3798 AND AS1289 						

Figure 2: Earthworks Specification

3 EARTHWORKS ACTIVITIES

Earthworks Inspections and Testing was carried out on the stripped and exposed ground surfaces and during the placement and compaction of fill materials.

Field and laboratory testing included walk over assessments of the existing ground conditions, proof roll testing of the stripped surface including the natural surface, observations of filling and compaction activities, field density testing using a soil moisture density gauge and Hilf Density compactions.

3.1 Stripped Surface Assessment

Foundation preparation observed by Protest comprised the removal of topsoil and unsuitable materials across the cut to fill area exposing the underlying natural materials. Proof rolls were performed on the natural soils using large sized trucks carrying out multiple passes and no noticeable movement was observed on the final pass. A photo showing the site during stripping operations is given in Figure 2.



Figure 2: View of the Site during Stripping Operations

3.2 Filling Activities

Following successful proof rolling, filling operations comprised the placement and compaction of material obtained from onsite cuts, which were typically gravelly sandy clay or ripped or blasted sandstone with properties of clayey gravelly sand.

Ripping operations were required to loosen high and very high strength sandstone. Ripped rock was then processed using mechanical crushing plant.

The methodology for the rock crushing operations can be broadly summarised as:

- » Large rock fragments were broken down by an excavator with a hammer attachment to sizes acceptable for the mechanical crushing plant.
- » Mechanical crushing to reduce rock fragments to 200mm size or less.
- » Mixing crushed product with onsite materials using a front-end loader and placed into stockpiles assessed to be suitable for filling and earthworks operations.

Materials were placed onsite in uniform layers not exceeding 300 mm thick, with the plant detailed below. The material used as fill was moisture conditioned at the fill source and during placement and blended to achieve suitable moisture content for compaction.

The following heavy plant were used throughout the bulk earthworks component:

- | | | |
|-------------------|--------------------|----------------------------|
| » Water carts | » Excavators | » Cat 825 compactor |
| » Pad foot roller | » Grader | » Articulated dump truck |
| » Dozers | » Front end loader | » Mechanical rock crushers |

Deleterious materials such as organics, sticks, roots and over size particles were sorted and removed during placement or were rejected for use. Occasional oversize particles including cobbles may be present in the deeper fill profile, however, these are not considered to affect the fill as a mass.

Placement of the fill materials was carried out in layers appropriate for the above plant and compacted using the above plant carrying out multiple passes.

Our representative observed the filling process as described above which was assessed to be consistent for the entire thickness of fill.

Field density tests and laboratory compactions were carried out on the fill materials in accordance with Table 5.1 and 8.1 of AS3798 2007 (Guidelines on Earthworks for Commercial and Residential Developments) and tested to AS1289 test methods (Testing of Soils for Engineering Purposes).

A total of 67 field density tests were undertaken at locations selected by Protest during the filling operations. Field density testing was carried out using a nuclear gauge and in accordance with the test method outlined in AS1289.5.8.1. The relative compaction was then determined by comparing the recorded field density with the laboratory compaction control test (standard compaction) outlined in test method AS1289.5.7.1.

Testing achieved the required specification of 95% of the maximum Hilf Density at the test locations. The individual test reports are attached in Appendix 2 and the approximate test locations are shown on the marked earthworks layout plan in Appendix 1. These test locations and levels were not obtained by survey and therefore should only be considered as approximate. Figures 3 and 4 are photos that were taken during the earthworks and show general filling operations.



Figure 3: View of the Site during construction



Figure 4: View of the Site during construction

4 COMPLIANCE

Our representatives observed the relevant earthworks operations including the stripped surface, fill placement and compaction operations and carried out field density tests and laboratory compaction tests in accordance with the required standards (AS3798, AS1289). Testing achieved the required specification of 95% Standard Maximum Dry Density (SMDD) at the test locations.

Level One Inspection and Testing has been carried out on the filling operation at the Site (limited to the extent shown in Figure 1). Based on the observations made by our Geo-technicians and the results of the field and laboratory tests, the placed and compacted fill at the above project has, as far as we have been able to assess, been constructed in general accordance with the intent of AS3798-2007 - *'Guidelines on Earthworks for Commercial and Residential Developments'*.

The fill can be deemed to be 'controlled' in accordance with AS2870-2011 Residential Slabs and Footings.

5 COMMENTS

Protest believes consideration should be given to the following:

- » This report only certifies the bulk earthworks activities supervised by Protest between June 2023 and July 2024. Protest does not take responsibility for any other bulk earthworks activities that have occurred before or after these dates.
- » The installation of services or any activities that may cause disturbance of the compacted filling
- » The suitability of the filled land to support the proposed structures
- » Any variation in filling depth or extent of areas that is not noted within this report or on the individual test report sheets

6 LIMITATIONS

Protest CMT ("Protest") has prepared this report for the bulk earthworks at Everleigh Precinct 8.3, Greenbank. This report was produced for the sole use of Shadforth Civil. This Report should not be used or relied upon for any other purpose without Protest's prior written consent. Protest does not accept any responsibility or liability in any way whatsoever for the use or reliance of this Report by anyone other than the Client, its designers, its clients, and relevant statutory authorities or by anyone else for any purpose other than that for which it has been prepared. In the preparation of this report Protest has relied upon information provided by the client and/or their agents.

Assessments of material quality such as soaked CBR and site classifications are excluded from this commission. This report is not to be relied upon for settlement analysis and soft soils engineering advice. This is beyond the scope of this report and outside our engagement.

Our onsite attendance specifically excludes assessments of fill material quality and engineering properties that are outside the requirements of AS3798-2007, including soil or fill reactivity and soaked CBR values. We note that the fill materials used may result in unfavourable site classifications and low subgrade design strengths.

The results provided in this report are indicative of the subsurface conditions on the site only at the specific sampling or testing locations, and then only to the depths investigated along with the time the work was carried out. It is known that subsurface conditions can suddenly change due to irregular geological processes and as a result of human influences. Such changes may occur after Protest field testing has been completed.

Certain ground conditions and the materials behaviour observed or contained at the test locations may alter from those which may be encountered elsewhere on the site. Should variations in subsurface conditions be encountered, then additional advice should be sought from Protest and, if required, amendments made.

Protest cannot be held responsible for interpretations or conclusions made by others unless they are supported by an expressed statement, interpretation, outcome, or conclusion given in this report.

Footings and ground slabs for any structures constructed over natural soils or controlled fill should be designed to accommodate the characteristic ground surface movements and settlement potential. Assessments of these design parameters are beyond the scope of this Report.

The Following should also be considered:

- » This report is not a SITE CLASS REPORT as per AS2870-2011 and not a Geotechnical Site Investigation report as per AS1726-2017;
- » The shrink/swell movements which can occur in the residual silty clays due to weather related natural moisture changes by the reduction in surface evaporation subsequent to covering the site with buildings and pavements. As outlined in AS2870-2011 - '*Residential Slabs and Footings*';
- » It should be noted that there is a possibility that compaction levels may have increased during placement of subsequent layers especially when there have been fully laden earthmoving equipment frequently travel across the fill areas exerting high traffic loads; and
- » All compacted filling is subject to decompaction phenomenon.

Protest does not accept any liability or responsibility whatsoever for, or in respect of, any use or reliance upon this Report by any other party. Protest is not obliged to enter into discussions with any third party in respect of this Report.

We trust that the above information is suitable for your present requirements. Should you have any queries, please do not hesitate to contact this office.


- Appendices:
- A. Site Plan & Testing Locations.
 - B. Laboratory Test Reports.

01



Appendix A Site Plan & Testing Locations



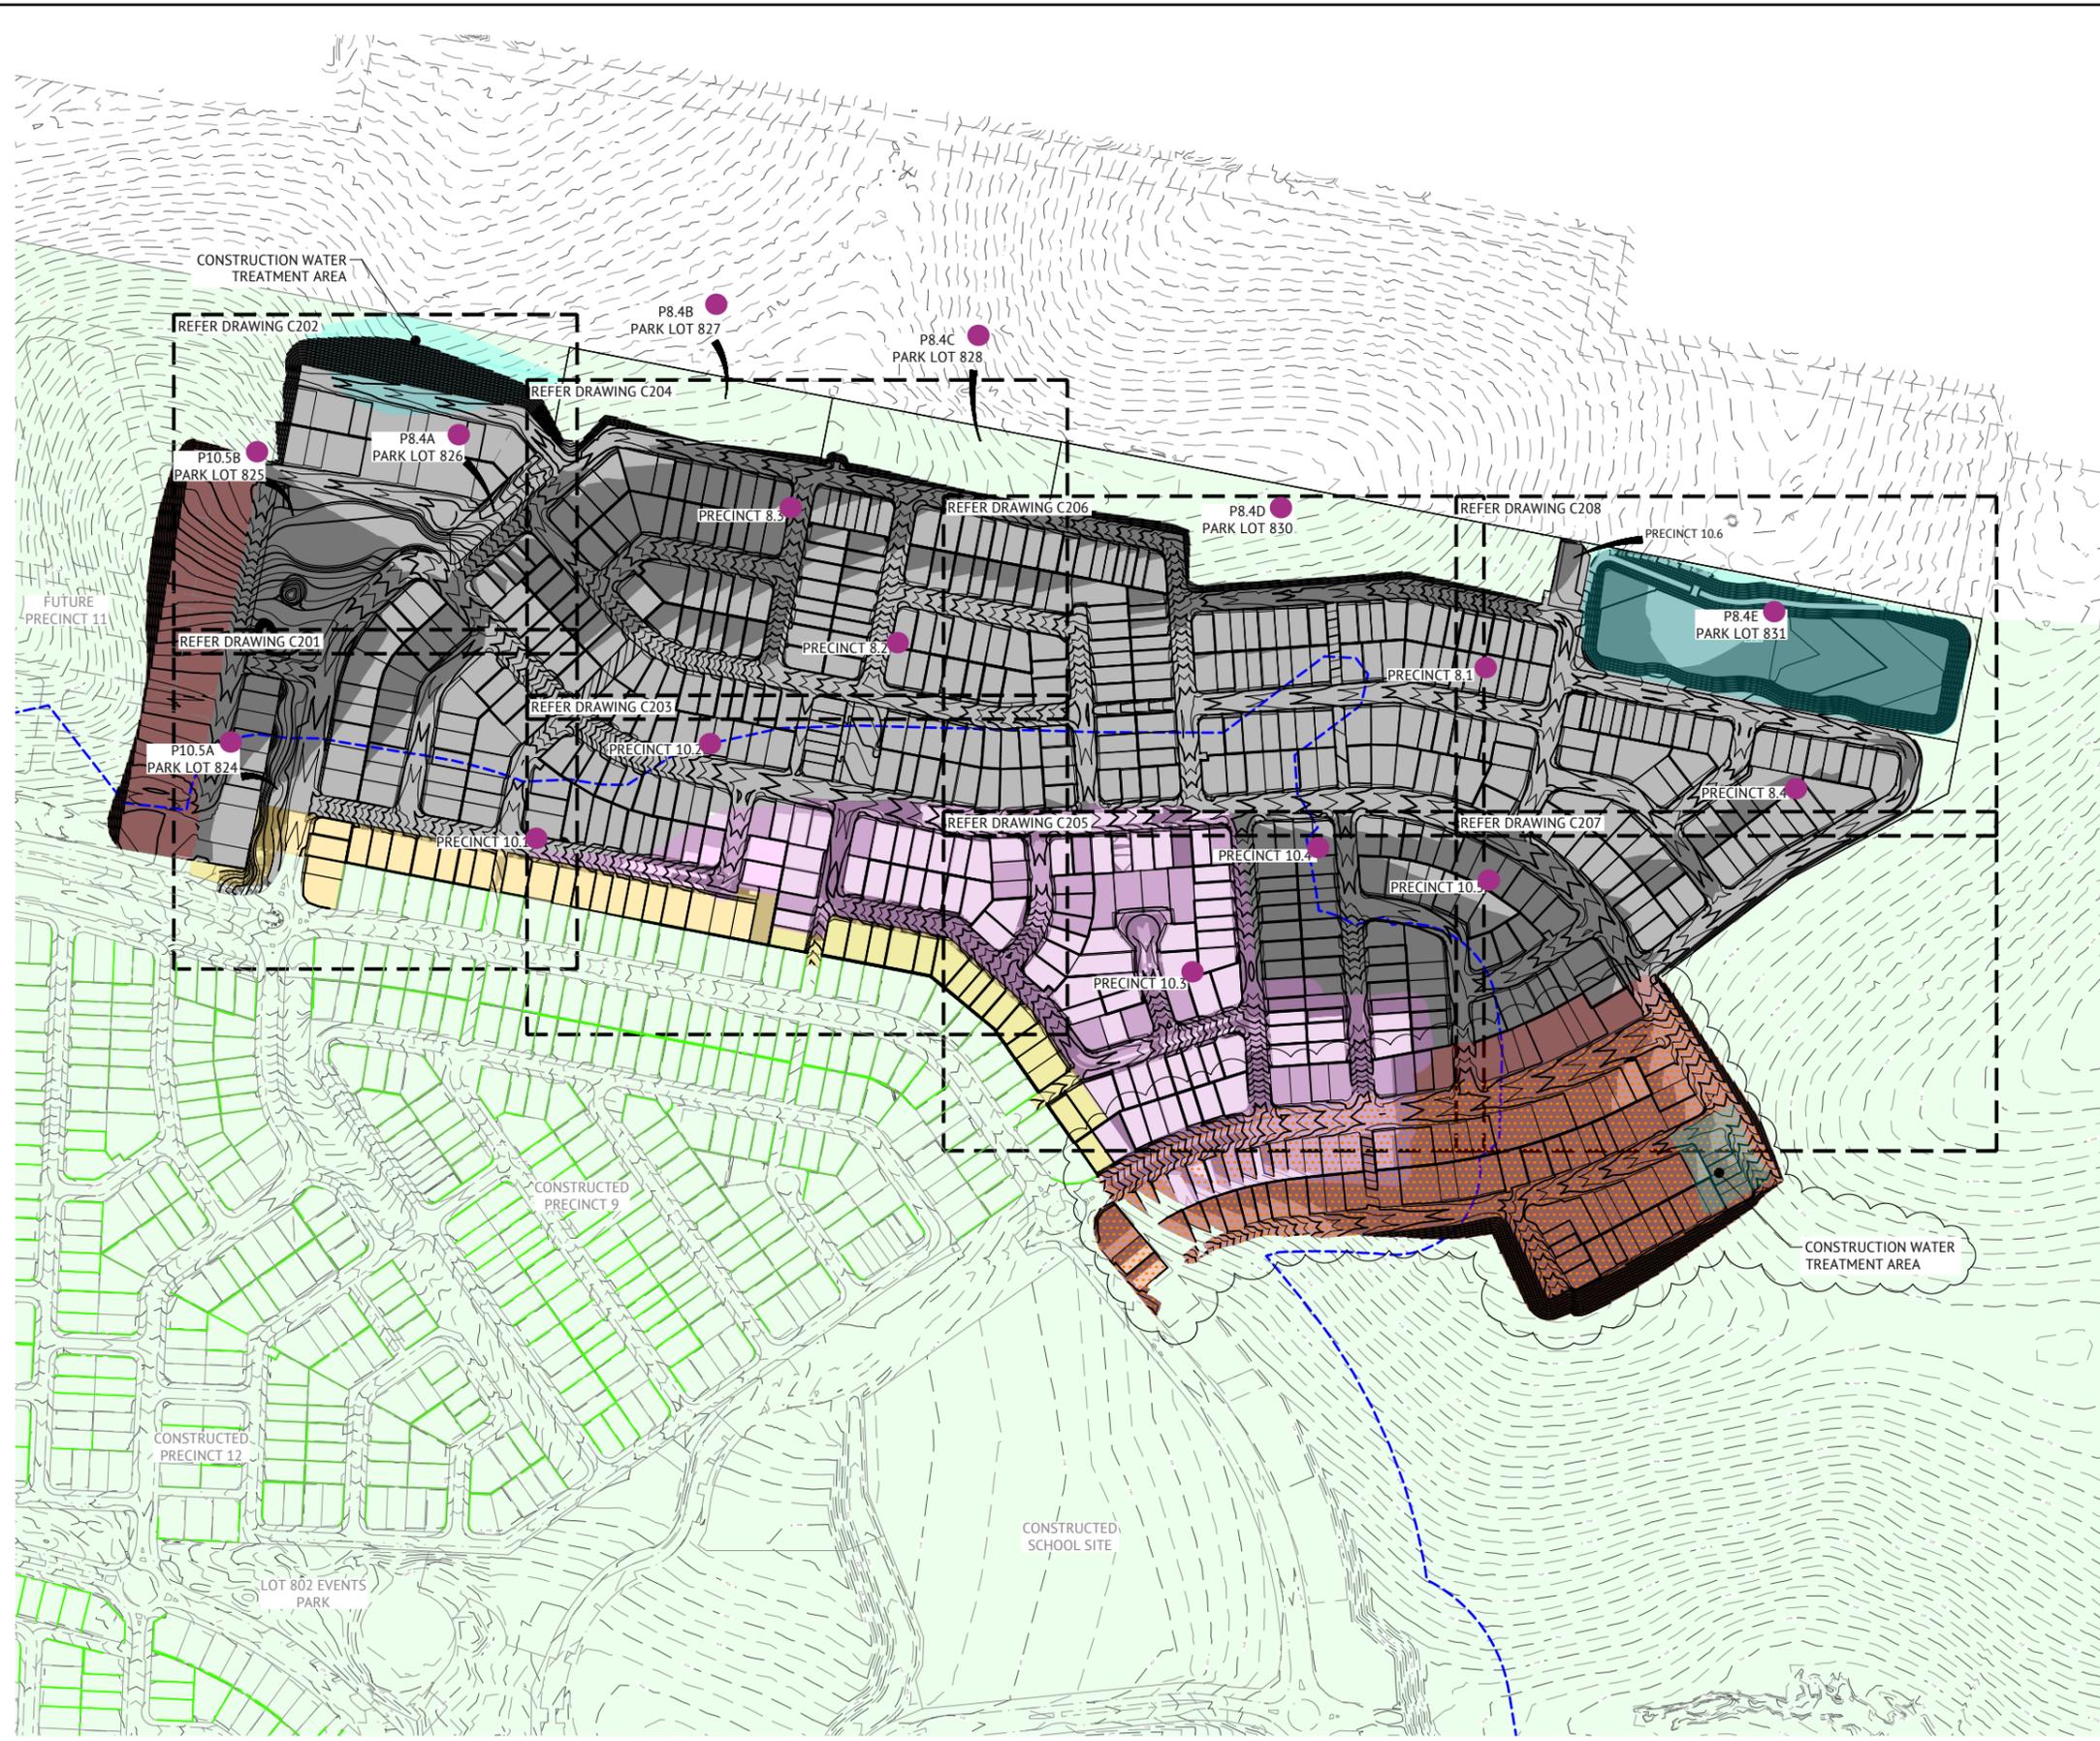

LEGEND - PROPOSED

- EXTENT OF CUT
- EXTENT OF FILL
- BORROW AREA. EXTENT MAY VARY AS PER CHANGES TO FUTURE LOT LAYOUT
- BORROW AREA - 1.0m DEEPER THAN FSL WITHIN ROAD RESERVES AND 0.6m DEEPER THAN FSL WITHIN LOT AREAS.
- CONSTRUCTION WATER TREATMENT AREA
- BORROW AREA EXTENT FOR PRECINCT 9 EARTHWORKS.
- 12.0 FINISHED MAJOR CONTOURS (0.50m)
- FINISHED MINOR CONTOURS (0.25m)
- VEGETATION CLEARING LINE
- PRECINCT BOUNDARY

LEGEND - EXISTING

- EARTHWORKS COMPLETED AS PART OF PRECINCT 9. REFER TO APPROVED DRAWINGS DEV2020/1160 DATED 26 AUGUST 2021
- 12.0 EXISTING CONTOURS (0.50m)
- RETAINING WALL
- EXISTING VEGETATION CLEARING LINE


FOR CONSTRUCTION

DATE	REV	DESCRIPTION	REC	APP
05/02/2024	C	UPDATED BORROW AREA AND LEGEND	KK	PB
06/06/2023	B	UPDATED EARTHWORKS	KK	PB
05/12/2022	A	ORIGINAL ISSUE	KK	PB



BRISBANE OFFICE
 LEVEL 11, 300 ADELAIDE STREET
 BRISBANE, QLD 4000
 PH: (07) 3253 2222
 WEB: www.premise.com.au

DESIGNED
KLYNT KIWANG
 CHECKED
ANDREW LANGDON
 PROJECT MANAGER
NICK SOMERVILLE
 PROJECT DIRECTOR
PKB
PATRICK BRADY RPEQ 7112




CLIENT
MIRVAC QLD PTY LTD

PROJECT
EVERLEIGH PRECINCTS 8 & 10 BULK EARTHWORKS

LOCATION
TEVIOT ROAD, GREENBANK

SHEET TITLE
OVERALL EARTHWORKS LAYOUT PLAN

JOB CODE MIR-1010	
SHEET NUMBER C200	REV C

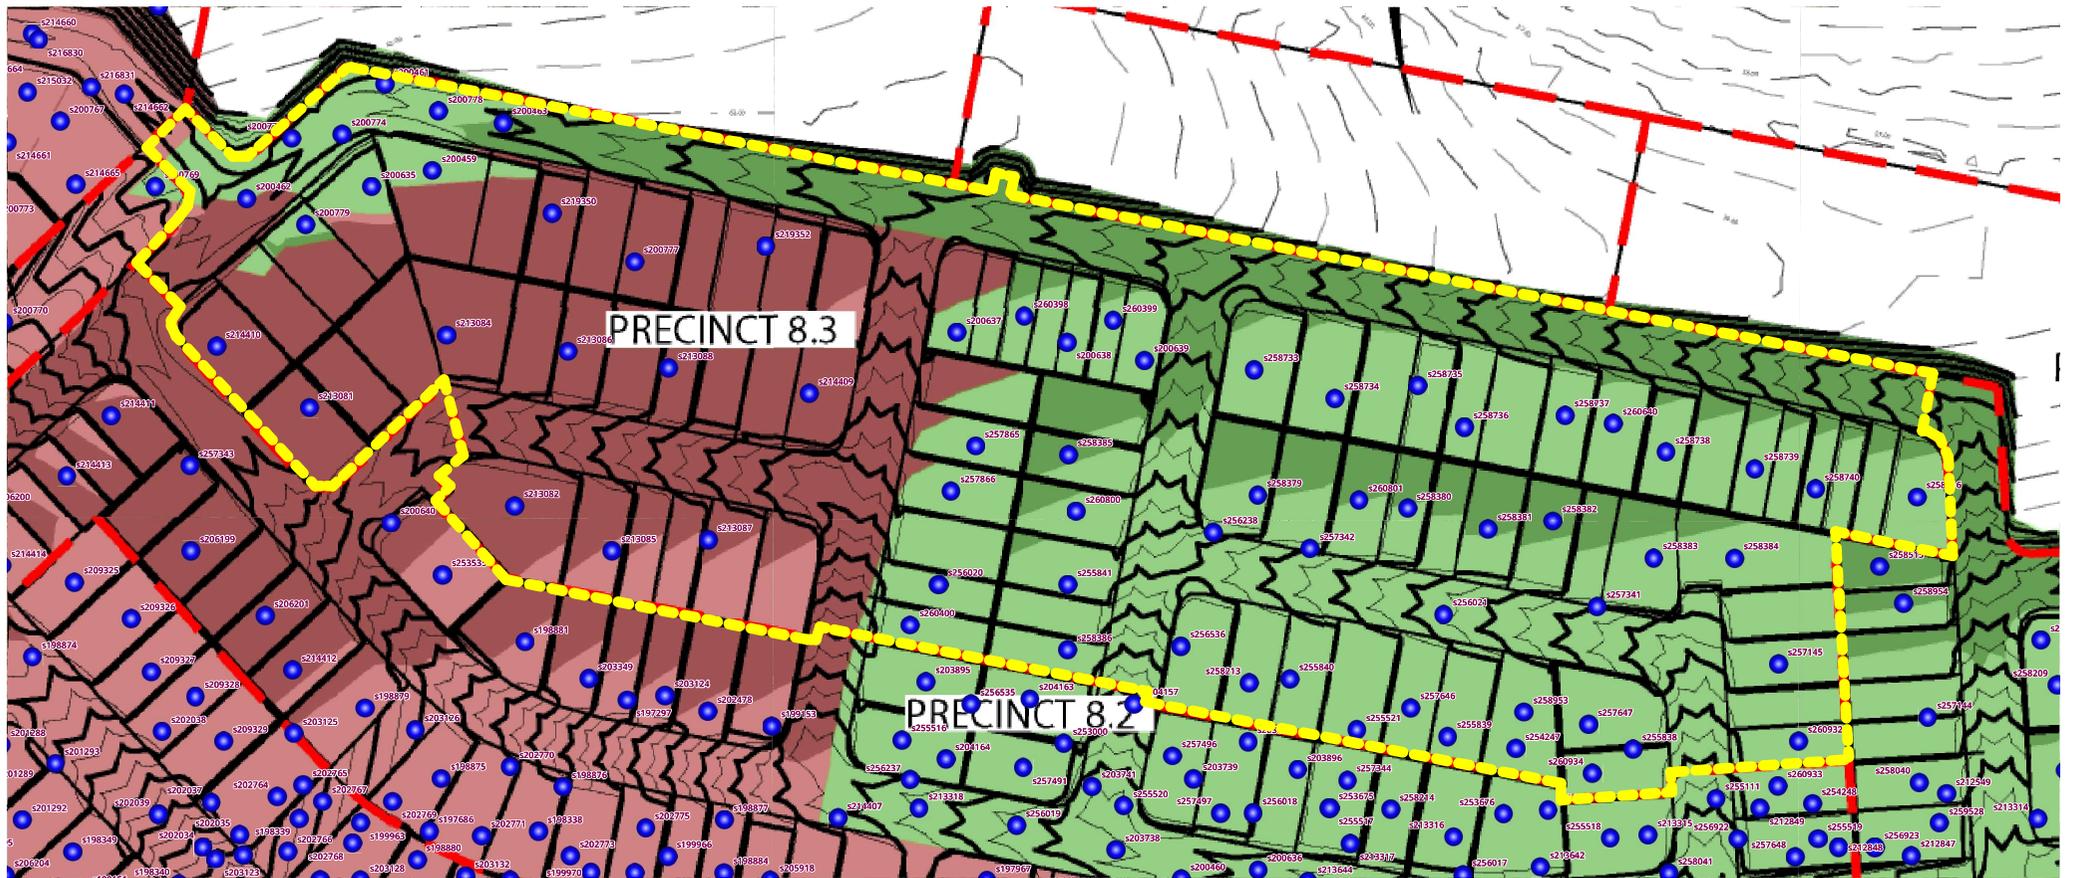

EVERLEIGH PRECINCT 8.3 - LEVEL 1 TESTS

02

Appendix B Laboratory Test Reports



Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 23/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	22/06/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 1 of 3		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/200457	S/200458	S/200459	S/200460	S/200461	S/200462
Date Tested :	9/06/2023	9/06/2023	9/06/2023	9/06/2023	9/06/2023	9/06/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	09:40	09:50	10:00	10:10	10:20	10:30
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499222	E 499239	E 499261	E 499283	E 499263	E 499235
Location 2 :	N 6932489	N 6932494	N 6932487	N 6932504	N 6932524	N 6932536
Location 3 :	RL 63.20	RL 63.12	RL 63.19	RL 63.22	RL 63.29	RL 63.18
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/200457	S/200458	S/200459	S/200460	S/200461	S/200462
MDR Test Date :	13/06/2023	13/06/2023	13/06/2023	13/06/2023	13/06/2023	13/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.06	2.08	2.08	2.08	2.13	2.04
Moisture Variation :	0.5%	0.0%	0.5%	0.5%	0.5%	0.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	14.5%	15.5%	14.0%	14.5%	14.5%	15.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	0.5% Dry of OMC	0.0% Wet of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.0% Wet of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.01	2.03	2.02	2.01	2.05	2.03
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	97.5%	97.5%	97.5%	96.5%	96.5%	99.5%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 23/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	22/06/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 2 of 3		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/200463	S/200464	S/200465	S/200466	S/200467	S/200468
Date Tested :	9/06/2023	9/06/2023	9/06/2023	9/06/2023	9/06/2023	9/06/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:40	10:50	11:00	11:10	11:20	11:30
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499222	E 499063	E 499095	E 499038	E 499041	E 499042
Location 2 :	N 6932530	N 6932272	N 6932288	N 6932296	N 6932290	N 6932281
Location 3 :	RL 63.21	RL 65.90	RL 65.97	RL 66.12	RL 66.04	RL 66.10
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/200463	S/200464	S/200465	S/200466	S/200467	S/200468
MDR Test Date :	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.06	2.06	2.06	2.07	2.15	2.15
Moisture Variation :	0.5%	0.0%	0.5%	0.5%	0.5%	0.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	15.0%	16.0%	14.0%	14.5%	14.5%	14.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	0.5% Dry of OMC	0.0% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.04	2.01	2.03	2.04	2.07	2.06
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	99.0%	97.5%	98.5%	98.5%	96.5%	95.5%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 23/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	22/06/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 3 of 3		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/200469	S/200470	S/200471			
Date Tested :	9/06/2023	9/06/2023	9/06/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	11:40	11:50	12:00			
Lot Number :	-	-	-			
Location 1 :	E 499043	E 499060	E 499078			
Location 2 :	N 6932323	N 6932341	N 6932344			
Location 3 :	RL 66.09	RL 66.17	RL 66.12			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/200469	S/200470	S/200471			
MDR Test Date :	14/06/2023	14/06/2023	14/06/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Gravelly CLAY - Light Brown	Sandy Gravelly CLAY - Light Brown	Sandy Gravelly CLAY - Light Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.11	2.12	2.15			
Moisture Variation :	0.5%	0.5%	0.5%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	15.0%	14.5%	14.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	0.5% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.07	2.06	2.05			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	98.5%	97.0%	95.5%			
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 26/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	22/06/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 1 of 1		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/200635	S/200636	S/200637	S/200638	S/200639	S/200640
Date Tested :	12/06/2023	12/06/2023	12/06/2023	12/06/2023	12/06/2023	12/06/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:00	10:15	10:30	10:45	11:00	11:15
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499197	E 499238	E 499282	E 499331	E 499456	E 499310
Location 2 :	N 6932493	N 6932493	N 6932487	N 6932477	N 6932488	N 6932495
Location 3 :	RL 63.3	RL 63.3	RL 63.3	RL 62.9	RL 62.9	RL 62.9
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/200635	S/200636	S/200637	S/200638	S/200639	S/200640
MDR Test Date :	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown	Clayey SAND - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.09	2.08	2.08	2.09	2.07	2.09
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	8.0%	8.0%	8.0%	8.0%	8.0%	7.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.00	2.00	2.02	2.01	2.02	2.02
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	96.0%	96.0%	97.0%	96.0%	97.5%	96.5%
Remarks :						
 <p>Accredited for Compliance with ISO / IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 28/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	22/06/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 1 of 2		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/200767	S/200769	S/200770	S/200771	S/200772	S/200773
Date Tested :	13/06/2023	13/06/2023	13/06/2023	13/06/2023	13/06/2023	13/06/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:30	10:40	10:50	11:00	11:10	11:20
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499203	E 499204	E 499283	E 499282	E 499259	E 499235
Location 2 :	N 6932548	N 6932536	N 6932535	N 6932497	N 6932520	N 6932527
Location 3 :	RL 63.40	RL 63.44	RL 63.37	RL 63.41	RL 63.46	RL 63.40
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/200767	S/200769	S/200770	S/200771	S/200772	S/200773
MDR Test Date :	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.13	2.13	2.13	2.12	2.13	2.12
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	10.5%	12.0%	11.5%	11.0%	11.5%	11.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.11	2.13	2.12	2.11	2.13	2.11
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	98.5%	100.0%	99.5%	99.5%	100.0%	99.5%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth 99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Number :	SR/PTP/11755 - 28/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	22/06/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 2 of 2		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/200774	S/200775	S/200776	S/200777	S/200778	S/200779
Date Tested :	13/06/2023	13/06/2023	13/06/2023	13/06/2023	13/06/2023	13/06/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175	150 / 175
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	11:30	11:40	11:50	12:00	12:10	12:20
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499204	E 499185	E 499258	E 499238	E 499222	E 499200
Location 2 :	N 6932504	N 6932509	N 6932512	N 6932517	N 6932515	N 6932528
Location 3 :	RL 63.44	RL 63.49	RL 63.50	RL 63.48	RL 63.39	RL 63.45
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	0%	0%	0%	0%	0%	0%
Oversize Density - Dry (t/m ³) :	-	-	-	-	-	-
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/200774	S/200775	S/200776	S/200777	S/200778	S/200779
MDR Test Date :	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023	15/06/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown	Sandy CLAY - Brown
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.12	2.15	2.16	2.11	2.17	2.10
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	-	-	-	-	-	-
ADJ Moisture Variation :	-	-	-	-	-	-
<i>Moisture Test Results :</i>						
Field Moisture Content :	12.0%	11.5%	11.0%	12.0%	11.0%	12.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.12	2.13	2.13	2.11	2.16	2.10
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	100.0%	99.5%	99.0%	100.0%	99.5%	100.0%
Remarks :						
 <p>Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/11755 - 68/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	25/08/2023
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1	Test Request :	-
Project Number :	PTP/11755	Page 1 of 2	
Location :	Lyons		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,
----------------	---

Sample Number :	S/213081	S/213082	S/213083	S/213084	S/213085	S/213086
Date Tested :	17/08/2023	17/08/2023	17/08/2023	17/08/2023	17/08/2023	17/08/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill					
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200

Sampling Method :	AS1289.1.2.1 - cl6.4b					
Time :	10:15	10:25	10:35	10:45	10:55	11:05
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499187	E 499190	E 499204	E 499221	E 499237	E 499251
Location 2 :	N 6932434	N 6932444	N 6932448	N 6932452	N 6932450	N 6932448
Location 3 :	Finish Level	0.3m Below Finish Level				
Location 4 :	-	-	-	-	-	-

Test Fraction (mm) :	< 19mm					
Override Wet :	20%	18%	10%	17%	20%	13%
Override Density - Dry (t/m ³) :	2.39	2.25	2.26	2.39	2.36	2.23
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/213081	S/213082	S/213083	S/213084	S/213085	S/213086
MDR Test Date :	24/08/2023	24/08/2023	24/08/2023	24/08/2023	24/08/2023	24/08/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Sandy CLAY - Brown					

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.19	2.19	2.17	2.18	2.19	2.17
Moisture Variation :	0.0%	0.0%	0.5%	0.5%	0.0%	0.5%
ADJ PCWD (t/m ³) :	2.22	2.20	2.18	2.21	2.22	2.18
ADJ Moisture Variation :	0.0%	0.0%	0.5%	0.5%	0.0%	0.5%

<i>Moisture Test Results :</i>						
Field Moisture Content :	6.5%	7.0%	9.0%	8.5%	9.0%	8.0%
Moisture Specification :	+/-2.0% of OMC					
Variation from OMC :	0.0% Dry of OMC	0.0% Dry of OMC	0.5% Dry of OMC	0.5% Dry of OMC	0.0% Dry of OMC	0.5% Dry of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.20	2.21	2.19	2.20	2.21	2.18
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	99.0%	100.5%	100.5%	99.5%	99.5%	100.0%

Remarks :	
-----------	--

 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>
--	--

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/11755 - 68/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	25/08/2023		
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1		Test Request :	-		
Project Number :	PTP/11755		Page 2 of 2			
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/213087	S/213088				
Date Tested :	17/08/2023	17/08/2023				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	175 / 200	175 / 200				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	11:15	11:25				
Lot Number :	-	-				
Location 1 :	E 499264	E 499276				
Location 2 :	N 6932447	N 6932444				
Location 3 :	0.3m Below Finish Level	0.3m Below Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	19%	19%				
Oversize Density - Dry (t/m ³) :	2.30	2.36				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/213087	S/213088				
MDR Test Date :	24/08/2023	24/08/2023				
Compaction Type :	Standard	Standard				
Soil Description :	Gravelly SAND Clay - Brown	Gravelly SAND Clay - Brown				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.15	2.13				
Moisture Variation :	0.0%	2.0%				
ADJ PCWD (t/m ³) :	2.18	2.17				
ADJ Moisture Variation :	0.0%	1.5%				
<i>Moisture Test Results :</i>						
Field Moisture Content :	7.5%	7.0%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	0.0% Dry of OMC	1.5% Dry of OMC				
Relative Moisture Ratio (Q250) :	-	-				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.19	2.20				
Density Specification :	95%	95%				
Wet Density Ratio :	100.5%	101.5%				
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>			<p>APPROVED SIGNATORY</p>  Nick Dobson - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 73/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	11/09/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 1 of 2		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/214407	S/214408	S/214409	S/214410	S/214411	S/214412
Date Tested :	24/08/2023	24/08/2023	24/08/2023	24/08/2023	24/08/2023	24/08/2023
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	10:45	10:50	10:55	11:00	11:05	11:10
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499200	E 499192	E 499176	E 499164	E 499138	E 499135
Location 2 :	N 6932481	N 6932466	N 6932460	N 6932449	N 6932432	N 6932420
Location 3 :	0.3m Below Finish Level	0.3m Below Finish Level	Finish Level	Finish Level	Finish Level	Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 37.5mm	< 37.5mm	< 37.5mm	< 19mm	< 37.5mm
Oversize Wet :	20%	13%	17%	20%	20%	14%
Oversize Density - Dry (t/m ³) :	2.23	2.35	2.30	2.09	1.89	2.37
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/214407	S/214408	S/214409	S/214410	S/214411	S/214412
MDR Test Date :	6/09/2023	6/09/2023	6/09/2023	6/09/2023	6/09/2023	6/09/2023
Compaction Type :	Standard	Standard	Standard	Standard	Standard	Standard
Soil Description :	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown	Gravelly Sandy CLAY - Brown
MDR Test Results						
PCWD (t/m ³) :	2.20	2.21	2.21	2.21	2.21	2.20
Moisture Variation :	0.5%	-2.0%	-2.0%	-1.5%	0.0%	-2.0%
ADJ PCWD (t/m ³) :	2.20	2.23	2.22	2.18	2.14	2.22
ADJ Moisture Variation :	0.5%	-2.0%	-1.5%	-1.5%	0.0%	-1.5%
Moisture Test Results :						
Field Moisture Content :	7.0%	10.5%	10.0%	9.0%	9.0%	12.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	0.5% Dry of OMC	2.0% Wet of OMC	1.5% Wet of OMC	1.5% Wet of OMC	0.0% Dry of OMC	1.5% Wet of OMC
Relative Moisture Ratio (Q250) :	-	-	-	-	-	-
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.22	2.19	2.20	2.19	2.20	2.21
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	101.0%	98.5%	99.0%	100.0%	102.5%	99.5%
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY  Nick Dobson - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/11755 - 73/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	11/09/2023		
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1		Test Request :	-		
Project Number :	PTP/11755		Page 2 of 2			
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/214413	S/214414				
Date Tested :	24/08/2023	24/08/2023				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	175 / 200	175 / 200				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	11:15	11:20				
Lot Number :	-	-				
Location 1 :	E 499127	E 499111				
Location 2 :	N 6932417	N 6932395				
Location 3 :	Finish Level	Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	0%	0%				
Oversize Density - Dry (t/m ³) :	-	-				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/214413	S/214414				
MDR Test Date :	29/08/2023	29/08/2023				
Compaction Type :	Standard	Standard				
Soil Description :	Sandy Graelly CLAY - Brown	Sandy Graelly CLAY - Brown				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.14	2.15				
Moisture Variation :	2.0%	1.5%				
ADJ PCWD (t/m ³) :	-	-				
ADJ Moisture Variation :	-	-				
<i>Moisture Test Results :</i>						
Field Moisture Content :	12.0%	12.5%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC				
Relative Moisture Ratio (Q250) :	-	-				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.19	2.19				
Density Specification :	95%	95%				
Wet Density Ratio :	102.5%	102.0%				
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>	APPROVED SIGNATORY					
	 Nick Dobson - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/11755 - 81/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	25/09/2023	
Project Name :	Everleigh Precinct 8 and 10 BEW - LV1			Test Request :	-	
Project Number :	PTP/11755			Page 1 of 1		
Location :	Lyons					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/219350	S/219351	S/219352			
Date Tested :	19/09/2023	19/09/2023	19/09/2023			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	09:40	09:50	10:00			
Lot Number :	-	-	-			
Location 1 :	E 499247	E 499270	E 499300			
Location 2 :	N 6932482	N 6932465	N 6932474			
Location 3 :	0.3m Below Finish Level	0.3m Below Finish Level	0.3m Below Finish Level			
Location 4 :	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/219350	S/219351	S/219352			
MDR Test Date :	25/09/2023	25/09/2023	25/09/2023			
Compaction Type :	Standard	Standard	Standard			
Soil Description :	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown	Sandy Gravelly CLAY - Brown			
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.20	2.20	2.19			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			
<i>Moisture Test Results :</i>						
Field Moisture Content :	-	-	-			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Relative Moisture Ratio (Q250) :	-	-	-			
Moisture Ratio :	N/A	N/A	N/A			
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.19	2.19	2.20			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	99.5%	99.5%	100.5%			
Remarks :						
 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, ORMEAU, QLD 4208</p>				<p>APPROVED SIGNATORY</p>  <p>Nick Dobson - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 9/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	10/06/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
----------------	---	--	--	--	--	--

Sample Number :	S/254247	S/254248	S/254260			
Date Tested :	31/05/2024	31/05/2024	31/05/2024			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	150 / 175	150 / 175	150 / 175			

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	07:25	07:30	07:45			
Lot Number :	-	-	-			
Location 1 :	E 499486	E 499552	E 499858			
Location 2 :	N 6932351	N 6932339	N 6932292			
Location 3 :	RL 51.63	RL 51.60	RL 45.05			
Location 4 :	-	-	-			

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/254247	S/254248	S/254260			
MDR Test Date :	4/06/2024	3/06/2024	4/06/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	Sandy Gravelly CLAY	Sandy Gravelly CLAY	Sandy Gravelly CLAY			

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.16	2.18	2.17			
Moisture Variation :	0.0%	-0.5%	0.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			

<i>Moisture Test Results :</i>						
Field Moisture Content :	11.5%	13.0%	11.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	0.0% Dry of OMC	0.5% Wet of OMC	0.0% Dry of OMC			
Moisture Ratio :	N/A	N/A	N/A			

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.16	2.14	2.14			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	100.0%	98.0%	99.0%			

Remarks :						
-----------	--	--	--	--	--	--

 <p>WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Darra) Accreditation Number - 2851</p> <p>Base Laboratory Site Number - 2844 - Darra</p>	<p>APPROVED SIGNATORY</p>  <p>Timothy Watson - Signatory</p>
	<p>Base Laboratory Address - 1-2/35 Limestone Street, Darra, 4076, QLD</p>	

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth					Report Number :	SR/PTP/14114 - 13/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD					Report Date :	20/06/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1					Test Request :	-
Project Number :	PTP/14114					Page 1 of 1	
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/255516	S/255517	S/255518	S/255519	S/255520	S/255521	
Date Tested :	7/06/2024	7/06/2024	7/06/2024	7/06/2024	7/06/2024	7/06/2024	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	07:15	07:20	07:25	07:30	07:35	07:40	
Lot Number :	-	-	-	-	-	-	
Location 1 :	E 499334	E 499440	E 499509	E 499561	E 499389	E 499447	
Location 2 :	N 6932353	N 6932336	N 6932329	N 6932329	N 6932337	N 6932356	
Location 3 :	1.6m Below Finish Level	1.5m Below Finish Level	1.8m Below Finish Level	1.6m Below Finish Level	1.4m Below Finish Level	1.6m Below Finish Level	
Location 4 :	-	-	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	0%	10%	4%	0%	0%	0%	
Oversize Density - Dry (t/m ³) :	-	2.50	2.68	-	-	-	
Assigned MDR (Yes/No) :	No	No	No	No	No	No	
MDR Sample Number :	S/255516	S/255517	S/255518	S/255519	S/255520	S/255521	
MDR Test Date :	14/06/2024	14/06/2024	14/06/2024	14/06/2024	14/06/2024	14/06/2024	
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	
Soil Description :	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	
MDR Test Results							
PCWD (t/m ³) :	2.06	2.00	2.07	2.17	2.12	2.13	
Moisture Variation :	2.0%	2.0%	2.0%	1.5%	2.0%	1.5%	
ADJ PCWD (t/m ³) :	-	2.04	2.09	-	-	-	
ADJ Moisture Variation :	-	2.0%	2.0%	-	-	-	
Moisture Test Results							
Field Moisture Content :	9.5%	8.5%	8.5%	9.5%	9.5%	10.0%	
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A	
Density Test Results							
Field Wet Density (t/m ³) :	2.08	2.05	2.12	2.17	2.15	2.13	
Density Specification :	95%	95%	95%	95%	95%	95%	
Wet Density Ratio :	101.0%	100.5%	101.5%	100.0%	101.0%	100.0%	
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth					Report Number :	SR/PTP/14114 - 15/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD					Report Date :	20/06/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1					Test Request :	-
Project Number :	PTP/14114					Page 1 of 1	
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/255836	S/255837	S/255838	S/255839	S/255840	S/255841	
Date Tested :	10/06/2024	10/06/2024	10/06/2024	10/06/2024	10/06/2024	10/06/2024	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	07:45	07:50	08:00	08:05	08:10	08:15	
Lot Number :	-	-	-	-	-	-	
Location 1 :	E 499932	E 499936	E 499515	E 499469	E 499430	E 499375	
Location 2 :	N 6932297	N 6932327	N 6932351	N 6932354	N 6932368	N 6932391	
Location 3 :	2.2m Below Finish Level	2.1m Below Finish Level	1.4m Below Finish Level	1.1m Below Finish Level	1.3m Below Finish Level	0.9m Below Finish Level	
Location 4 :	-	-	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	1%	3%	1%	1%	7%	5%	
Oversize Density - Dry (t/m ³) :	2.56	2.47	2.16	2.31	2.44	2.15	
Assigned MDR (Yes/No) :	No	No	No	No	No	No	
MDR Sample Number :	S/255836	S/255837	S/255838	S/255839	S/255840	S/255841	
MDR Test Date :	17/06/2024	17/06/2024	17/06/2024	17/06/2024	17/06/2024	17/06/2024	
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	
Soil Description :	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	
MDR Test Results							
PCWD (t/m ³) :	2.14	2.14	2.13	2.09	2.09	2.09	
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%	
ADJ PCWD (t/m ³) :	2.14	2.14	2.13	2.09	2.11	2.09	
ADJ Moisture Variation :	1.5%	1.5%	2.0%	2.0%	2.0%	2.0%	
Moisture Test Results :							
Field Moisture Content :	8.5%	8.5%	8.0%	7.5%	7.5%	8.0%	
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC				
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A	
Density Test Results							
Field Wet Density (t/m ³) :	2.15	2.14	2.13	2.13	2.15	2.13	
Density Specification :	95%	95%	95%	95%	95%	95%	
Wet Density Ratio :	100.5%	99.5%	100.0%	101.5%	101.5%	102.0%	
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/14114 - 17/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	20/06/2024		
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1		Test Request :	-		
Project Number :	PTP/14114		Page 1 of 1			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/256020	S/256021				
Date Tested :	11/06/2024	11/06/2024				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	175 / 200	175 / 200				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	07:25	07:30				
Lot Number :	-	-				
Location 1 :	E 499343	E 499468				
Location 2 :	N 6932391	N 6932384				
Location 3 :	0.7m Below Finish Level	0.9m Below Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 37.5mm	< 37.5mm				
Oversize Wet :	19%	13%				
Oversize Density - Dry (t/m ³) :	2.34	2.24				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/256020	S/256021				
MDR Test Date :	20/06/2024	20/06/2024				
Compaction Type :	HILF-STD	HILF-STD				
Soil Description :	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist				
MDR Test Results						
PCWD (t/m ³) :	2.15	2.15				
Moisture Variation :	2.0%	2.0%				
ADJ PCWD (t/m ³) :	2.18	2.16				
ADJ Moisture Variation :	2.0%	2.0%				
Moisture Test Results :						
Field Moisture Content :	8.0%	8.5%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC				
Moisture Ratio :	N/A	N/A				
Density Test Results						
Field Wet Density (t/m ³) :	2.21	2.20				
Density Specification :	95%	95%				
Wet Density Ratio :	101.0%	101.5%				
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>			<p>APPROVED SIGNATORY</p>  Joshua Andres - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth					Report Number :	SR/PTP/14114 - 18/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD					Report Date :	21/06/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1					Test Request :	-
Project Number :	PTP/14114					Page 1 of 1	
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/256233	S/256234	S/256235	S/256236	S/256237	S/256238	
Date Tested :	12/06/2024	12/06/2024	12/06/2024	12/06/2024	12/06/2024	12/06/2024	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	06:45	06:50	06:55	07:00	07:05	07:10	
Lot Number :	-	-	-	-	-	-	
Location 1 :	E 499882	E 499937	E 499834	E 499510	E 499336	E 499411	
Location 2 :	N 6932329	N 6932267	N 6932261	N 6932325	N 6932343	N 6932404	
Location 3 :	1.8m Below Finish Level	1.9m Below Finish Level	1.7m Below Finish Level	0.5m Below Finish Level	0.7m Below Finish Level	0.4m Below Finish Level	
Location 4 :	-	-	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	2%	0%	2%	0%	0%	0%	
Oversize Density - Dry (t/m ³) :	2.94	-	2.85	-	-	-	
Assigned MDR (Yes/No) :	No	No	No	No	No	No	
MDR Sample Number :	S/256233	S/256234	S/256235	S/256236	S/256237	S/256238	
MDR Test Date :	21/06/2024	21/06/2024	21/06/2024	21/06/2024	21/06/2024	21/06/2024	
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	
Soil Description :	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	
MDR Test Results							
PCWD (t/m ³) :	2.11	2.14	2.14	2.18	2.17	2.13	
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	2.0%	2.0%	
ADJ PCWD (t/m ³) :	2.12	-	2.15	-	-	-	
ADJ Moisture Variation :	2.0%	-	2.0%	-	-	-	
Moisture Test Results							
Field Moisture Content :	8.5%	9.5%	8.5%	9.0%	9.0%	8.5%	
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A	
Density Test Results							
Field Wet Density (t/m ³) :	2.17	2.19	2.17	2.22	2.19	2.17	
Density Specification :	95%	95%	95%	95%	95%	95%	
Wet Density Ratio :	102.5%	102.0%	101.0%	102.0%	101.0%	102.0%	
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/14114 - 19/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	21/06/2024	
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1				Test Request :	-	
Project Number :	PTP/14114				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/256533	S/256534	S/256535	S/256536			
Date Tested :	13/06/2024	13/06/2024	13/06/2024	13/06/2024			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	06:50	06:55	07:00	07:05			
Lot Number :	-	-	-	-			
Location 1 :	E 499880	E 499904	E 499356	E 499403			
Location 2 :	N 6932251	N 6932241	N 6932376	N 6932376			
Location 3 :	1.5m Below Finish Level	1.6m Below Finish Level	0.5m Below Finish Level	0.7m Below Finish Level			
Location 4 :	-	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	6%	3%	2%	2%			
Oversize Density - Dry (t/m ³) :	2.53	2.57	2.86	2.99			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/256533	S/256534	S/256535	S/256536			
MDR Test Date :	21/06/2024	21/06/2024	21/06/2024	21/06/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Sandy CLAY, Low Plasticity, Brown, Moist			
<i>MDR Test Results</i>							
PCWD (t/m ³) :	2.04	2.07	2.08	2.05			
Moisture Variation :	2.0%	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	2.06	2.08	2.09	2.06			
ADJ Moisture Variation :	2.0%	2.0%	2.0%	2.0%			
<i>Moisture Test Results :</i>							
Field Moisture Content :	8.0%	7.5%	8.0%	8.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Moisture Ratio :	N/A	N/A	N/A	N/A			
<i>Density Test Results</i>							
Field Wet Density (t/m ³) :	2.07	2.09	2.09	2.08			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	100.5%	100.5%	100.0%	101.0%			
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory						
	Document Number : RF1 Date : 6/06/2024						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 21/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	23/06/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
----------------	---	--	--	--	--	--

Sample Number :	S/257864	S/257865	S/257866			
Date Tested :	21/06/2024	21/06/2024	21/06/2024			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200			

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	06:50	06:55	07:00			
Lot Number :	-	-	-			
Location 1 :	E 499897	E 499352	E 499346			
Location 2 :	N 6932311	N 6932425	N 6932414			
Location 3 :	0.8m Below Finish Level	0.1m Below Finish Level	Finish Level			
Location 4 :	-	-	-			

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	14%	12%	16%			
Oversize Density - Dry (t/m ³) :	1.96	1.82	1.83			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/257864	S/257865	S/257866			
MDR Test Date :	22/06/2024	22/06/2024	22/06/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	(GM) Clayey Sandy GRAVEL, Medium-Grained, Brown, Moist	(GM) Clayey Sandy GRAVEL, Medium-Grained, Brown, Moist	(GM) Clayey Sandy GRAVEL, Medium-Grained, Brown, Moist			

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.21	2.24	2.24			
Moisture Variation :	2.0%	1.5%	1.5%			
ADJ PCWD (t/m ³) :	2.17	2.18	2.17			
ADJ Moisture Variation :	1.5%	1.5%	1.5%			

<i>Moisture Test Results :</i>						
Field Moisture Content :	9.0%	8.5%	8.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	1.5% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC			
Moisture Ratio :	N/A	N/A	N/A			

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.21	2.20	2.21			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	102.0%	101.0%	102.0%			

Remarks :						
-----------	--	--	--	--	--	--

 <p>WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p>			<p>APPROVED SIGNATORY</p> 		
	<p>Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>			<p>Joshua Andres - Signatory</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/14114 - 22/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	23/06/2024	
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1				Test Request :	-	
Project Number :	PTP/14114				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/257144	S/257145	S/257146	S/257147			
Date Tested :	17/06/2024	17/06/2024	17/06/2024	17/06/2024			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	07:00	07:05	07:10	07:15			
Lot Number :	-	-	-	-			
Location 1 :	E 499588	E 499551	E 499971	E 499940			
Location 2 :	N 6932359	N 6932372	N 6932281	N 6932240			
Location 3 :	0.7m Below Finish Level	0.5m Below Finish Level	1.4m Below Finish Level	1.6m Below Finish Level			
Location 4 :	-	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%	0%			
Oversize Density - Dry (t/m³) :	-	-	-	-			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/257144	S/257145	S/257146	S/257147			
MDR Test Date :	22/06/2024	22/06/2024	22/06/2024	22/06/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	(Cl) Sandy CLAY, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY, Medium Plasticity, Brown, Moist			
MDR Test Results							
PCWD (t/m3) :	2.05	2.03	2.02	2.05			
Moisture Variation :	0.0%	0.0%	0.0%	0.0%			
ADJ PCWD (t/m3) :	-	-	-	-			
ADJ Moisture Variation :	-	-	-	-			
Moisture Test Results							
Field Moisture Content :	18.0%	18.0%	18.5%	17.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	0.0% Wet of OMC	0.0% Wet of OMC	0.0% Wet of OMC	0.0% Wet of OMC			
Moisture Ratio :	N/A	N/A	N/A	N/A			
Density Test Results							
Field Wet Density (t/m3) :	2.00	2.01	2.01	2.02			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	97.5%	99.0%	99.5%	98.5%			
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>				<p>APPROVED SIGNATORY</p>  Joshua Andres - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/14114 - 24/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	23/06/2024	
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1				Test Request :	-	
Project Number :	PTP/14114				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/257341	S/257342	S/257343	S/257344			
Date Tested :	18/06/2024	18/06/2024	18/06/2024	18/06/2024			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	07:00	07:05	07:10	07:15			
Lot Number :	-	-	-	-			
Location 1 :	E 499506	E 499435	E 499452	E 499445			
Location 2 :	N 6932386	N 6932400	N 6932364	N 6932339			
Location 3 :	0.6m Below Finish Level	0.5m Below Finish Level	0.2m Below Finish Level	0.5m Below Finish Level			
Location 4 :	-	-	-	-			
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-	-			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/257341	S/257342	S/257343	S/257344			
MDR Test Date :	22/06/2024	22/06/2024	22/06/2024	22/06/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	(Cl) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist			
MDR Test Results							
PCWD (t/m ³) :	2.05	2.01	2.03	2.06			
Moisture Variation :	2.0%	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-	-			
ADJ Moisture Variation :	-	-	-	-			
Moisture Test Results :							
Field Moisture Content :	11.5%	11.5%	11.0%	11.5%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC						
Moisture Ratio :	N/A	N/A	N/A	N/A			
Density Test Results							
Field Wet Density (t/m ³) :	2.08	2.02	2.08	2.06			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	101.5%	100.5%	102.0%	100.0%			
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>				<p>APPROVED SIGNATORY</p>  Joshua Andres - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 25/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	24/06/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
----------------	---	--	--	--	--	--

Sample Number :	S/257646	S/257647	S/257648			
Date Tested :	20/06/2024	20/06/2024	20/06/2024			
Material Source :	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200			

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	06:55	07:00	07:05			
Lot Number :	-	-	-			
Location 1 :	E 499460	E 499504	E 499555			
Location 2 :	N 6932361	N 6932357	N 6932328			
Location 3 :	U.2m Below Finish Level	U.2m Below Finish Level	Finish Level			
Location 4 :	-	-	-			

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm			
Oversize Wet :	0%	0%	0%			
Oversize Density - Dry (t/m ³) :	-	-	-			
Assigned MDR (Yes/No) :	No	No	No			
MDR Sample Number :	S/257646	S/257647	S/257648			
MDR Test Date :	22/06/2024	22/06/2024	22/06/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist			

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.12	2.13	2.12			
Moisture Variation :	2.0%	2.0%	2.0%			
ADJ PCWD (t/m ³) :	-	-	-			
ADJ Moisture Variation :	-	-	-			

<i>Moisture Test Results :</i>						
Field Moisture Content :	10.0%	10.0%	11.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC			
Moisture Ratio :	N/A	N/A	N/A			

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.14	2.16	2.13			
Density Specification :	95%	95%	95%			
Wet Density Ratio :	101.0%	101.5%	100.5%			

Remarks :						
-----------	--	--	--	--	--	--

 <p>WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p>	<p>APPROVED SIGNATORY</p> 
	<p>Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	<p>Joshua Andres - Signatory</p>

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/14114 - 28/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	12/07/2024		
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1		Test Request :	-		
Project Number :	PTP/14114		Page 1 of 1			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/258213	S/258214				
Date Tested :	25/06/2024	25/06/2024				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	175 / 200	175 / 200				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	07:20	07:25				
Lot Number :	-	-				
Location 1 :	E 499420	E 499455				
Location 2 :	N 6932367	N 6932336				
Location 3 :	Finish Level	Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 37.5mm	< 19mm				
Oversize Wet :	23%	19%				
Oversize Density - Dry (t/m ³) :	2.38	2.37				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/258213	S/258214				
MDR Test Date :	28/06/2024	28/06/2024				
Compaction Type :	HILF-STD	HILF-STD				
Soil Description :	(Cl) Sandy CLAY, Medium Plasticity, Pale Brown, Moist	(Cl) Sandy CLAY, Medium Plasticity, Pale Brown, Moist				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	Not Testable using this Method	1.94				
Moisture Variation :	-	2.5%				
ADJ PCWD (t/m ³) :	-	2.01				
ADJ Moisture Variation :	-	2.0%				
<i>Moisture Test Results :</i>						
Field Moisture Content :	5.5%	5.0%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	-	2.0% Dry of OMC				
Moisture Ratio :	-	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.05	2.04				
Density Specification :	95%	95%				
Wet Density Ratio :	-	101.5%				
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 29/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	16/07/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,
----------------	---

Sample Number :	S/258379	S/258380	S/258381	S/258382	S/258383	S/258384
Date Tested :	26/06/2024	26/06/2024	26/06/2024	26/06/2024	26/06/2024	26/06/2024
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill					
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200

Sampling Method :	AS1289.1.2.1 - cl6.4b					
Time :	06:55	07:00	07:05	07:10	07:15	07:20
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499433	E 499459	E 499479	E 499495	E 499520	E 499540
Location 2 :	N 6932419	N 6932410	N 6932405	N 6932407	N 6932398	N 6932398
Location 3 :	U.3m Below Finish Level	U.1m Below Finish Level	U.4m Below Finish Level	U.2m Below Finish Level	U.2m Below Finish Level	U.5m Below Finish Level
Location 4 :	-	-	-	-	-	-

Test Fraction (mm) :	< 37.5mm	< 37.5mm	< 37.5mm	< 37.5mm	< 37.5mm	< 37.5mm
Oversize Wet :	30%	37%	9%	25%	17%	23%
Oversize Density - Dry (t/m ³) :	2.49	2.35	2.37	2.44	2.38	2.53
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/258379	S/258380	S/258381	S/258382	S/258383	S/258384
MDR Test Date :	0/01/1900	0/01/1900	3/07/2024	0/01/1900	3/07/2024	0/01/1900
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD
Soil Description :	GW - Sandy GRAVEL with CLAY - Brown	GW - Sandy GRAVEL with CLAY - Brown	(Cl) Gravelly Sandy CLAY, Medium Plasticity, Moist	GW - Sandy GRAVEL with CLAY - Brown	(Cl) Gravelly Sandy CLAY, Medium Plasticity, Moist	GW - Sandy GRAVEL with CLAY - Brown

MDR Test Results						
PCWD (t/m ³) :	Not Testable using this Method	Not Testable using this Method	2.14	Not Testable using this Method	2.18	Not Testable using this Method
Moisture Variation :	-	-	-0.5%	-	-0.5%	-
ADJ PCWD (t/m ³) :	-	-	2.15	-	2.21	-
ADJ Moisture Variation :	-	-	-0.5%	-	-0.5%	-

Moisture Test Results :						
Field Moisture Content :	7.5%	6.0%	11.5%	9.5%	10.5%	10.0%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	-	-	0.5% Wet of OMC	-	0.5% Wet of OMC	-
Moisture Ratio :	-	-	N/A	-	N/A	-

Density Test Results						
Field Wet Density (t/m ³) :	2.15	2.18	2.13	2.15	2.17	2.15
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	-	-	98.5%	-	98.0%	-

Remarks :	
-----------	--

 Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD	APPROVED SIGNATORY  Nick Dobson - Signatory
--	---

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 30/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	16/07/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,
----------------	---

Sample Number :	S/258515	S/258516	S/258517	S/258518	S/258519	S/258520
Date Tested :	27/06/2024	27/06/2024	27/06/2024	27/06/2024	27/06/2024	27/06/2024
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill					
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200

Sampling Method :	AS1289.1.2.1 - cl6.4b					
Time :	07:10	07:15	07:20	07:25	07:30	07:35
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499576	E 499553	E 499653	E 499655	E 499676	E 499689
Location 2 :	N 6932396	N 6932361	N 6932372	N 6932348	N 6932375	N 6932352
Location 3 :	0.2m Below Finish Level	0.1m Below Finish Level	0.6m Below Finish Level	0.4m Below Finish Level	0.5m Below Finish Level	0.6m Below Finish Level
Location 4 :	-	-	-	-	-	-

Test Fraction (mm) :	< 37.5mm	< 37.5mm	< 19mm	< 37.5mm	< 19mm	< 19mm
Oversize Wet :	19%	13%	17%	17%	6%	19%
Oversize Density - Dry (t/m³) :	2.29	2.38	2.42	2.48	2.39	2.34
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/258515	S/258516	S/258517	S/258518	S/258519	S/258520
MDR Test Date :	8/07/2024	8/07/2024	8/07/2024	8/07/2024	8/07/2024	8/07/2024
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD
Soil Description :	(Cl) Sandy CLAY, Medium Plasticity, Brown, Moist					

MDR Test Results						
PCWD (t/m3) :	2.08	2.07	2.05	2.08	2.07	2.03
Moisture Variation :	2.0%	2.0%	2.0%	2.0%	1.5%	2.5%
ADJ PCWD (t/m3) :	2.12	2.11	2.11	2.14	2.08	2.08
ADJ Moisture Variation :	2.0%	1.5%	1.5%	2.0%	1.5%	2.0%

Moisture Test Results :						
Field Moisture Content :	9.0%	10.0%	10.0%	9.5%	10.0%	8.5%
Moisture Specification :	+/-2.0% of OMC					
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A

Density Test Results						
Field Wet Density (t/m3) :	2.04	2.03	2.05	2.06	2.07	2.05
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	96.5%	96.5%	97.5%	96.5%	99.5%	98.5%

Remarks :	
-----------	--

 <p>WORLD HEALTH ORGANIZATION ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	<p>APPROVED SIGNATORY</p>  <p>Joshua Andres - Signatory</p>
	Document Number : RF1	Date : 6/06/2024

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth				Report Number :	SR/PTP/14114 - 32/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD				Report Date :	17/07/2024	
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1				Test Request :	-	
Project Number :	PTP/14114				Page 1 of 1		
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/258953	S/258954	S/258955	S/258956			
Date Tested :	1/07/2024	1/07/2024	1/07/2024	1/07/2024			
Material Source :	Onsite	Onsite	Onsite	Onsite			
For use as :	General Fill	General Fill	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200			
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	06:55	07:00	07:05	07:10			
Lot Number :	-	-	-	-			
Location 1 :	E 499488	E 499582	E 499666	E 499700			
Location 2 :	N 6932360	N 6932387	N 6932344	N 6932347			
Location 3 :	0.4m Below Finish Level	0.2m Below Finish Level	0.1m Below Finish Level	0.2m Below Finish Level			
Location 4 :	-	-	-	-			
Test Fraction (mm) :	< 37.5mm	< 37.5mm	< 37.5mm	< 19mm			
Oversize Wet :	22%	35%	13%	16%			
Oversize Density - Dry (t/m ³) :	2.22	2.11	2.35	2.31			
Assigned MDR (Yes/No) :	No	No	No	No			
MDR Sample Number :	S/258953	S/258954	S/258955	S/258956			
MDR Test Date :	12/07/2024	12/07/2024	12/07/2024	12/07/2024			
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD			
Soil Description :	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist			
MDR Test Results							
PCWD (t/m ³) :	Not Testable using this Method	Not Testable using this Method	2.08	2.07			
Moisture Variation :	-	-	2.0%	2.5%			
ADJ PCWD (t/m ³) :	-	-	2.11	2.10			
ADJ Moisture Variation :	-	-	2.0%	2.0%			
Moisture Test Results :							
Field Moisture Content :	9.5%	8.5%	9.0%	10.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	-	-	2.0% Dry of OMC	2.0% Dry of OMC			
Moisture Ratio :	-	-	N/A	N/A			
Density Test Results							
Field Wet Density (t/m ³) :	2.09	2.06	2.07	2.06			
Density Specification :	95%	95%	95%	95%			
Wet Density Ratio :	-	-	98.0%	98.0%			
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory						

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/14114 - 34/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	17/07/2024	
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1			Test Request :	-	
Project Number :	PTP/14114			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/258733	S/258734	S/258735	S/258736	S/258737	S/258738
Date Tested :	28/06/2024	28/06/2024	28/06/2024	28/06/2024	28/06/2024	28/06/2024
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	06:50	06:55	07:00	07:05	07:10	07:15
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499421	E 499441	E 499466	E 499473	E 499498	E 499523
Location 2 :	N 6932444	N 6932437	N 6932446	N 6932430	N 6932433	N 6932424
Location 3 :	0.3m Below Finish Level	0.4m Below Finish Level	0.1m Below Finish Level	0.1m Below Finish Level	0.3m Below Finish Level	0.5m Below Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	5%	13%	9%	9%	10%	11%
Oversize Density - Dry (t/m ³) :	2.14	2.35	2.36	2.36	2.40	2.15
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/258733	S/258734	S/258735	S/258736	S/258737	S/258738
MDR Test Date :	11/07/2024	11/07/2024	11/07/2024	11/07/2024	11/07/2024	11/07/2024
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD
Soil Description :	(CI) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(CI) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(CI) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(CI) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(CI) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(CI) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist
MDR Test Results						
PCWD (t/m ³) :	2.07	2.06	2.12	2.05	2.07	2.10
Moisture Variation :	2.0%	2.0%	1.5%	2.0%	2.0%	2.0%
ADJ PCWD (t/m ³) :	2.08	2.09	2.14	2.07	2.10	2.10
ADJ Moisture Variation :	2.0%	2.0%	1.5%	2.0%	1.5%	1.5%
Moisture Test Results :						
Field Moisture Content :	10.5%	10.5%	11.5%	10.0%	12.5%	12.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.06	2.09	2.07	2.06	2.08	2.09
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	99.5%	100.0%	97.0%	99.5%	99.0%	99.5%
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/14114 - 35/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	17/07/2024		
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1		Test Request :	-		
Project Number :	PTP/14114		Page 1 of 1			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/258739	S/258740				
Date Tested :	28/06/2024	28/06/2024				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	175 / 200	175 / 200				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	07:20	07:25				
Lot Number :	-	-				
Location 1 :	E 499545	E 499560				
Location 2 :	N 6932420	N 6932415				
Location 3 :	0.4m Below Finish Level	0.2m Below Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	14%	14%				
Oversize Density - Dry (t/m ³) :	2.38	2.21				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/258739	S/258740				
MDR Test Date :	11/07/2024	11/07/2024				
Compaction Type :	HILF-STD	HILF-STD				
Soil Description :	(Cl) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist	(Cl) Sandy CLAY trace Gravel, Medium Plasticity, Brown, Moist				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.04	2.04				
Moisture Variation :	2.0%	1.5%				
ADJ PCWD (t/m ³) :	2.09	2.06				
ADJ Moisture Variation :	2.0%	1.5%				
<i>Moisture Test Results</i>						
Field Moisture Content :	10.5%	13.0%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	2.0% Dry of OMC	1.5% Dry of OMC				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.06	2.05				
Density Specification :	95%	95%				
Wet Density Ratio :	98.5%	99.5%				
Remarks :						
 <p>World Recognised Accreditation</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p> <p>Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>			<p>APPROVED SIGNATORY</p>  <p>Joshua Andres - Signatory</p>		
	<p>Document Number : RF1</p>			<p>Date : 6/06/2024</p>		

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 40/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	23/07/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,				
----------------	---	--	--	--	--

Sample Number :	S/258385	S/258386			
Date Tested :	26/06/2024	26/06/2024			
Material Source :	Onsite	Onsite			
For use as :	General Fill	General Fill			
Test / Layer Depths :	175 / 200	175 / 200			

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b			
Time :	07:25	07:30			
Lot Number :	-	-			
Location 1 :	E 499375	E 499375			
Location 2 :	N 6932423	N 6932375			
Location 3 :	0.4m Below Finish Level	0.2m Below Finish Level			
Location 4 :	-	-			

Test Fraction (mm) :	< 37.5mm	< 37.5mm			
Oversize Wet :	21%	20%			
Oversize Density - Dry (t/m ³) :	2.51	2.43			
Assigned MDR (Yes/No) :	No	No			
MDR Sample Number :	S/258385	S/258386			
MDR Test Date :	0/01/1900	0/01/1900			
Compaction Type :	HILF-STD	HILF-STD			
Soil Description :	GW - Sandy GRAVEL with CLAY - Brown	GW - Sandy GRAVEL with Clay - Brown			

<i>MDR Test Results</i>					
PCWD (t/m ³) :	Not Testable using this Method	Not Testable using this Method			
Moisture Variation :	-	-			
ADJ PCWD (t/m ³) :	-	-			
ADJ Moisture Variation :	-	-			

<i>Moisture Test Results :</i>					
Field Moisture Content :	10.5%	10.0%			
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC			
Variation from OMC :	-	-			
Moisture Ratio :	-	-			

<i>Density Test Results</i>					
Field Wet Density (t/m ³) :	2.18	2.15			
Density Specification :	95%	95%			
Wet Density Ratio :	-	-			

Remarks :					
-----------	--	--	--	--	--

 <p>WORLD RECOGNISED ACCREDITATION</p>	<p>Note: The results contained in this report relate only to the item/s that were tested/sampled</p> <p>Accredited for Compliance with ISO/ IEC 17025 - Testing</p> <p>Protest Engineering (Gold Coast) Accreditation Number - 19667</p> <p>Base Laboratory Site Number - 22838 - Gold Coast</p>	<p>APPROVED SIGNATORY</p> 
	<p>Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	<p>Nick Dobson - Signatory</p>

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth	Report Number :	SR/PTP/14114 - 48/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	24/07/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,
----------------	---

Sample Number :	S/260931	S/260932	S/260933	S/260934		
Date Tested :	16/07/2024	16/07/2024	16/07/2024	16/07/2024		
Material Source :	Onsite	Onsite	Onsite	Onsite		
For use as :	General Fill	General Fill	General Fill	General Fill		
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200		

Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b		
Time :	10:30	10:40	10:50	11:00		
Lot Number :	-	-	-	-		
Location 1 :	E 499758	E 499556	E 499551	E 499505		
Location 2 :	N 6932376	N 6932353	N 6932342	N 6932345		
Location 3 :	0.2m Below Finish Level	Finish Level	Finish Level	0.1m Below Finish Level		
Location 4 :	-	-	-	-		

Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm		
Oversize Wet :	6%	6%	5%	5%		
Oversize Density - Dry (t/m ³) :	2.32	2.28	2.38	2.27		
Assigned MDR (Yes/No) :	No	No	No	No		
MDR Sample Number :	S/260931	S/260932	S/260933	S/260934		
MDR Test Date :	22/07/2024	22/07/2024	22/07/2024	22/07/2024		
Compaction Type :	Hilf-Std	Hilf-Std	Hilf-Std	Hilf-Std		
Soil Description :	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist	(CL) Sandy CLAY with Gravel, Low Plasticity, Brown, Moist		

<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.00	2.02	2.01	2.01		
Moisture Variation :	2.0%	2.5%	2.5%	2.0%		
ADJ PCWD (t/m ³) :	2.02	2.03	2.02	2.02		
ADJ Moisture Variation :	2.0%	2.0%	2.0%	2.0%		

<i>Moisture Test Results :</i>						
Field Moisture Content :	11.5%	11.0%	10.5%	11.0%		
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC		
Variation from OMC :	2.0% Dry of OMC					
Moisture Ratio :	N/A	N/A	N/A	N/A		

<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.04	2.03	2.04	2.03		
Density Specification :	95%	95%	95%	95%		
Wet Density Ratio :	101.0%	100.0%	100.5%	100.5%		

Remarks :	
-----------	--

	Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast	APPROVED SIGNATORY  Joshua Andres - Signatory
	Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD	

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth					Report Number :	SR/PTP/14114 - 50/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD					Report Date :	24/07/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1					Test Request :	-
Project Number :	PTP/14114					Page 1 of 1	
Location :	Greenbank						
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,						
Sample Number :	S/260640	S/260795	S/260796	S/260797	S/260798	S/260799	
Date Tested :	15/07/2024	15/07/2024	15/07/2024	15/07/2024	15/07/2024	15/07/2024	
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite	
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill	
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	
Time :	07:25	10:30	10:35	10:40	10:45	10:50	
Lot Number :	-	-	-	-	-	-	
Location 1 :	E 499510	E 499933	E 499910	E 499921	E 499848	E 499452	
Location 2 :	N 6932431	N 6932218	N 6932200	N 6932309	N 6932360	N 6932436	
Location 3 :	0.1m Below Finish Level	0.7m Below Finish Level	0.8m Below Finish Level	0.6m Below Finish Level	0.2m Below Finish Level	0.2m Below Finish Level	
Location 4 :	-	-	-	-	-	-	
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	
Oversize Wet :	6%	7%	6%	5%	15%	12%	
Oversize Density - Dry (t/m ³) :	2.50	2.23	2.41	2.46	2.37	2.41	
Assigned MDR (Yes/No) :	No	No	No	No	No	No	
MDR Sample Number :	S/260640	S/260795	S/260796	S/260797	S/260798	S/260799	
MDR Test Date :	22/07/2024	22/07/2024	22/07/2024	22/07/2024	22/07/2024	22/07/2024	
Compaction Type :	Hilf-Std	Hilf-Std	Hilf-Std	Hilf-Std	Hilf-Std	Hilf-Std	
Soil Description :	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	
MDR Test Results							
PCWD (t/m ³) :	2.00	2.03	2.01	2.00	1.98	2.00	
Moisture Variation :	1.5%	2.5%	2.0%	2.0%	2.5%	2.5%	
ADJ PCWD (t/m ³) :	2.03	2.04	2.03	2.02	2.03	2.04	
ADJ Moisture Variation :	1.5%	2.0%	1.5%	2.0%	2.0%	2.0%	
Moisture Test Results :							
Field Moisture Content :	11.5%	10.5%	11.5%	11.0%	10.5%	10.0%	
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	
Variation from OMC :	1.5% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC	
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A	
Density Test Results							
Field Wet Density (t/m ³) :	2.06	2.04	2.02	2.04	2.06	2.04	
Density Specification :	95%	95%	95%	95%	95%	95%	
Wet Density Ratio :	101.5%	100.0%	100.0%	100.5%	101.5%	100.0%	
Remarks :							
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>				APPROVED SIGNATORY  Joshua Andres - Signatory			

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth		Report Number :	SR/PTP/14114 - 51/1		
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD		Report Date :	24/07/2024		
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1		Test Request :	-		
Project Number :	PTP/14114		Page 1 of 1			
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/260800	S/260801				
Date Tested :	15/07/2024	15/07/2024				
Material Source :	Onsite	Onsite				
For use as :	General Fill	General Fill				
Test / Layer Depths :	175 / 200	175 / 200				
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b				
Time :	11:00	11:05				
Lot Number :	-	-				
Location 1 :	E 499377	E 499447				
Location 2 :	N 6932409	N 6932412				
Location 3 :	Finish Level	0.2m Below Finish Level				
Location 4 :	-	-				
Test Fraction (mm) :	< 19mm	< 19mm				
Oversize Wet :	5%	11%				
Oversize Density - Dry (t/m ³) :	2.44	2.40				
Assigned MDR (Yes/No) :	No	No				
MDR Sample Number :	S/260800	S/260801				
MDR Test Date :	22/07/2024	22/07/2024				
Compaction Type :	Hilf-Std	Hilf-Std				
Soil Description :	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist	(CL) Gravelly Sandy CLAY, Low Plasticity, Brown, Moist				
<i>MDR Test Results</i>						
PCWD (t/m ³) :	2.04	2.01				
Moisture Variation :	2.0%	2.0%				
ADJ PCWD (t/m ³) :	2.06	2.04				
ADJ Moisture Variation :	2.0%	2.0%				
<i>Moisture Test Results :</i>						
Field Moisture Content :	9.5%	10.0%				
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC				
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC				
Moisture Ratio :	N/A	N/A				
<i>Density Test Results</i>						
Field Wet Density (t/m ³) :	2.05	2.04				
Density Specification :	95%	95%				
Wet Density Ratio :	99.0%	100.0%				
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory					

Soil Compaction and Density Tests Report - Compaction Control

Client :	Shadforth			Report Number :	SR/PTP/14114 - 52/1	
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD			Report Date :	24/07/2024	
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1			Test Request :	-	
Project Number :	PTP/14114			Page 1 of 1		
Location :	Greenbank					
Test Methods :	AS1289.5.4.1, AS1289.5.8.1, AS1289.2.1.1, AS1289.5.7.1,					
Sample Number :	S/260398	S/260399	S/260400	S/260401	S/260402	S/260403
Date Tested :	12/07/2024	12/07/2024	12/07/2024	12/07/2024	12/07/2024	12/07/2024
Material Source :	Onsite	Onsite	Onsite	Onsite	Onsite	Onsite
For use as :	General Fill	General Fill	General Fill	General Fill	General Fill	General Fill
Test / Layer Depths :	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200	175 / 200
Sampling Method :	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b	AS1289.1.2.1 - cl6.4b
Time :	06:50	06:55	07:00	07:05	07:10	07:15
Lot Number :	-	-	-	-	-	-
Location 1 :	E 499364	E 499386	E 499336	E 499677	E 499844	E 499844
Location 2 :	N 6932457	N 6932456	N 6932381	N 6932346	N 6932333	N 6932283
Location 3 :	0.4m Below Finish Level	0.5m Below Finish Level	0.2m Below Finish Level	0.1m Below Finish Level	Finish Level	0.2m Below Finish Level
Location 4 :	-	-	-	-	-	-
Test Fraction (mm) :	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm	< 19mm
Oversize Wet :	7%	4%	6%	5%	6%	11%
Oversize Density - Dry (t/m ³) :	2.40	2.36	2.38	2.34	2.37	2.21
Assigned MDR (Yes/No) :	No	No	No	No	No	No
MDR Sample Number :	S/260398	S/260399	S/260400	S/260401	S/260402	S/260403
MDR Test Date :	19/07/2024	19/07/2024	19/07/2024	19/07/2024	19/07/2024	19/07/2024
Compaction Type :	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD	HILF-STD
Soil Description :	(CL) Sandy CLAY trace Gravel, Low Plasticity, Brown, Mottled Orange, Moist	(CL) Sandy CLAY trace Gravel, Low Plasticity, Brown, Mottled Orange, Moist	(CL) Sandy CLAY trace Gravel, Low Plasticity, Brown, Mottled Orange, Moist	(CL) Sandy CLAY trace Gravel, Low Plasticity, Brown, Mottled Orange, Moist	(CL) Sandy CLAY trace Gravel, Low Plasticity, Brown, Mottled Orange, Moist	(CL) Sandy CLAY trace Gravel, Low Plasticity, Brown, Mottled Orange, Moist
MDR Test Results						
PCWD (t/m ³) :	2.00	2.01	1.97	1.99	1.98	2.01
Moisture Variation :	2.5%	2.0%	1.5%	2.0%	2.0%	2.5%
ADJ PCWD (t/m ³) :	2.02	2.02	1.99	2.00	2.00	2.03
ADJ Moisture Variation :	2.0%	2.0%	1.5%	1.5%	2.0%	2.0%
Moisture Test Results :						
Field Moisture Content :	11.0%	11.0%	11.5%	11.5%	10.5%	10.5%
Moisture Specification :	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC	+/-2.0% of OMC
Variation from OMC :	2.0% Dry of OMC	2.0% Dry of OMC	1.5% Dry of OMC	1.5% Dry of OMC	2.0% Dry of OMC	2.0% Dry of OMC
Moisture Ratio :	N/A	N/A	N/A	N/A	N/A	N/A
Density Test Results						
Field Wet Density (t/m ³) :	2.01	2.02	2.00	2.01	2.01	2.02
Density Specification :	95%	95%	95%	95%	95%	95%
Wet Density Ratio :	99.5%	100.0%	100.5%	100.0%	101.0%	99.5%
Remarks :						
 <p>Note: The results contained in this report relate only to the item/s that were tested/sampled Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	APPROVED SIGNATORY  Joshua Andres - Signatory					

Particle Size Distribution Report

Client :	Shadforth	Report Number :	SR/PTP/14114 - 72/1
Client Address :	99 Sandalwood Lane, Forest Glen, 4556, QLD	Report Date :	17/09/2024
Project Name :	Everleigh - Precinct 8-10 Phase 2 - LV1	Test Request :	-
Project Number :	PTP/14114	Page 1 of 1	
Location :	Greenbank		

Test Methods :	AS1289.3.6.1, AS1289.2.1.1, AS1289.1.1
----------------	--

Material Description	(GM) Clayey Sandy GRAVEL, Medium-Grained, Brown, Moist
----------------------	--



Sample Number :	S/266683	Sampling Method :	AS1289.1.2.1 - cl6.4b
Date(s) Tested :	29/08/2024 - 17/09/2024	Time :	07:30
Material Source :	Onsite	Location 1 :	Precinct 8.3
For Use As :	General Fill	Location 2 :	E 499497
Lot Number :	-	Location 3 :	N 6932392
PSD Specification Number :	N/A	Location 4 :	Top 600

AS Sieve Size (mm) :	Percent Passing (%) :	Specification Limits :
75.0	100	
63.0		
53.0	91	
37.5	87	
26.5	74	
19.0	70	
16		
13.2	65	
9.5	62	
6.7	59	
4.75	57	
2.36	51	
1.18	49	
0.600	45	
0.425	41	
0.300	33	
0.150	19	
0.075	15	

Particle Size Distribution Graph

Remarks :	-
-----------	---

 <p>Accredited for Compliance with ISO/ IEC 17025 - Testing Protest Engineering (Gold Coast) Accreditation Number - 19667 Base Laboratory Site Number - 22838 - Gold Coast Base Laboratory Address - 8/36 Blanck Street, Ormeau, 4208, QLD</p>	<p>APPROVED SIGNATORY</p>  <p>Joshua Andres - Signatory</p>
--	--

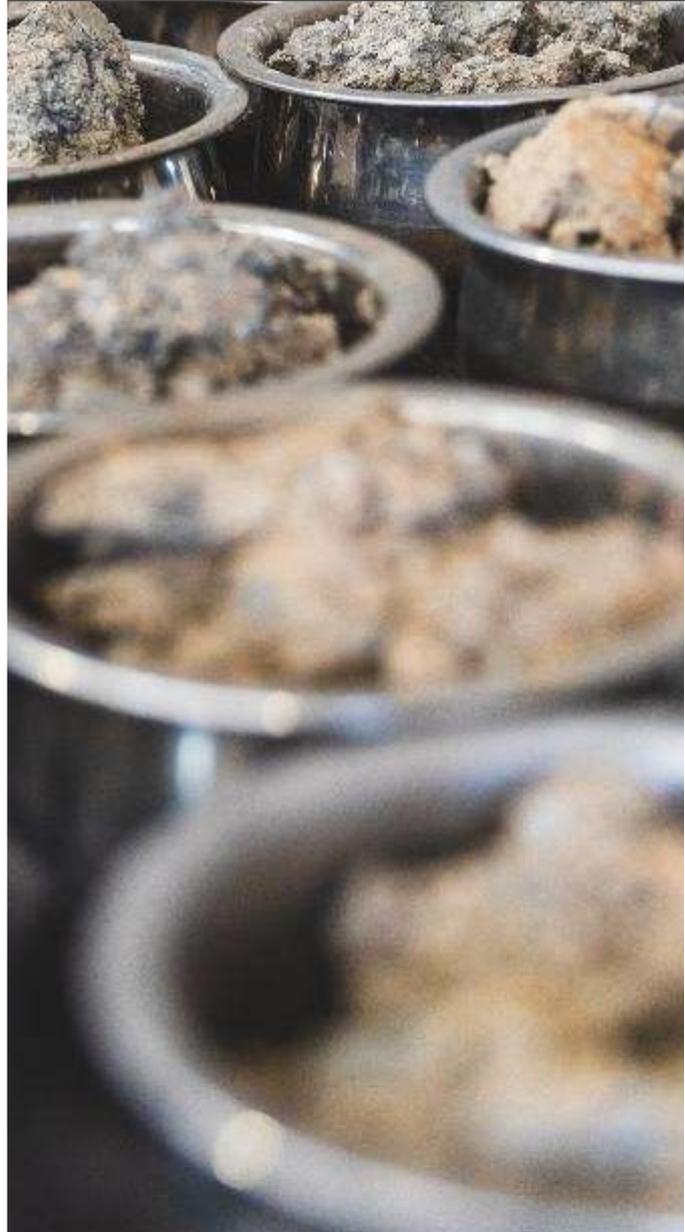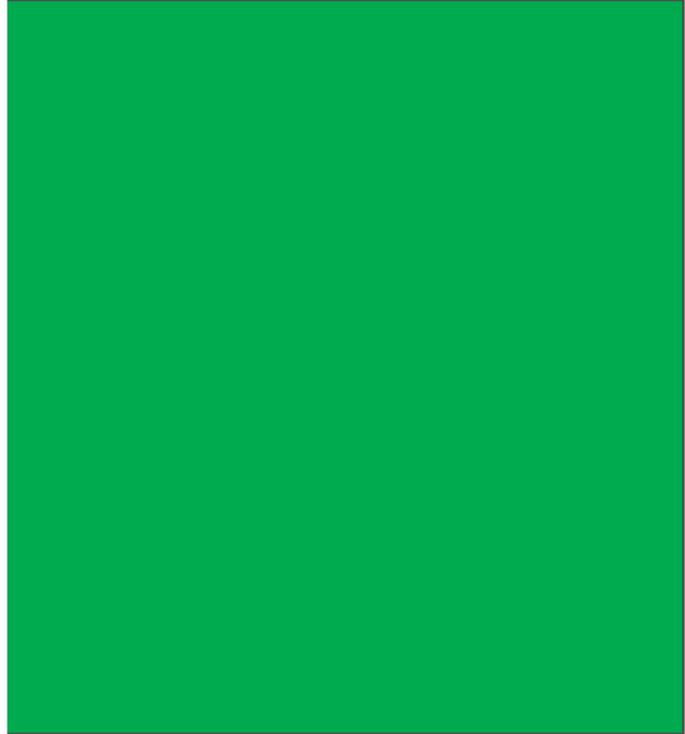

PROTEST
CONSTRUCTION MATERIALS TESTING

